




**Appendix 2: Extreme Value Analysis of Total Water Levels:
points SW1-SW58 and S1-S26**

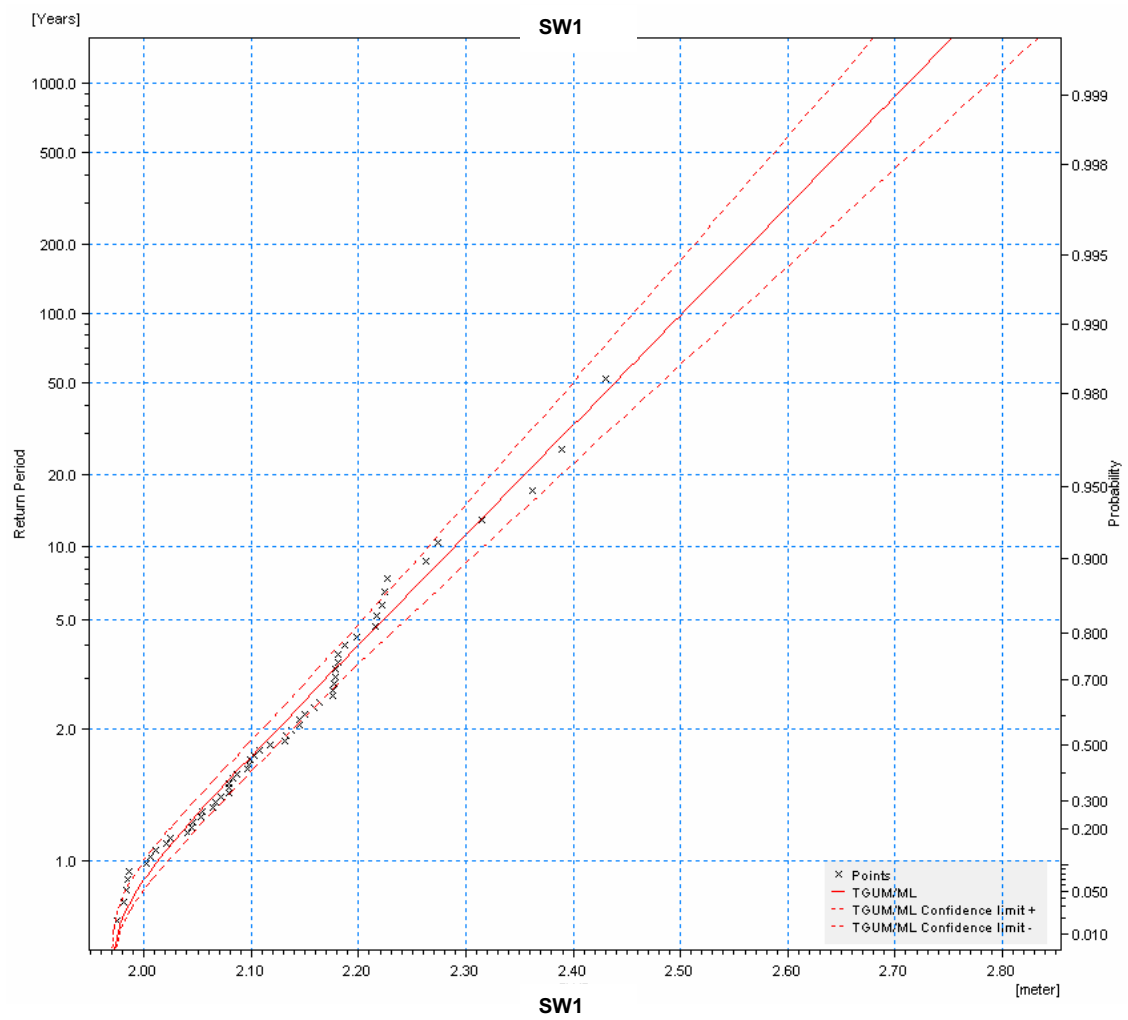


SW1		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.012
	2.00	2.124
	5.00	2.222
	10.00	2.290
	20.00	2.355
	25.00	2.375
	50.00	2.439
	100.00	2.502
	200.00	2.565
	500.00	2.648
	1000.00	2.711
Average quantile	1.00	2.011
	2.00	2.124
	5.00	2.223
	10.00	2.291
	20.00	2.356
	25.00	2.377
	50.00	2.441
	100.00	2.505
	200.00	2.568
	500.00	2.651
	1000.00	2.715
Standard deviation	1.00	0.011
	2.00	0.014
	5.00	0.020
	10.00	0.026
	20.00	0.032
	25.00	0.034
	50.00	0.041
	100.00	0.048
	200.00	0.055
	500.00	0.065
	1000.00	0.072
Goodness-of-fit statistics	CHISQ	5.982
	SLSC	0.023
	PPCC1	0.993
	PPCC2	0.993

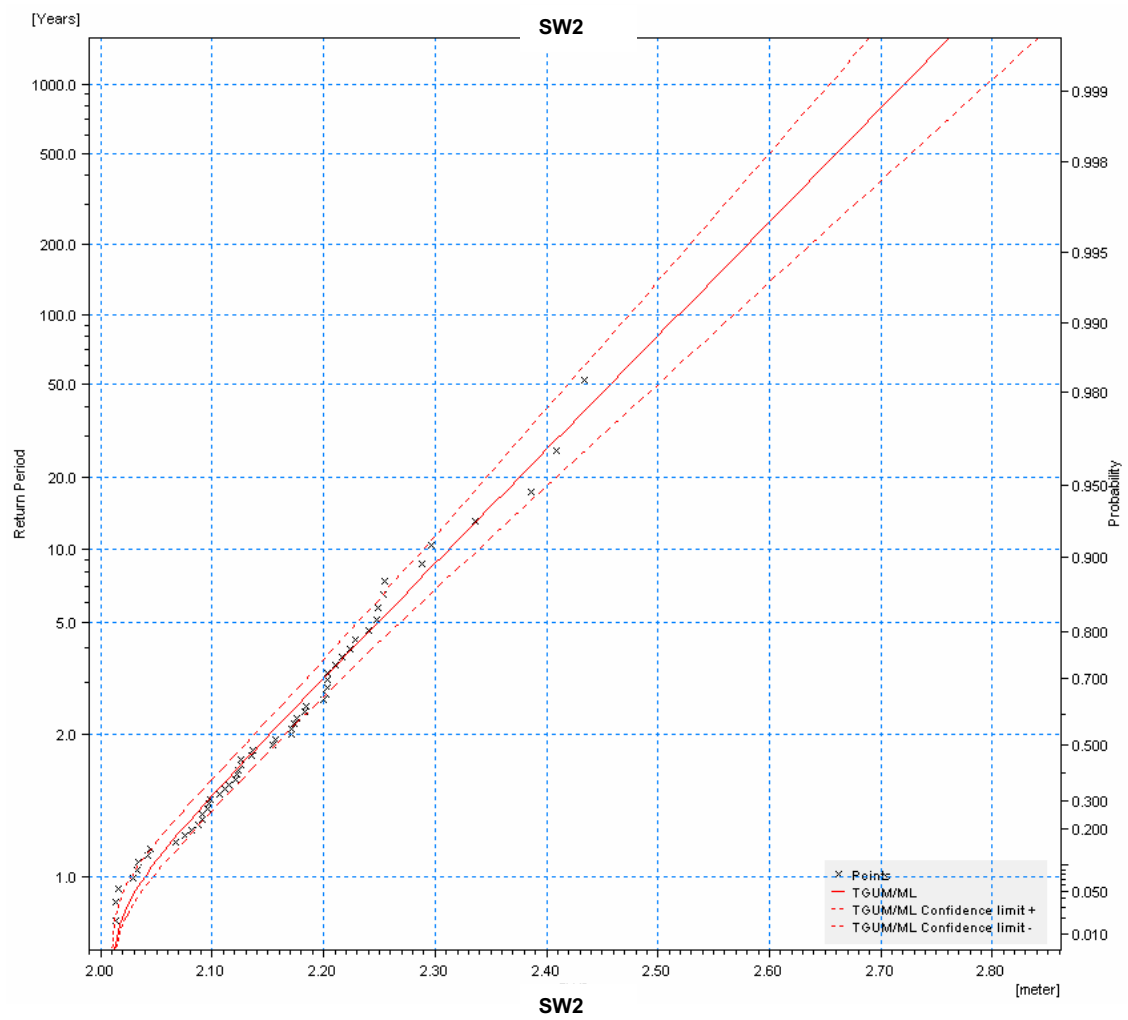


SW2		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.040
	2.00	2.152
	5.00	2.248
	10.00	2.313
	20.00	2.376
	25.00	2.396
	50.00	2.458
	100.00	2.519
	200.00	2.580
	500.00	2.660
	1000.00	2.721
Average quantile	1.00	2.037
	2.00	2.152
	5.00	2.249
	10.00	2.315
	20.00	2.378
	25.00	2.398
	50.00	2.460
	100.00	2.521
	200.00	2.583
	500.00	2.664
	1000.00	2.725
Standard deviation	1.00	0.010
	2.00	0.014
	5.00	0.019
	10.00	0.025
	20.00	0.031
	25.00	0.033
	50.00	0.040
	100.00	0.047
	200.00	0.054
	500.00	0.064
	1000.00	0.071
Goodness -of-fit statistics	CHISQ	10.636
	SLSC	0.023
	PPCC1	0.993
	PPCC2	0.993

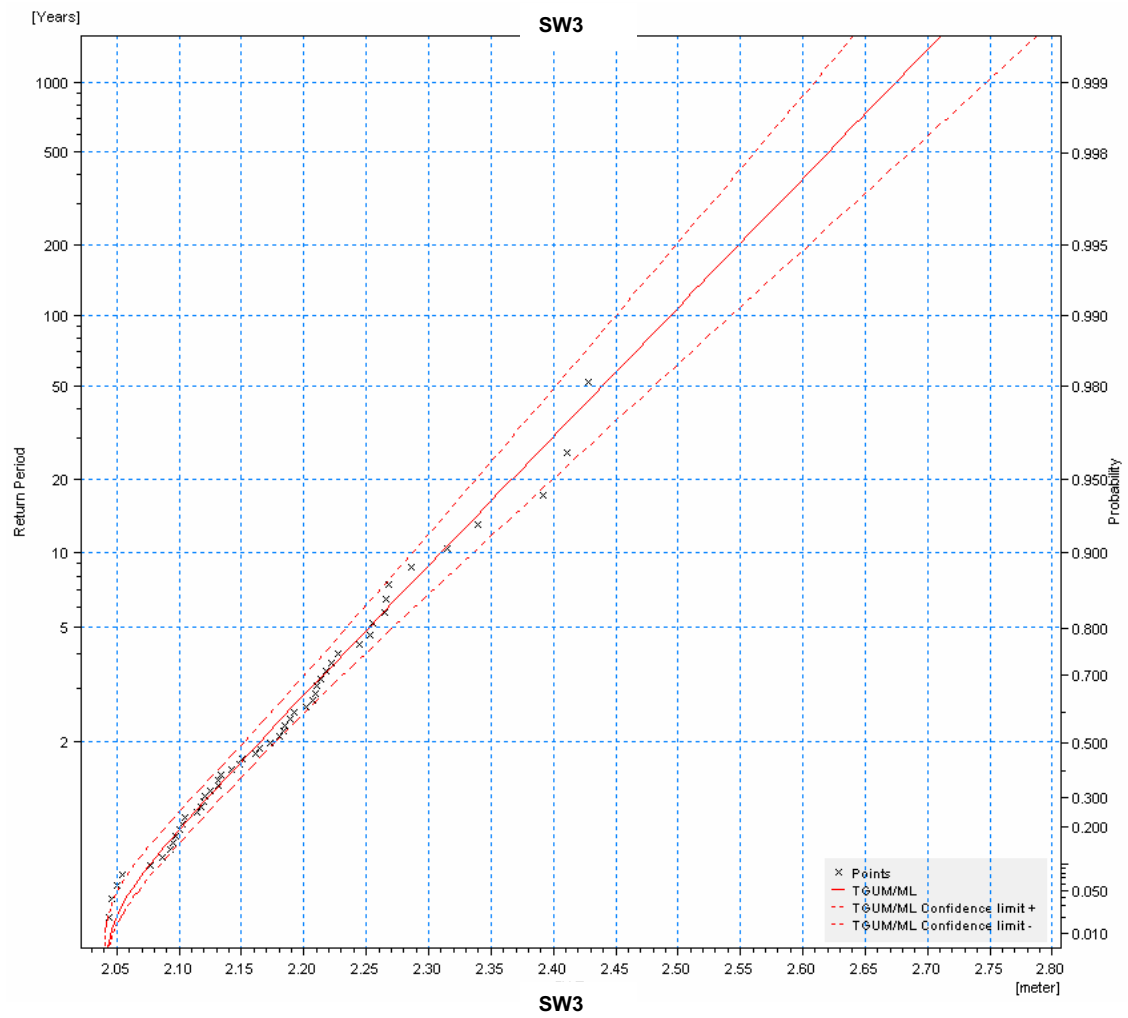


SW3		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.042
	2.00	2.164
	5.00	2.252
	10.00	2.310
	20.00	2.367
	25.00	2.384
	50.00	2.439
	100.00	2.494
	200.00	2.549
	500.00	2.620
	1000.00	2.675
Average quantile	1.00	2.041
	2.00	2.164
	5.00	2.253
	10.00	2.312
	20.00	2.368
	25.00	2.386
	50.00	2.442
	100.00	2.497
	200.00	2.551
	500.00	2.624
	1000.00	2.678
Standard deviation	1.00	0.001
	2.00	0.013
	5.00	0.018
	10.00	0.024
	20.00	0.031
	25.00	0.033
	50.00	0.040
	100.00	0.046
	200.00	0.053
	500.00	0.062
	1000.00	0.069
Goodness-of-fit statistics	CHISQ	2.529
	SLSC	0.021
	PPCC1	0.995
	PPCC2	0.995

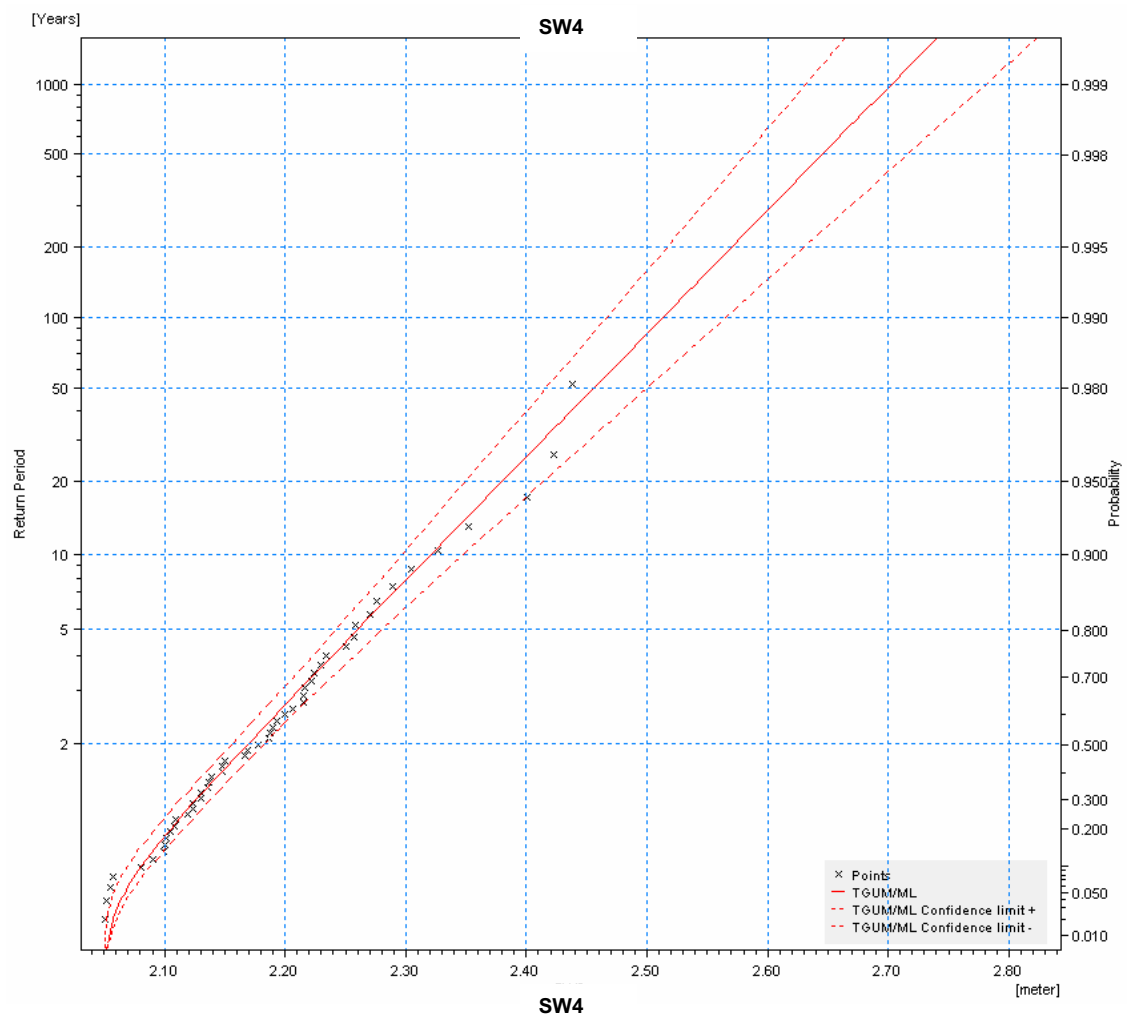


SW4		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.051
	2.00	2.169
	5.00	2.260
	10.00	2.321
	20.00	2.380
	25.00	2.399
	50.00	2.456
	100.00	2.513
	200.00	2.570
	500.00	2.646
	1000.00	2.702
Average quantile	1.00	2.051
	2.00	2.169
	5.00	2.261
	10.00	2.323
	20.00	2.382
	25.00	2.401
	50.00	2.459
	100.00	2.516
	200.00	2.573
	500.00	2.649
	1000.00	2.706
Standard deviation	1.00	0.0008
	2.00	0.013
	5.00	0.019
	10.00	0.025
	20.00	0.032
	25.00	0.035
	50.00	0.042
	100.00	0.049
	200.00	0.057
	500.00	0.067
	1000.00	0.075
Goodness-of-fit statistics	CHISQ	1.745
	SLSC	0.020
	PPCC1	0.996
	PPCC2	0.996

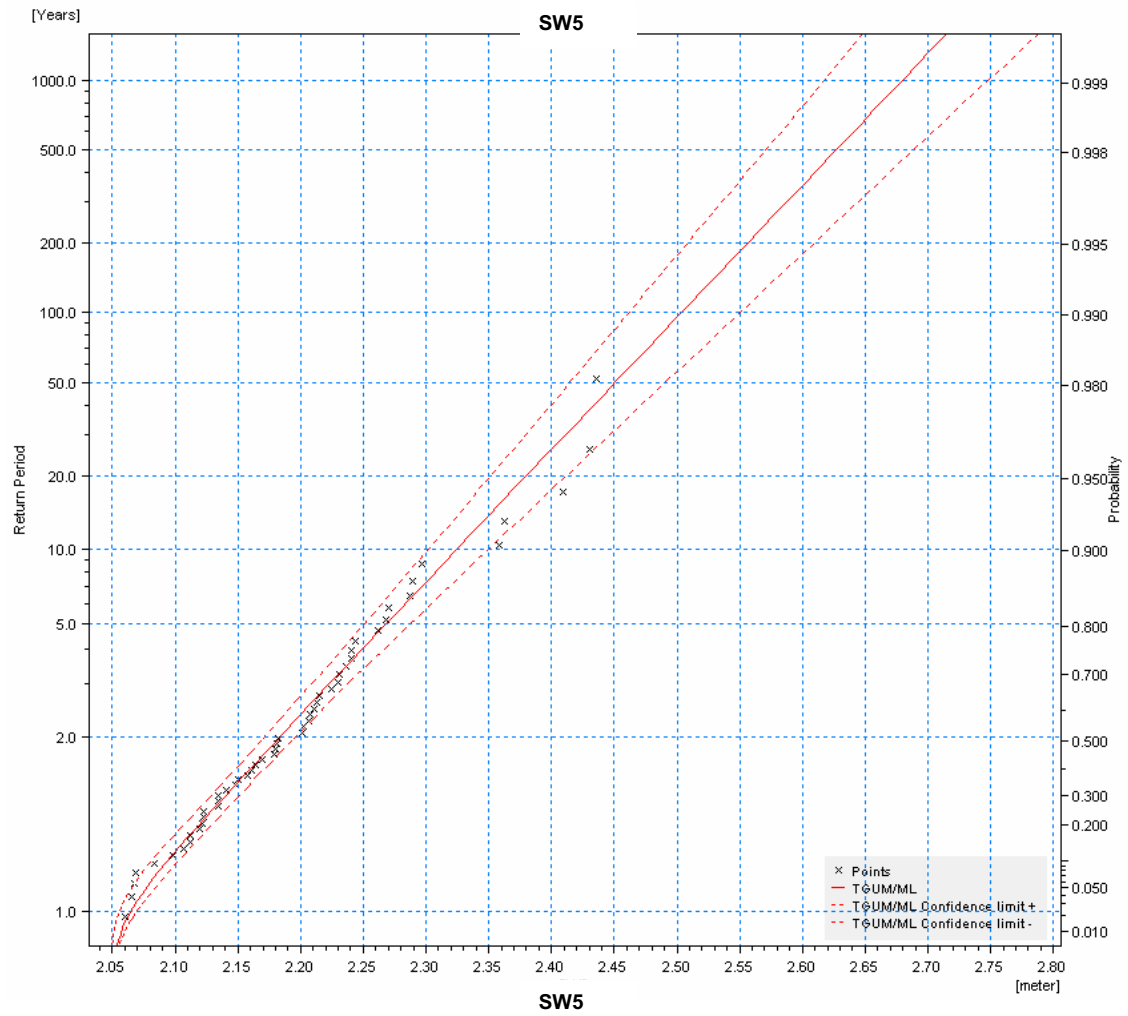


SW5		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.065
	2.00	2.183
	5.00	2.268
	10.00	2.325
	20.00	2.380
	25.00	2.397
	50.00	2.451
	100.00	2.504
	200.00	2.557
	500.00	2.627
	1000.00	2.679
Average quantile	1.00	2.062
	2.00	2.183
	5.00	2.269
	10.00	2.326
	20.00	2.381
	25.00	2.399
	50.00	2.453
	100.00	2.506
	200.00	2.559
	500.00	2.630
	1000.00	2.683
Standard deviation	1.00	0.007
	2.00	0.012
	5.00	0.018
	10.00	0.024
	20.00	0.030
	25.00	0.032
	50.00	0.038
	100.00	0.044
	200.00	0.051
	500.00	0.059
	1000.00	0.065
Goodness-of-fit statistics	CHISQ	2.231
	SLSC	0.025
	PPCC1	0.993
	PPCC2	0.993

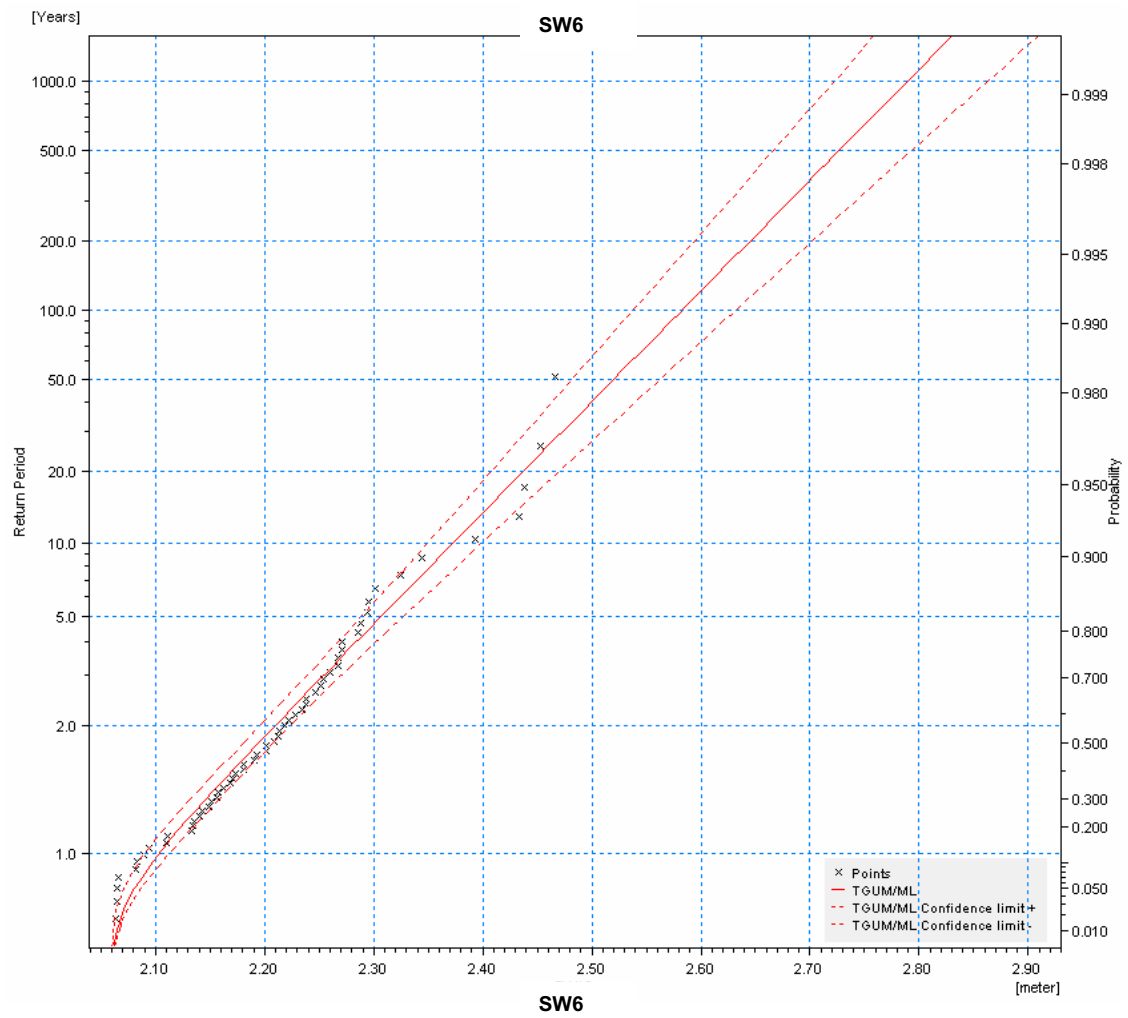


SW6		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.104
	2.00	2.210
	5.00	2.307
	10.00	2.373
	20.00	2.437
	25.00	2.457
	50.00	2.520
	100.00	2.582
	200.00	2.645
	500.00	2.727
	1000.00	2.789
Average quantile	1.00	2.102
	2.00	2.210
	5.00	2.308
	10.00	2.374
	20.00	2.439
	25.00	2.459
	50.00	2.522
	100.00	2.585
	200.00	2.647
	500.00	2.730
	1000.00	2.792
Standard deviation	1.00	0.011
	2.00	0.014
	5.00	0.019
	10.00	0.025
	20.00	0.031
	25.00	0.033
	50.00	0.040
	100.00	0.047
	200.00	0.054
	500.00	0.063
	1000.00	0.070
Goodness-of-fit statistics	CHISQ	4.759
	SLSC	0.028
	PPCC1	0.990
	PPCC2	0.990

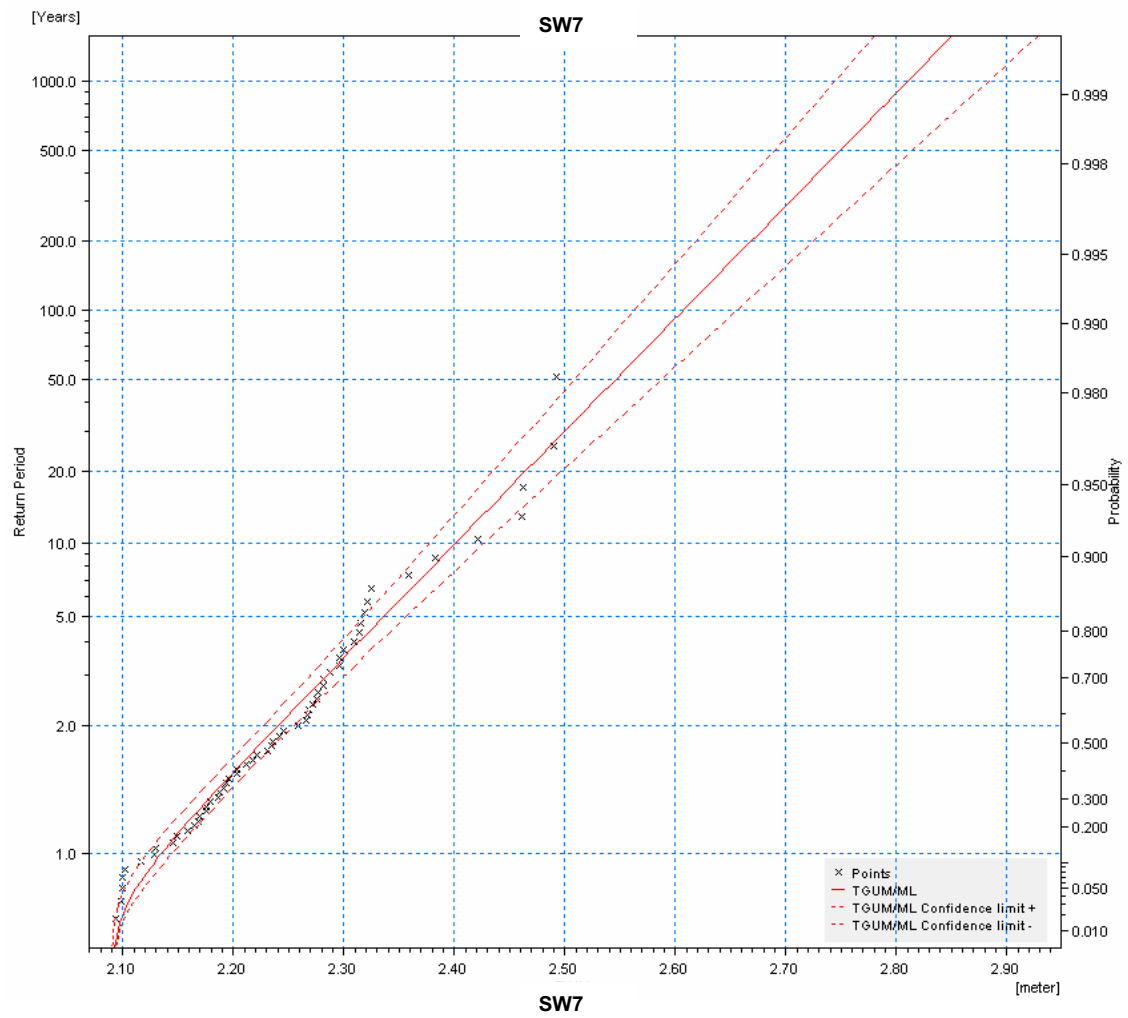


SW7		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.135
	2.00	2.241
	5.00	2.336
	10.00	2.401
	20.00	2.464
	25.00	2.484
	50.00	2.546
	100.00	2.607
	200.00	2.668
	500.00	2.749
Average quantile	1000.00	2.810
	1.00	2.133
	2.00	2.241
	5.00	2.337
	10.00	2.402
	20.00	2.466
	25.00	2.486
	50.00	2.548
	100.00	2.610
	200.00	2.671
Standard deviation	500.00	2.752
	1000.00	2.813
	1.00	0.011
	2.00	0.014
	5.00	0.019
	10.00	0.025
	20.00	0.031
	25.00	0.033
	50.00	0.040
	100.00	0.046
Goodness-of-fit statistics	200.00	0.053
	500.00	0.062
	1000.00	0.069
	CHISQ	5.793
	SLSC	0.029
	PPCC1	0.989
	PPCC2	0.989

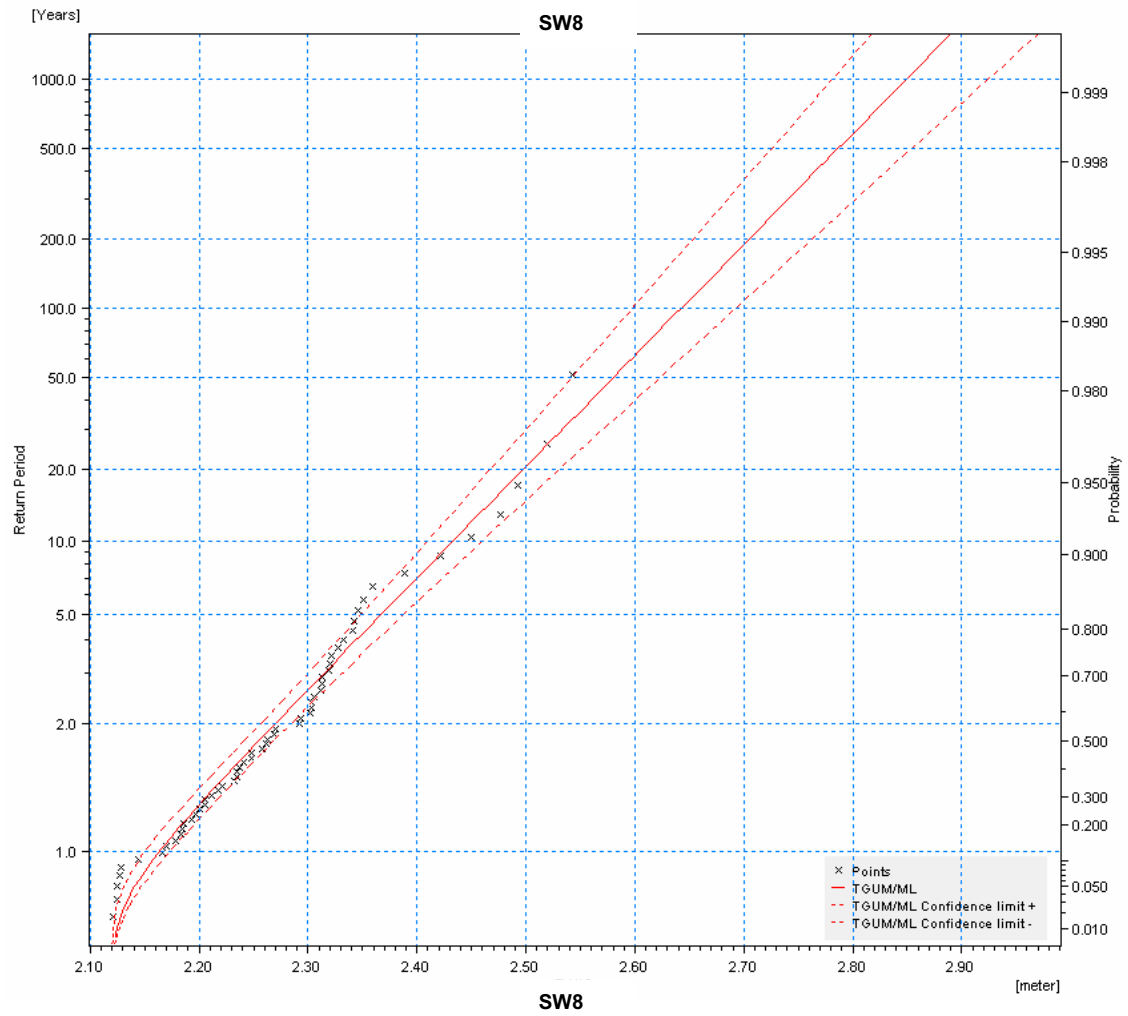


SW8		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.164
	2.00	2.270
	5.00	2.367
	10.00	2.433
	20.00	2.497
	25.00	2.517
	50.00	2.580
	100.00	2.642
	200.00	2.705
	500.00	2.787
	1000.00	2.849
Average quantile	1.00	2.162
	2.00	2.271
	5.00	2.368
	10.00	2.435
	20.00	2.499
	25.00	2.519
	50.00	2.582
	100.00	2.645
	200.00	2.707
	500.00	2.790
	1000.00	2.852
Standard deviation	1.00	0.012
	2.00	0.014
	5.00	0.019
	10.00	0.025
	20.00	0.031
	25.00	0.034
	50.00	0.041
	100.00	0.048
	200.00	0.055
	500.00	0.064
	1000.00	0.071
Goodness-of-fit statistics	CHISQ	8.897
	SLSC	0.027
	PPCC1	0.991
	PPCC2	0.991

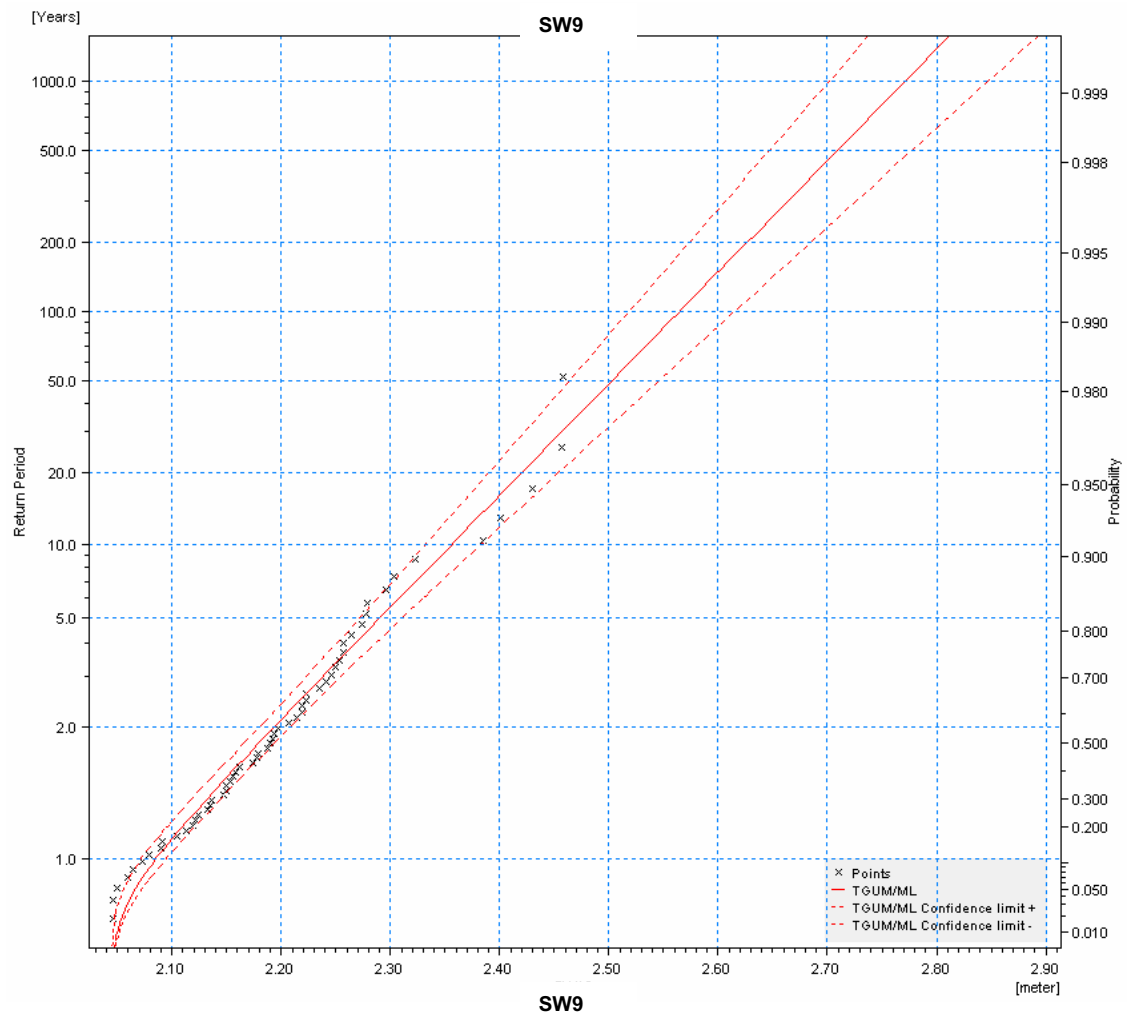


SW9		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.085
	2.00	2.193
	5.00	2.290
	10.00	2.356
	20.00	2.420
	25.00	2.440
	50.00	2.503
	100.00	2.565
	200.00	2.627
	500.00	2.709
	1000.00	2.771
Average quantile	1.00	2.083
	2.00	2.194
	5.00	2.291
	10.00	2.358
	20.00	2.422
	25.00	2.442
	50.00	2.505
	100.00	2.567
	200.00	2.630
	500.00	2.712
	1000.00	2.774
Standard deviation	1.00	0.011
	2.00	0.014
	5.00	0.019
	10.00	0.025
	20.00	0.032
	25.00	0.034
	50.00	0.041
	100.00	0.048
	200.00	0.056
	500.00	0.065
	1000.00	0.073
Goodness-of-fit statistics	CHISQ	6.684
	SLSC	0.026
	PPCC1	0.991
	PPCC2	0.991

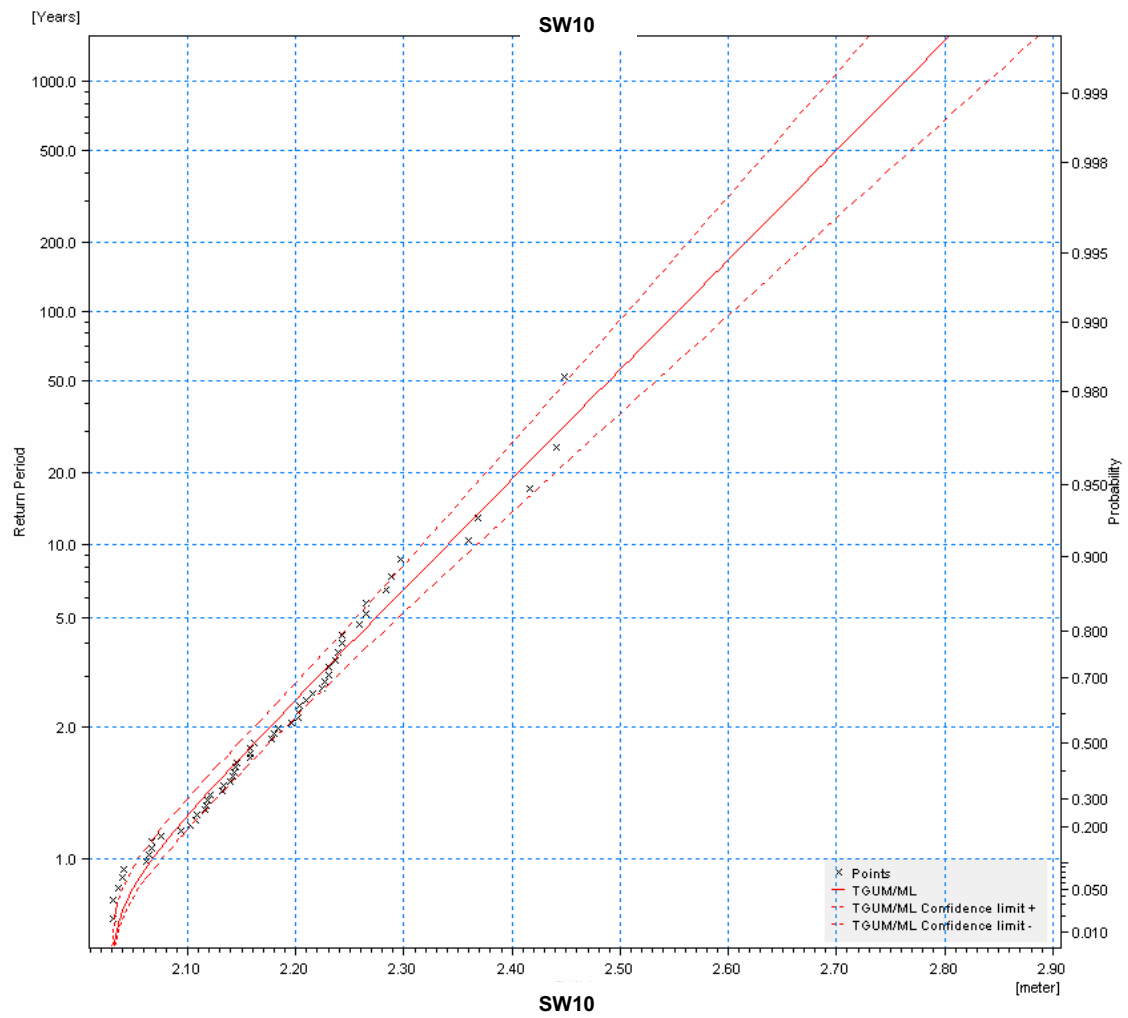


SW10		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.067
	2.00	2.175
	5.00	2.274
	10.00	2.341
	20.00	2.406
	25.00	2.426
	50.00	2.490
	100.00	2.553
	200.00	2.616
	500.00	2.700
	1000.00	2.763
Average quantile	1.00	2.065
	2.00	2.176
	5.00	2.275
	10.00	2.342
	20.00	2.408
	25.00	2.428
	50.00	2.492
	100.00	2.556
	200.00	2.619
	500.00	2.703
	1000.00	2.766
Standard deviation	1.00	0.011
	2.00	0.014
	5.00	0.019
	10.00	0.025
	20.00	0.032
	25.00	0.034
	50.00	0.041
	100.00	0.049
	200.00	0.056
	500.00	0.066
	1000.00	0.073
Goodness-of-fit statistics	CHISQ	5.632
	SLSC	0.026
	PPCC1	0.991
	PPCC2	0.991

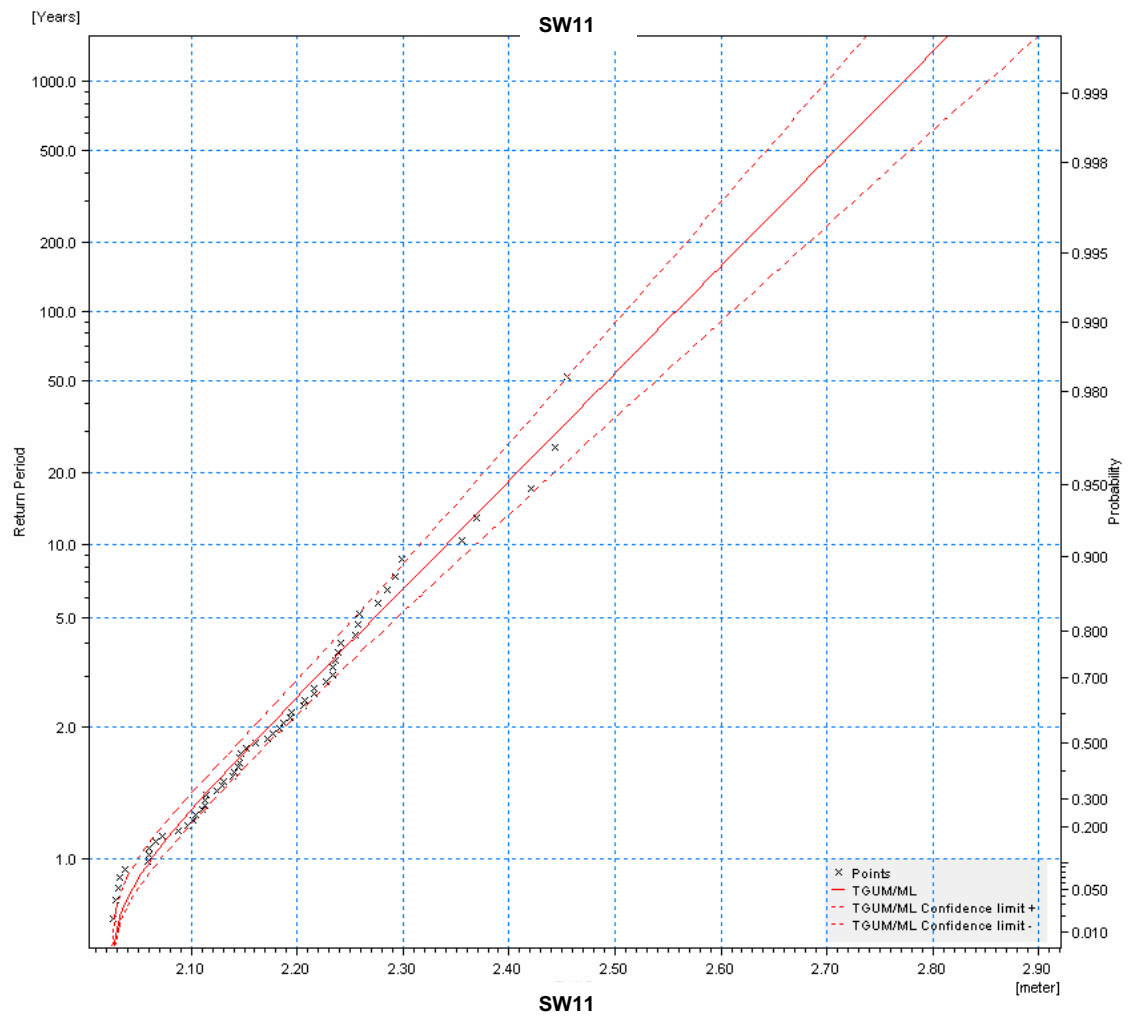


SW11		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.062
	2.00	2.172
	5.00	2.273
	10.00	2.341
	20.00	2.407
	25.00	2.428
	50.00	2.493
	100.00	2.558
	200.00	2.622
	500.00	2.707
	1000.00	2.772
Average quantile	1.00	2.060
	2.00	2.173
	5.00	2.274
	10.00	2.343
	20.00	2.409
	25.00	2.430
	50.00	2.496
	100.00	2.561
	200.00	2.625
	500.00	2.711
	1000.00	2.775
Standard deviation	1.00	0.011
	2.00	0.015
	5.00	0.020
	10.00	0.026
	20.00	0.033
	25.00	0.036
	50.00	0.043
	100.00	0.050
	200.00	0.058
	500.00	0.068
	1000.00	0.076
Goodness -of-fit statistics	CHISQ	4.930
	SLSC	0.023
	PPCC1	0.993
	PPCC2	0.993

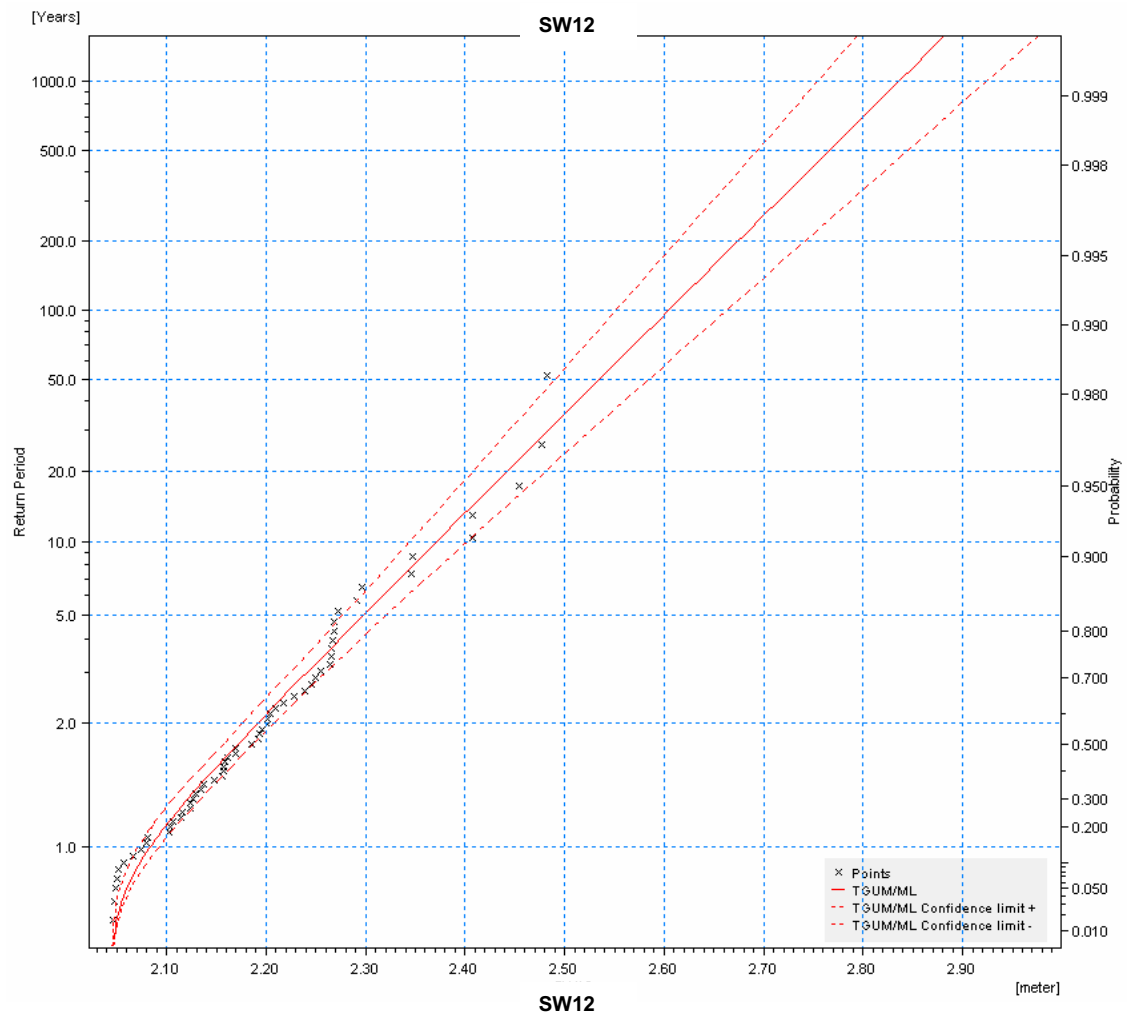


SW12		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.084
	2.00	2.191
	5.00	2.298
	10.00	2.371
	20.00	2.442
	25.00	2.465
	50.00	2.535
	100.00	2.605
	200.00	2.674
	500.00	2.766
	1000.00	2.835
Average quantile	1.00	2.082
	2.00	2.192
	5.00	2.299
	10.00	2.373
	20.00	2.444
	25.00	2.467
	50.00	2.537
	100.00	2.607
	200.00	2.677
	500.00	2.769
	1000.00	2.839
Standard deviation	1.00	0.010
	2.00	0.016
	5.00	0.022
	10.00	0.029
	20.00	0.036
	25.00	0.039
	50.00	0.047
	100.00	0.056
	200.00	0.064
	500.00	0.076
	1000.00	0.085
Goodness-of-fit statistics	CHISQ	8.288
	SLSC	0.027
	PPCC1	0.991
	PPCC2	0.991

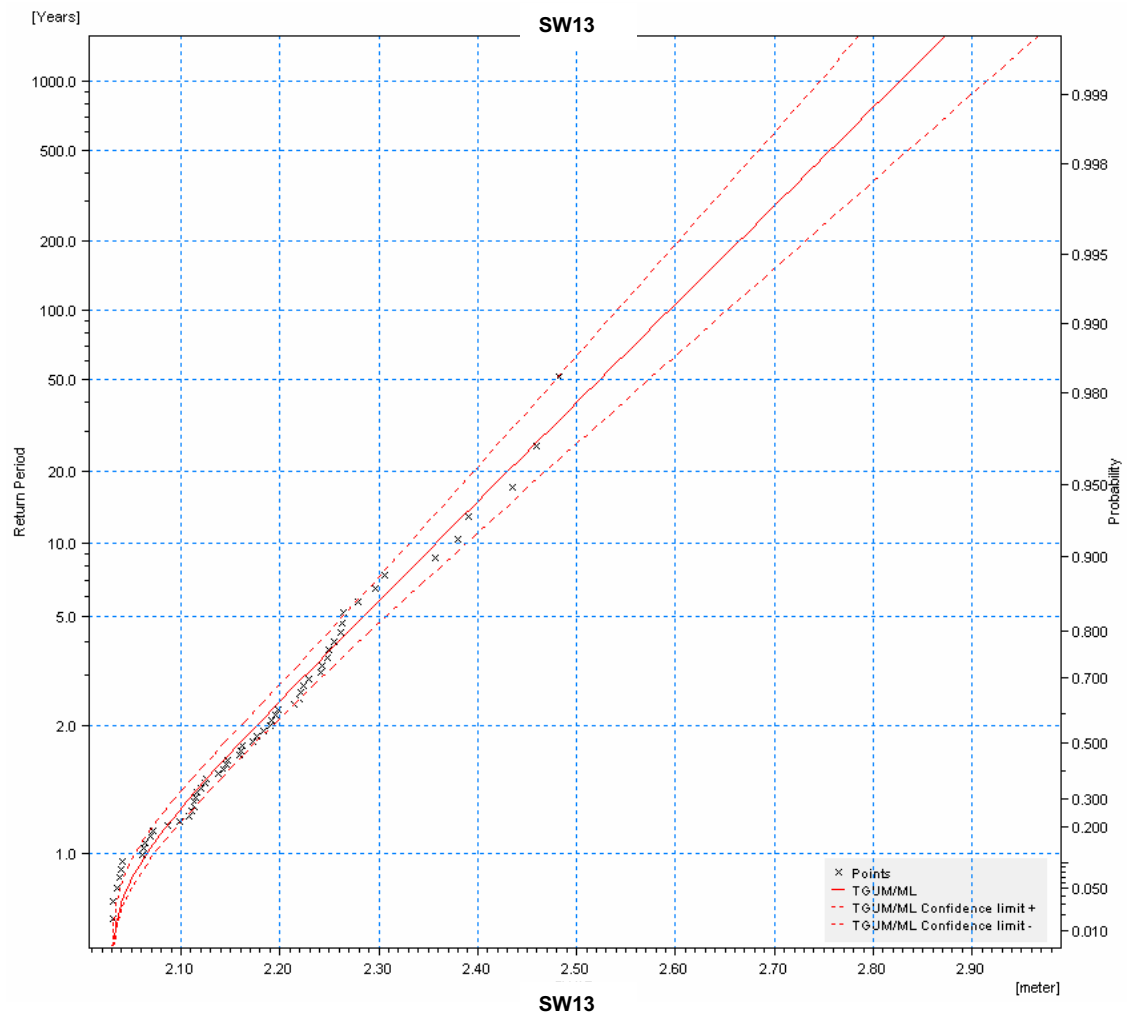


SW13		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.066
	2.00	2.177
	5.00	2.284
	10.00	2.358
	20.00	2.430
	25.00	2.453
	50.00	2.523
	100.00	2.594
	200.00	2.664
	500.00	2.756
Average quantile	1000.00	2.826
	1.00	2.064
	2.00	2.177
	5.00	2.285
	10.00	2.360
	20.00	2.432
	25.00	2.455
	50.00	2.526
	100.00	2.596
	200.00	2.667
Standard deviation	500.00	2.759
	1000.00	2.829
	1.00	0.010
	2.00	0.016
	5.00	0.022
	10.00	0.029
	20.00	0.036
	25.00	0.039
	50.00	0.047
	100.00	0.056
Goodness-of-fit statistics	200.00	0.064
	500.00	0.076
	1000.00	0.084
	CHISQ	7.517
	SLSC	0.023
	PPCC1	0.993
	PPCC2	0.993

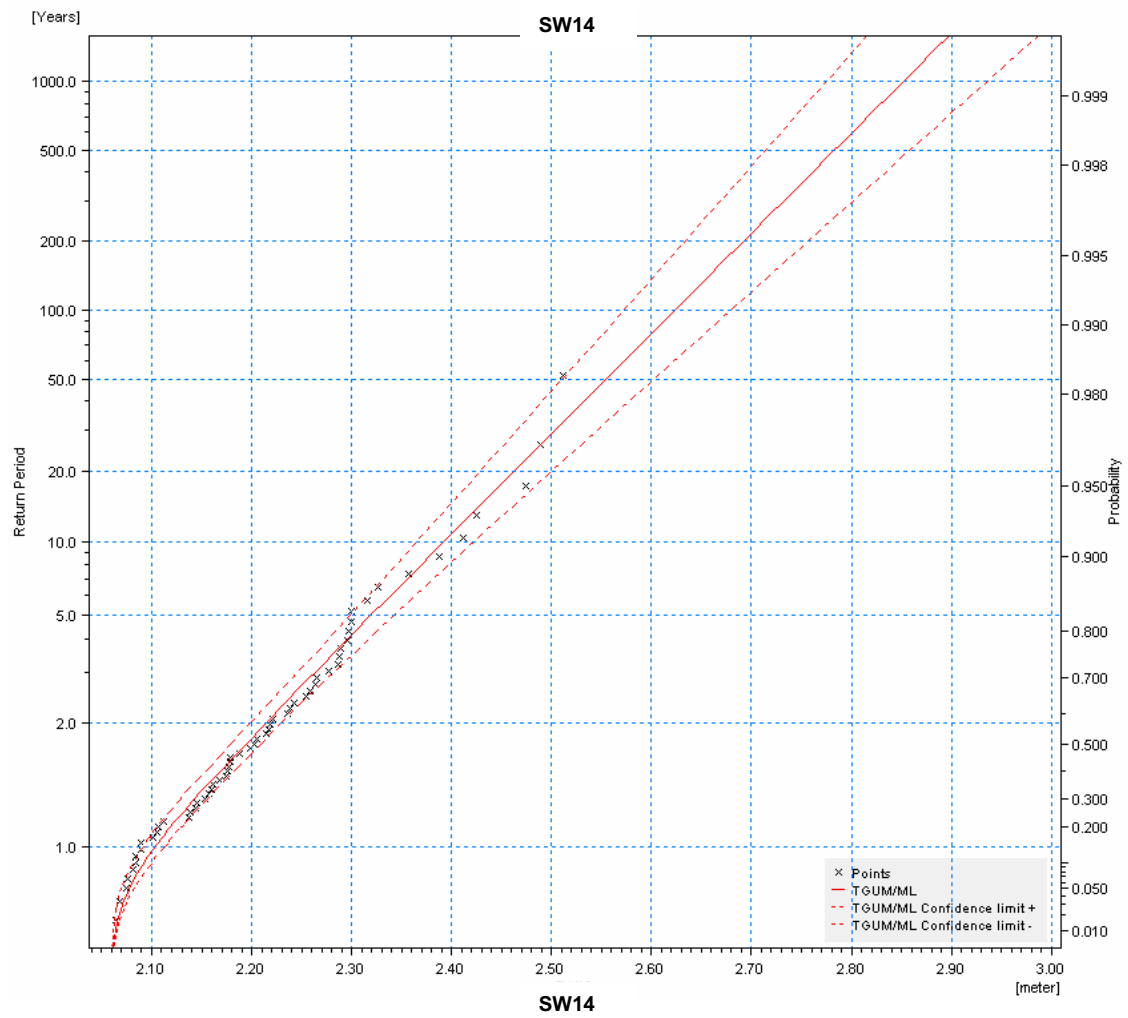


SW14		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.103
	2.00	2.214
	5.00	2.319
	10.00	2.392
	20.00	2.463
	25.00	2.485
	50.00	2.555
	100.00	2.624
	200.00	2.692
	500.00	2.783
	1000.00	2.852
Average quantile	1.00	2.102
	2.00	2.214
	5.00	2.320
	10.00	2.394
	20.00	2.465
	25.00	2.487
	50.00	2.557
	100.00	2.626
	200.00	2.695
	500.00	2.786
	1000.00	2.855
Standard deviation	1.00	0.011
	2.00	0.016
	5.00	0.022
	10.00	0.028
	20.00	0.036
	25.00	0.038
	50.00	0.046
	100.00	0.054
	200.00	0.062
	500.00	0.072
	1000.00	0.081
Goodness-of-fit statistics	CHISQ	11.678
	SLSC	0.022
	PPCC1	0.994
	PPCC2	0.994

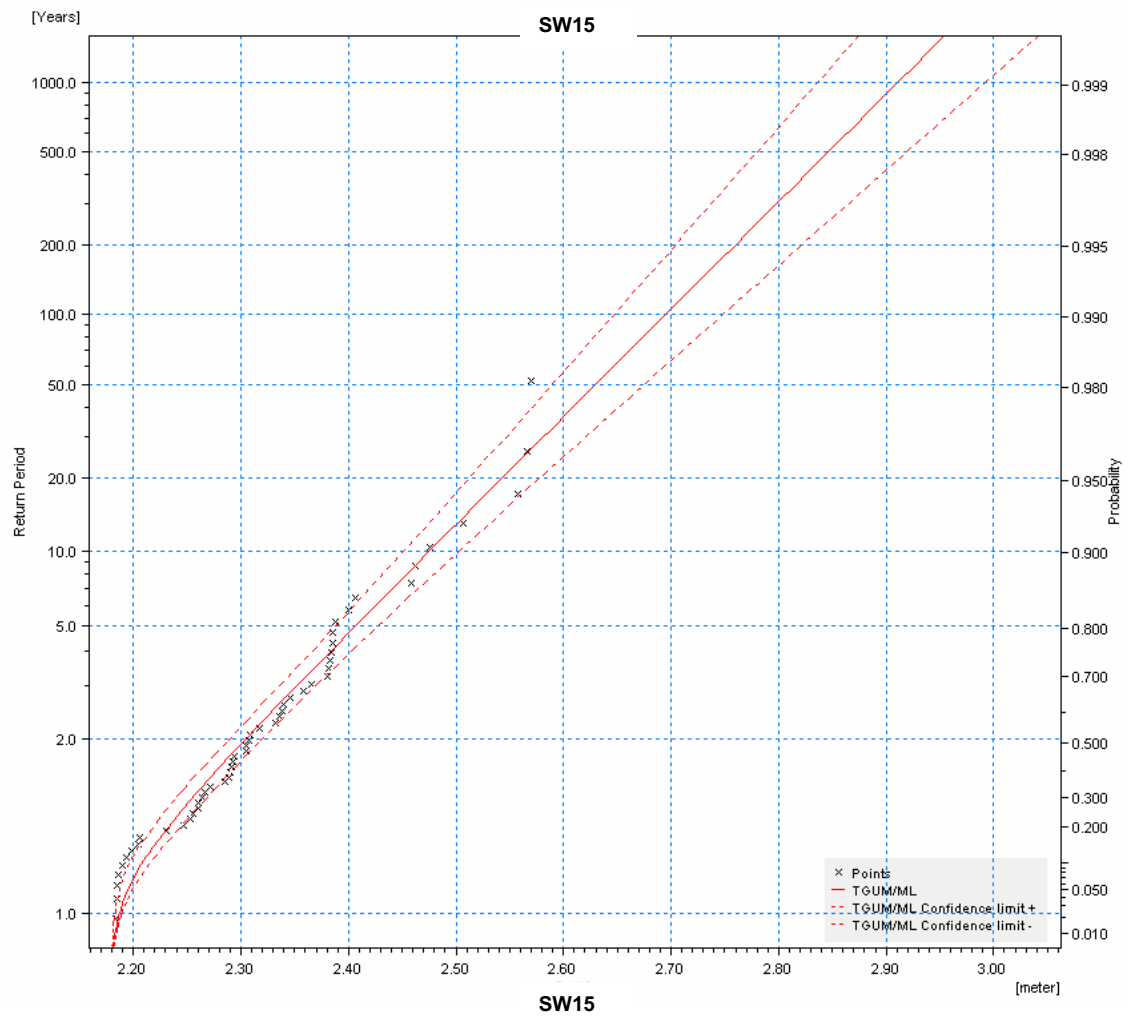


SW15		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.187
	2.00	2.304
	5.00	2.406
	10.00	2.476
	20.00	2.543
	25.00	2.564
	50.00	2.630
	100.00	2.695
	200.00	2.760
	500.00	2.846
	1000.00	2.911
Average quantile	1.00	2.186
	2.00	2.304
	5.00	2.408
	10.00	2.478
	20.00	2.545
	25.00	2.566
	50.00	2.632
	100.00	2.698
	200.00	2.763
	500.00	2.849
	1000.00	2.914
Standard deviation	1.00	0.003
	2.00	0.015
	5.00	0.020
	10.00	0.026
	20.00	0.033
	25.00	0.035
	50.00	0.043
	100.00	0.051
	200.00	0.059
	500.00	0.070
	1000.00	0.078
Goodness-of-fit statistics	CHISQ	12.231
	SLSC	0.030
	PPCC1	0.988
	PPCC2	0.988

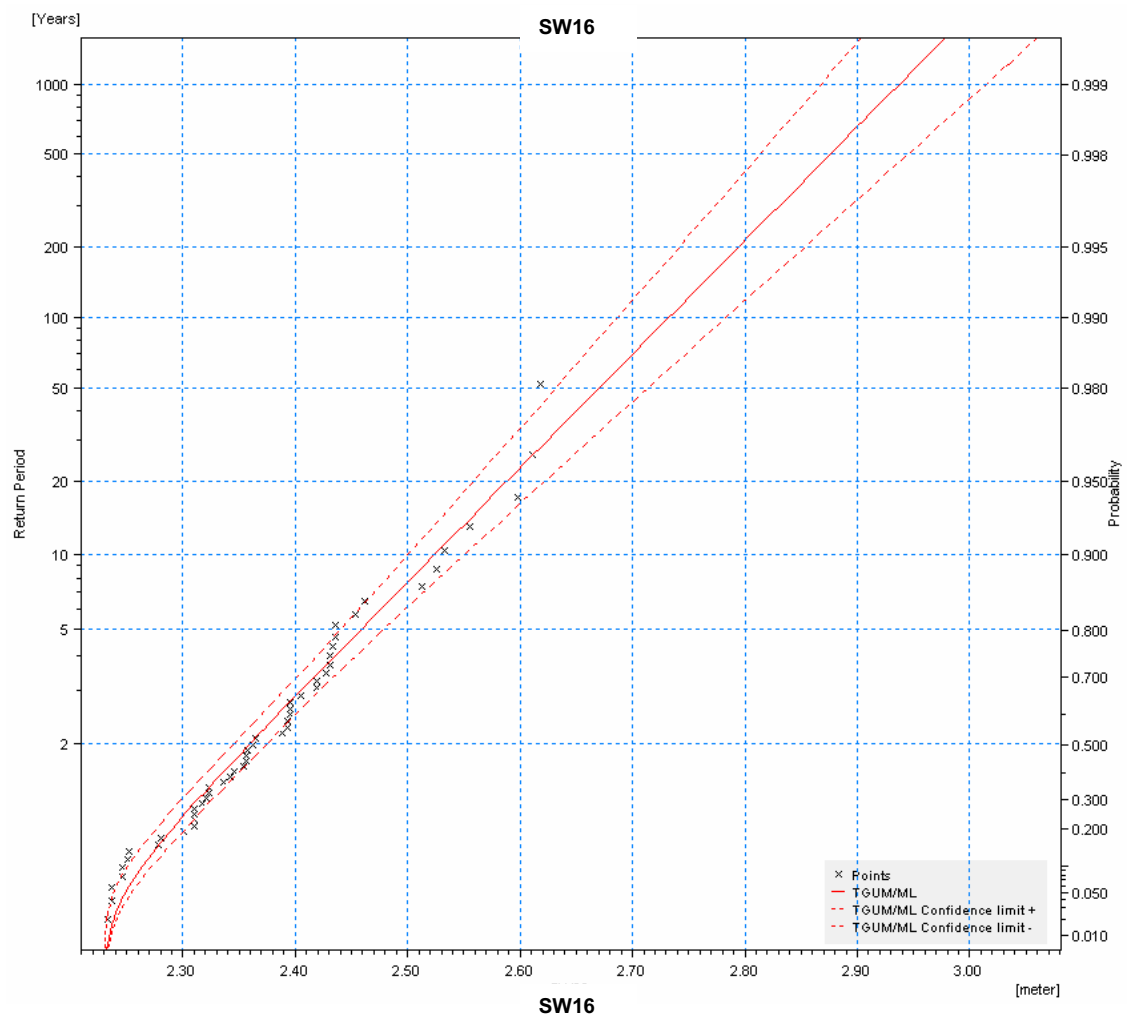


SW16		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.231
	2.00	2.360
	5.00	2.458
	10.00	2.524
	20.00	2.588
	25.00	2.608
	50.00	2.671
	100.00	2.732
	200.00	2.794
	500.00	2.876
	1000.00	2.937
Average quantile	1.00	2.231
	2.00	2.360
	5.00	2.459
	10.00	2.526
	20.00	2.590
	25.00	2.610
	50.00	2.673
	100.00	2.735
	200.00	2.797
	500.00	2.879
	1000.00	2.941
Standard deviation	1.00	0.0009
	2.00	0.014
	5.00	0.019
	10.00	0.025
	20.00	0.032
	25.00	0.034
	50.00	0.041
	100.00	0.048
	200.00	0.056
	500.00	0.066
	1000.00	0.073
Goodness-of-fit statistics	CHISQ	11.157
	SLSC	0.029
	PPCC1	0.990
	PPCC2	0.990

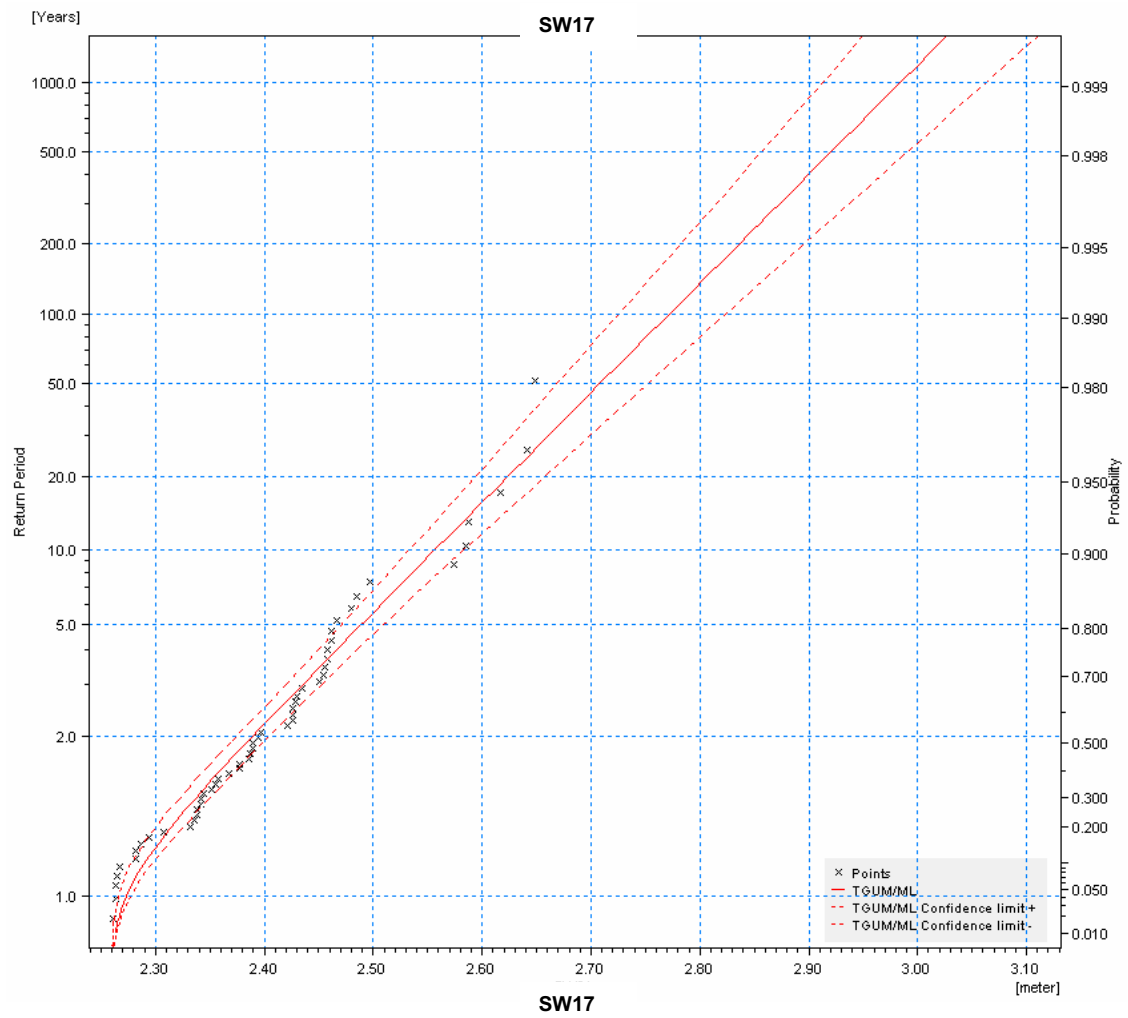


SW17		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.273
	2.00	2.389
	5.00	2.489
	10.00	2.557
	20.00	2.623
	25.00	2.644
	50.00	2.708
	100.00	2.772
	200.00	2.836
	500.00	2.920
	1000.00	2.984
Average quantile	1.00	2.271
	2.00	2.389
	5.00	2.490
	10.00	2.559
	20.00	2.625
	25.00	2.646
	50.00	2.711
	100.00	2.775
	200.00	2.839
	500.00	2.924
	1000.00	2.988
Standard deviation	1.00	0.006
	2.00	0.015
	5.00	0.019
	10.00	0.025
	20.00	0.032
	25.00	0.034
	50.00	0.041
	100.00	0.049
	200.00	0.057
	500.00	0.067
	1000.00	0.075
Goodness-of-fit statistics	CHISQ	13.226
	SLSC	0.034
	PPCC1	0.985
	PPCC2	0.985

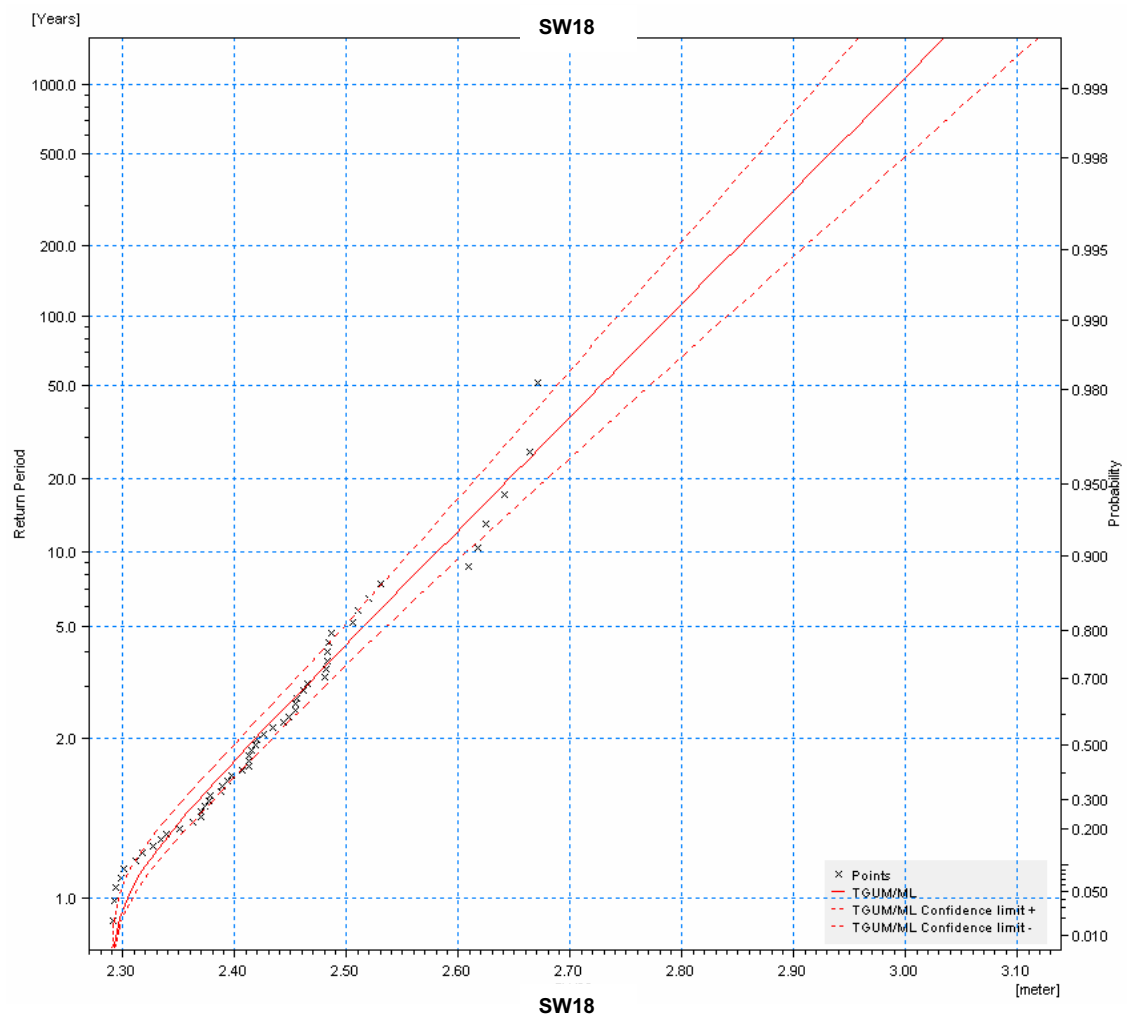


SW18		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.304
	2.00	2.418
	5.00	2.515
	10.00	2.581
	20.00	2.645
	25.00	2.665
	50.00	2.727
	100.00	2.789
	200.00	2.851
	500.00	2.932
	1000.00	2.994
Average quantile	1.00	2.302
	2.00	2.418
	5.00	2.517
	10.00	2.583
	20.00	2.647
	25.00	2.667
	50.00	2.730
	100.00	2.792
	200.00	2.854
	500.00	2.935
	1000.00	2.997
Standard deviation	1.00	0.006
	2.00	0.014
	5.00	0.019
	10.00	0.025
	20.00	0.032
	25.00	0.034
	50.00	0.042
	100.00	0.049
	200.00	0.057
	500.00	0.067
	1000.00	0.075
Goodness-of-fit statistics	CHISQ	8.321
	SLSC	0.032
	PPCC1	0.987
	PPCC2	0.987

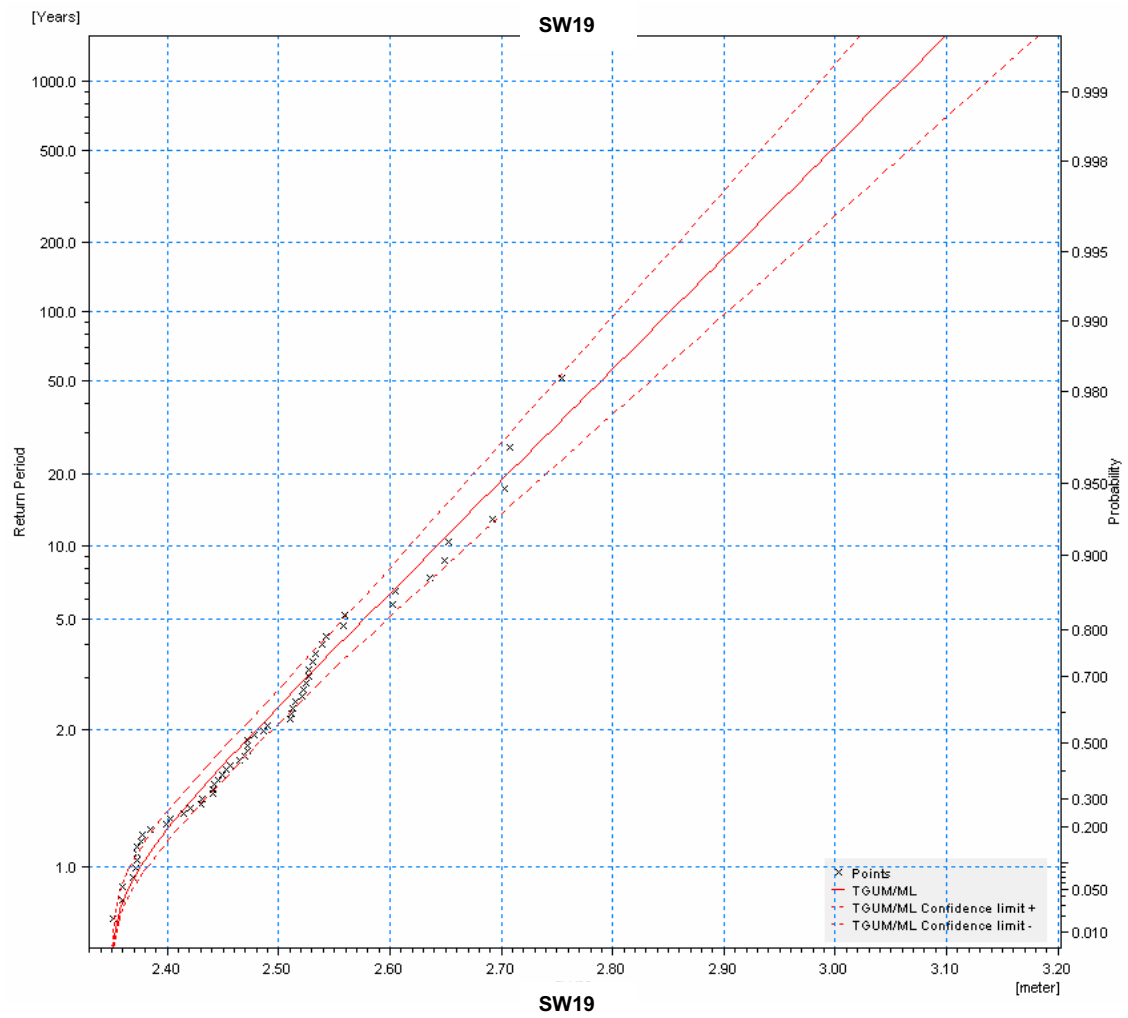


SW19		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.376
	2.00	2.480
	5.00	2.576
	10.00	2.642
	20.00	2.706
	25.00	2.726
	50.00	2.789
	100.00	2.852
	200.00	2.914
	500.00	2.996
	1000.00	3.058
Average quantile	1.00	2.374
	2.00	2.480
	5.00	2.577
	10.00	2.644
	20.00	2.708
	25.00	2.728
	50.00	2.791
	100.00	2.854
	200.00	2.916
	500.00	2.999
	1000.00	3.061
Standard deviation	1.00	0.008
	2.00	0.014
	5.00	0.020
	10.00	0.026
	20.00	0.033
	25.00	0.035
	50.00	0.042
	100.00	0.049
	200.00	0.057
	500.00	0.067
	1000.00	0.075
Goodness-of-fit statistics	CHISQ	9.000
	SLSC	0.026
	PPCC1	0.992
	PPCC2	0.992

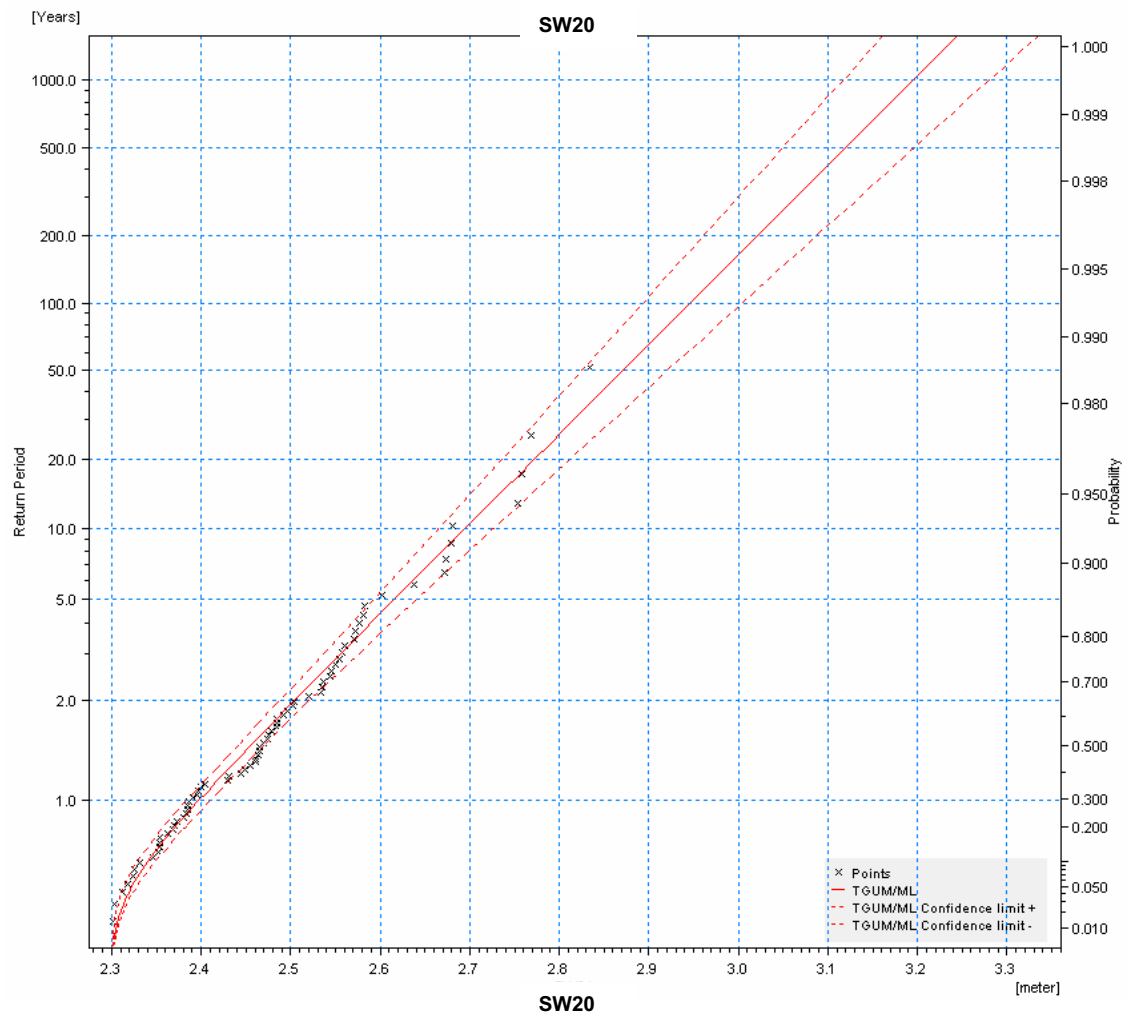


SW20		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.398
	2.00	2.504
	5.00	2.616
	10.00	2.695
	20.00	2.771
	25.00	2.796
	50.00	2.871
	100.00	2.946
	200.00	3.021
	500.00	3.120
	1000.00	3.195
Average quantile	1.00	2.397
	2.00	2.505
	5.00	2.617
	10.00	2.696
	20.00	2.773
	25.00	2.798
	50.00	2.873
	100.00	2.949
	200.00	3.024
	500.00	3.123
	1000.00	3.198
Standard deviation	1.00	0.013
	2.00	0.016
	5.00	0.024
	10.00	0.031
	20.00	0.038
	25.00	0.040
	50.00	0.048
	100.00	0.055
	200.00	0.063
	500.00	0.074
	1000.00	0.081
Goodness-of-fit statistics	CHISQ	13.833
	SLSC	0.022
	PPCC1	0.994
	PPCC2	0.994

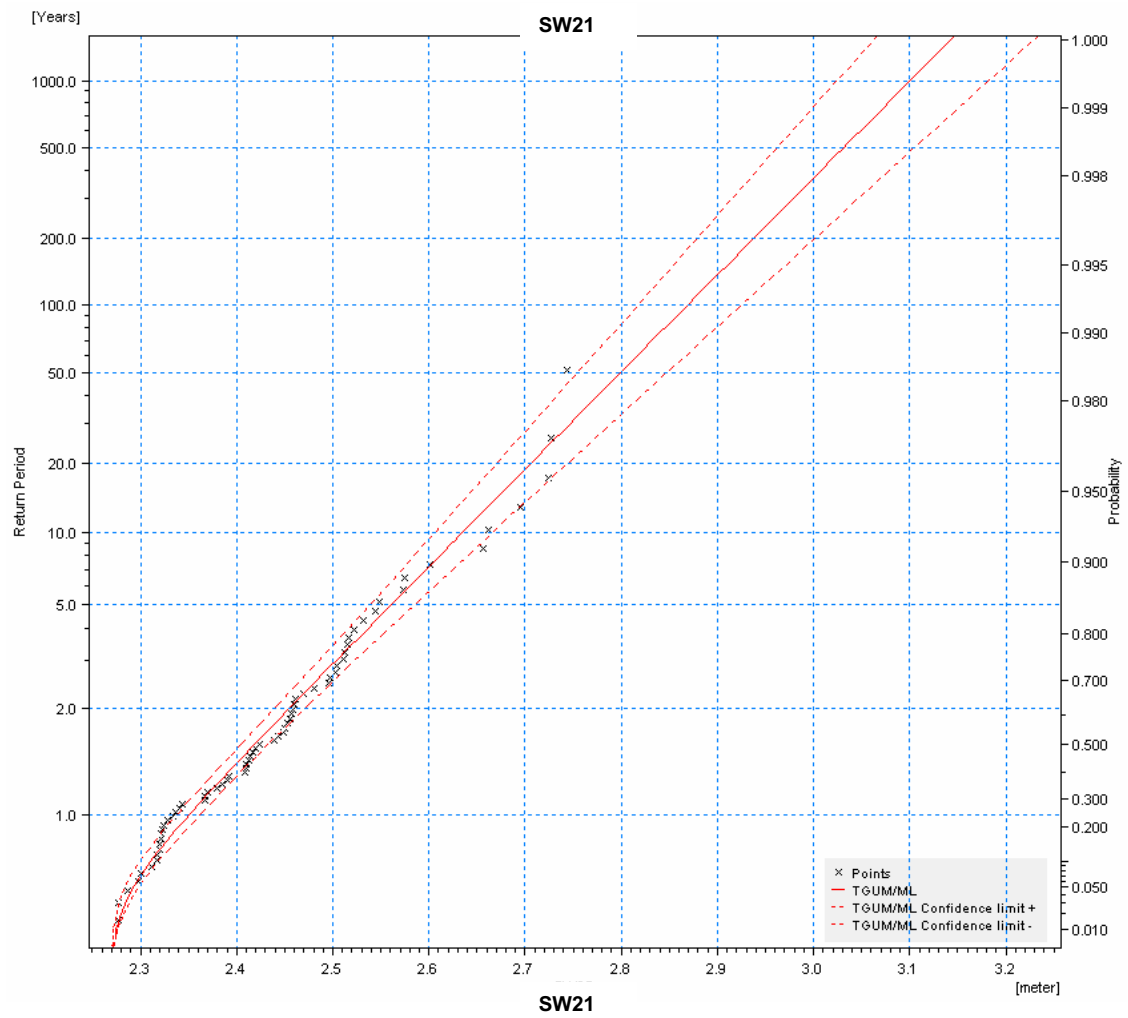


SW21		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.351
	2.00	2.455
	5.00	2.561
	10.00	2.634
	20.00	2.706
	25.00	2.728
	50.00	2.799
	100.00	2.869
	200.00	2.938
	500.00	3.031
	1000.00	3.100
Average quantile	1.00	2.350
	2.00	2.455
	5.00	2.562
	10.00	2.635
	20.00	2.707
	25.00	2.730
	50.00	2.801
	100.00	2.871
	200.00	2.941
	500.00	3.033
	1000.00	3.103
Standard deviation	1.00	0.012
	2.00	0.016
	5.00	0.023
	10.00	0.030
	20.00	0.037
	25.00	0.039
	50.00	0.046
	100.00	0.054
	200.00	0.061
	500.00	0.071
	1000.00	0.079
Goodness -of-fit statistics	CHISQ	11.657
	SLSC	0.026
	PPCC1	0.992
	PPCC2	0.992

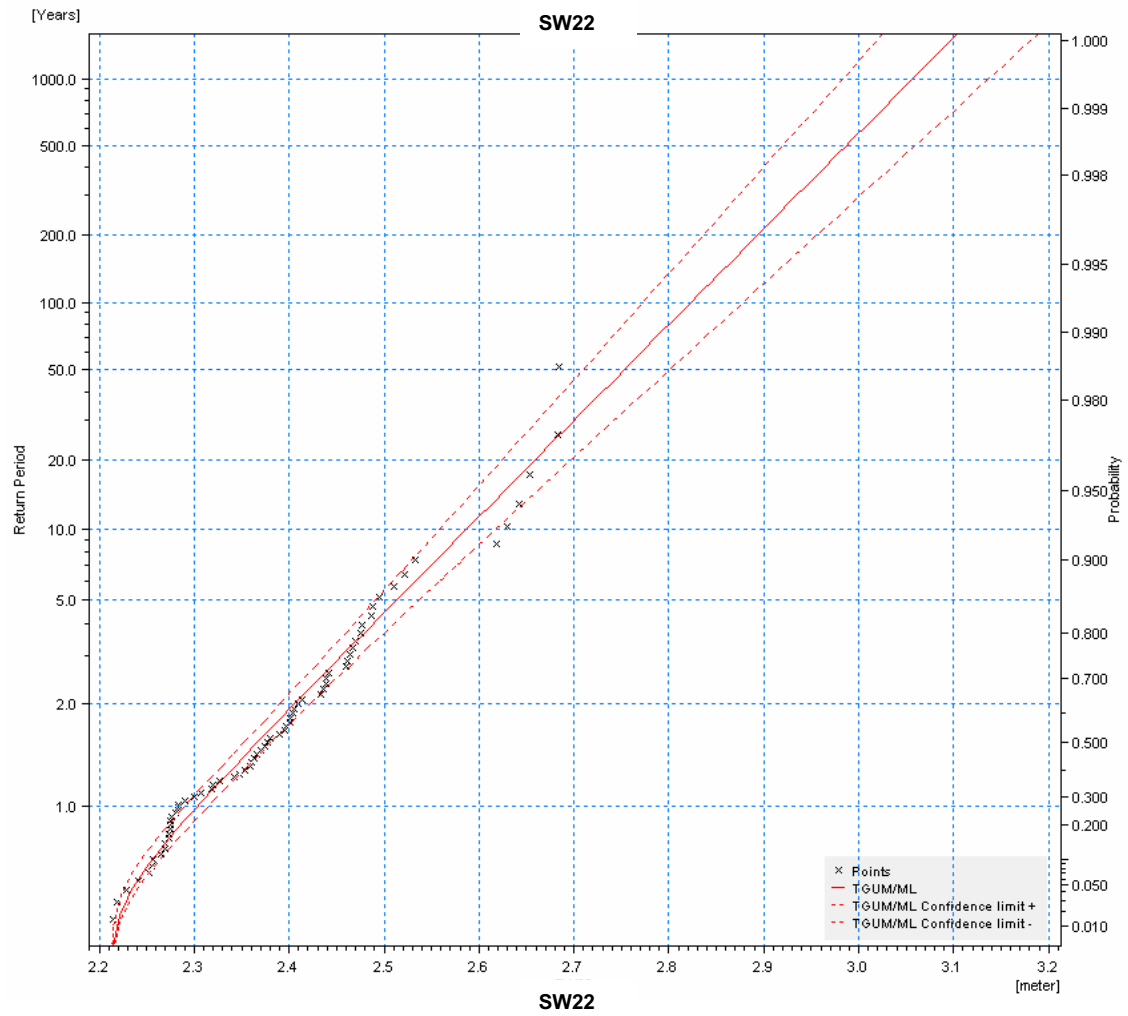


SW22		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.303
	2.00	2.407
	5.00	2.513
	10.00	2.587
	20.00	2.659
	25.00	2.682
	50.00	2.753
	100.00	2.823
	200.00	2.894
	500.00	2.986
	1000.00	3.057
Average quantile	1.00	2.302
	2.00	2.407
	5.00	2.514
	10.00	2.588
	20.00	2.661
	25.00	2.684
	50.00	2.755
	100.00	2.826
	200.00	2.896
	500.00	2.990
	1000.00	3.060
Standard deviation	1.00	0.013
	2.00	0.016
	5.00	0.023
	10.00	0.029
	20.00	0.036
	25.00	0.039
	50.00	0.046
	100.00	0.053
	200.00	0.060
	500.00	0.070
	1000.00	0.077
Goodness-of-fit statistics	CHISQ	14.043
	SLSC	0.029
	PPCC1	0.990
	PPCC2	0.990

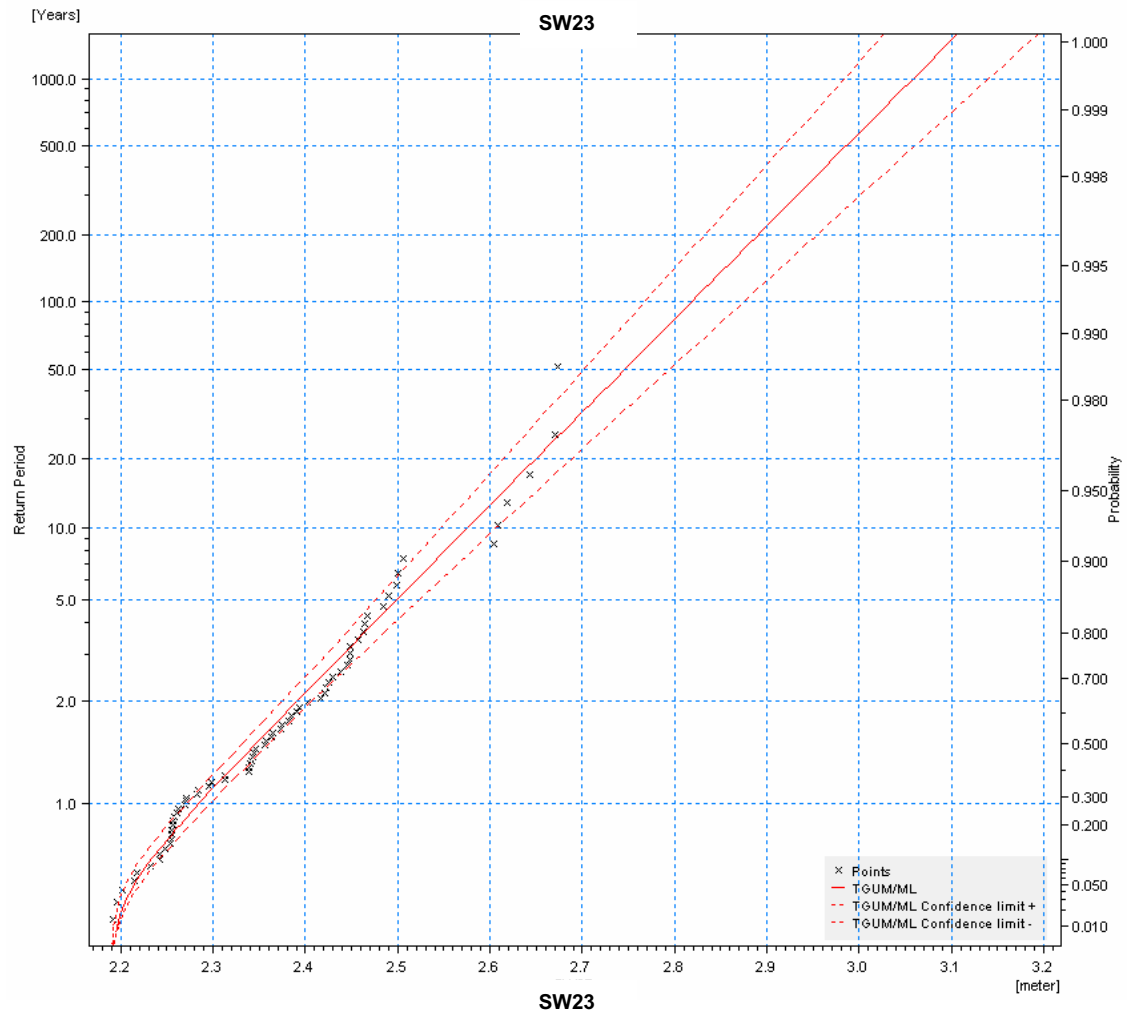


SW23		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.285
	2.00	2.390
	5.00	2.499
	10.00	2.575
	20.00	2.649
	25.00	2.673
	50.00	2.746
	100.00	2.818
	200.00	2.891
	500.00	2.986
	1000.00	3.058
Average quantile	1.00	2.284
	2.00	2.391
	5.00	2.500
	10.00	2.577
	20.00	2.651
	25.00	2.675
	50.00	2.748
	100.00	2.821
	200.00	2.894
	500.00	2.990
	1000.00	3.062
Standard deviation	1.00	0.013
	2.00	0.016
	5.00	0.023
	10.00	0.030
	20.00	0.037
	25.00	0.039
	50.00	0.046
	100.00	0.054
	200.00	0.061
	500.00	0.071
	1000.00	0.078
Goodness-of-fit statistics	CHISQ	8.857
	SLSC	0.028
	PPCC1	0.990
	PPCC2	0.990

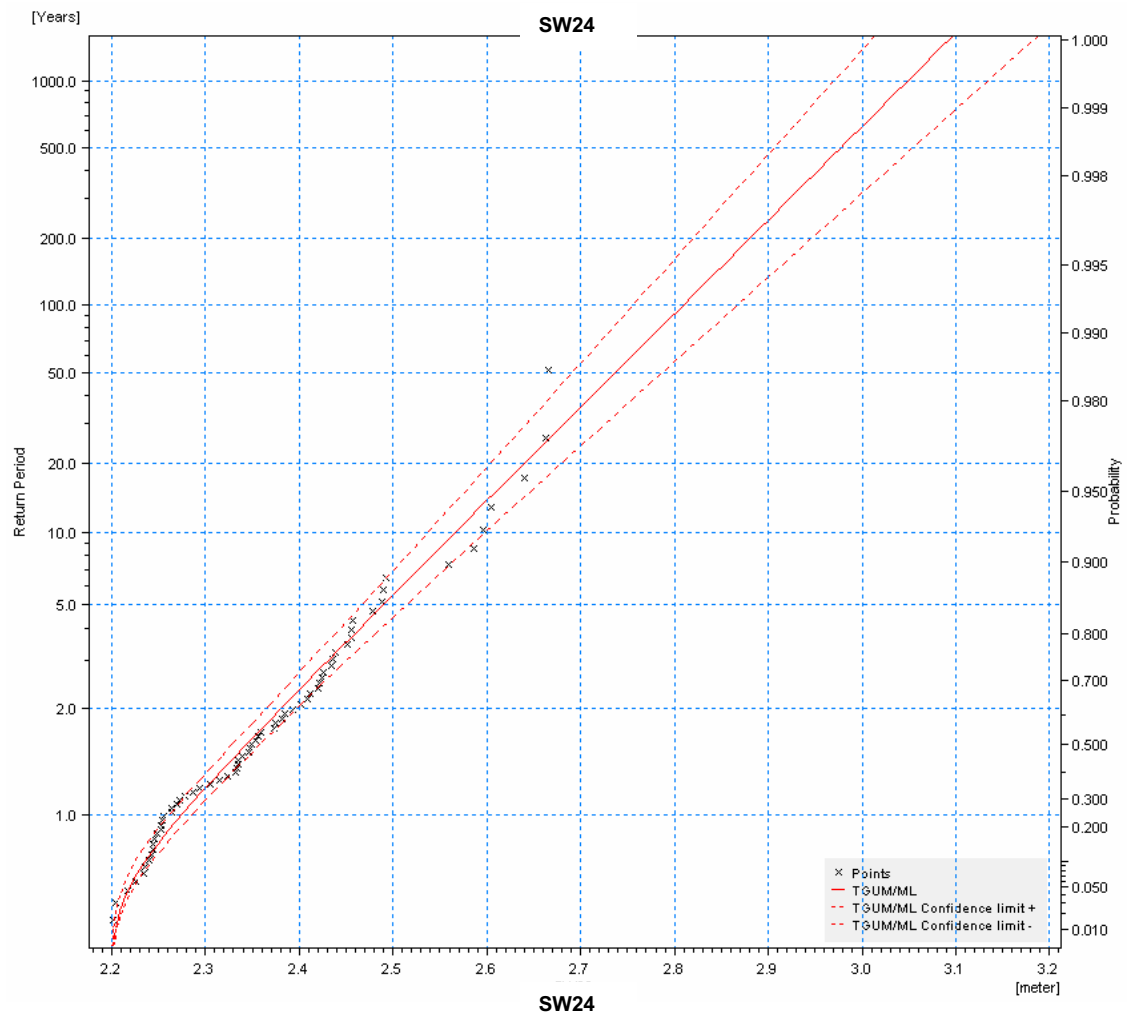


SW24		
		D/E Combination
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.275
	2.00	2.381
	5.00	2.490
	10.00	2.566
	20.00	2.640
	25.00	2.663
	50.00	2.736
	100.00	2.809
	200.00	2.881
	500.00	2.977
	1000.00	3.049
Average quantile	1.00	2.274
	2.00	2.381
	5.00	2.491
	10.00	2.567
	20.00	2.641
	25.00	2.665
	50.00	2.738
	100.00	2.811
	200.00	2.884
	500.00	2.980
	1000.00	3.052
Standard deviation	1.00	0.012
	2.00	0.016
	5.00	0.024
	10.00	0.030
	20.00	0.038
	25.00	0.040
	50.00	0.048
	100.00	0.056
	200.00	0.063
	500.00	0.074
	1000.00	0.082
Goodness -of-fit statistics	CHISQ	9.269
	SLSC	0.027
	PPCC1	0.991
	PPCC2	0.991

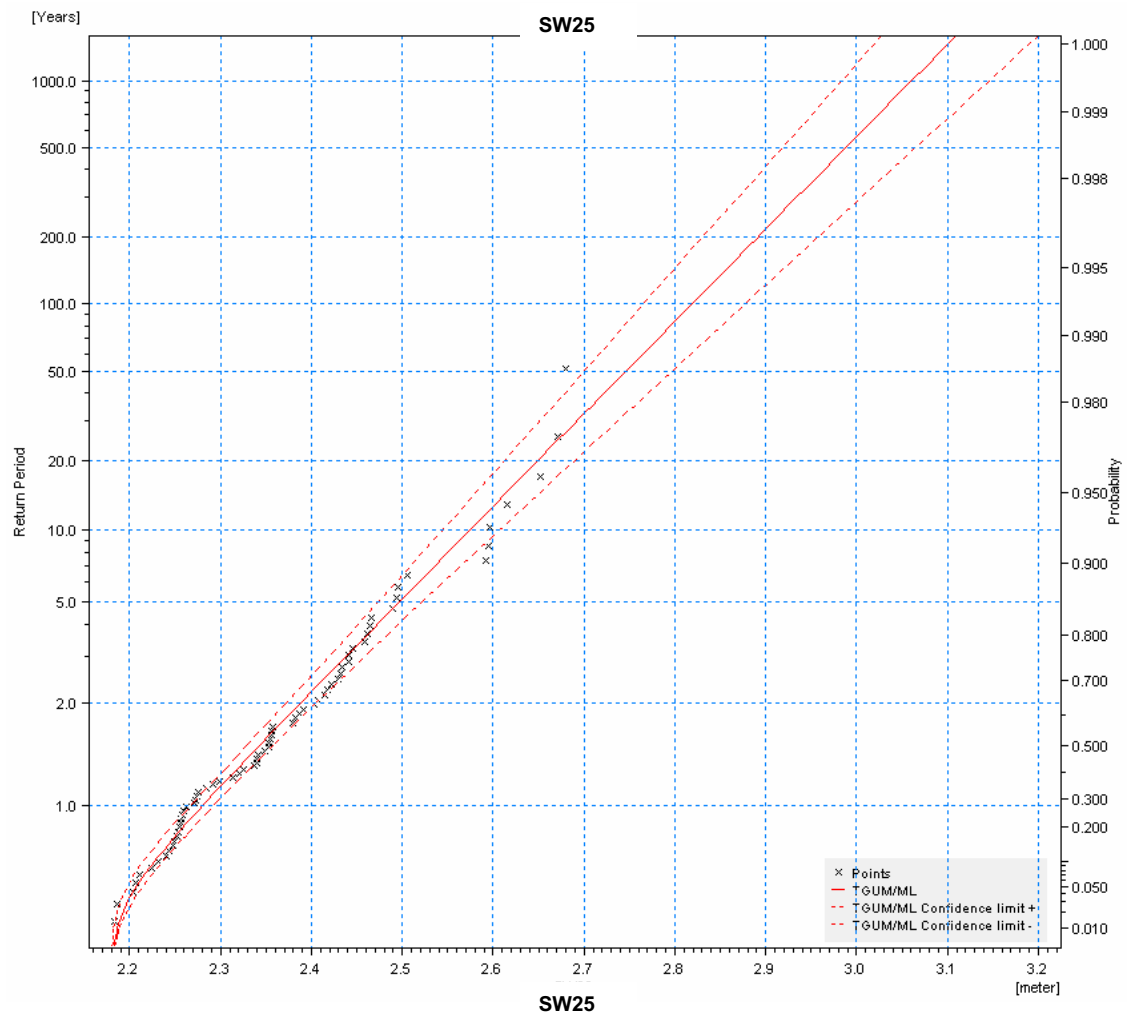


SW25		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.280
	2.00	2.388
	5.00	2.497
	10.00	2.574
	20.00	2.649
	25.00	2.672
	50.00	2.746
	100.00	2.819
	200.00	2.892
	500.00	2.988
	1000.00	3.061
Average quantile	1.00	2.280
	2.00	2.388
	5.00	2.498
	10.00	2.576
	20.00	2.650
	25.00	2.674
	50.00	2.748
	100.00	2.822
	200.00	2.895
	500.00	2.991
	1000.00	3.065
Standard deviation	1.00	0.013
	2.00	0.017
	5.00	0.024
	10.00	0.031
	20.00	0.039
	25.00	0.041
	50.00	0.048
	100.00	0.056
	200.00	0.064
	500.00	0.074
	1000.00	0.081
Goodness-of-fit statistics	CHISQ	7.714
	SLSC	0.026
	PPCC1	0.992
	PPCC2	0.992

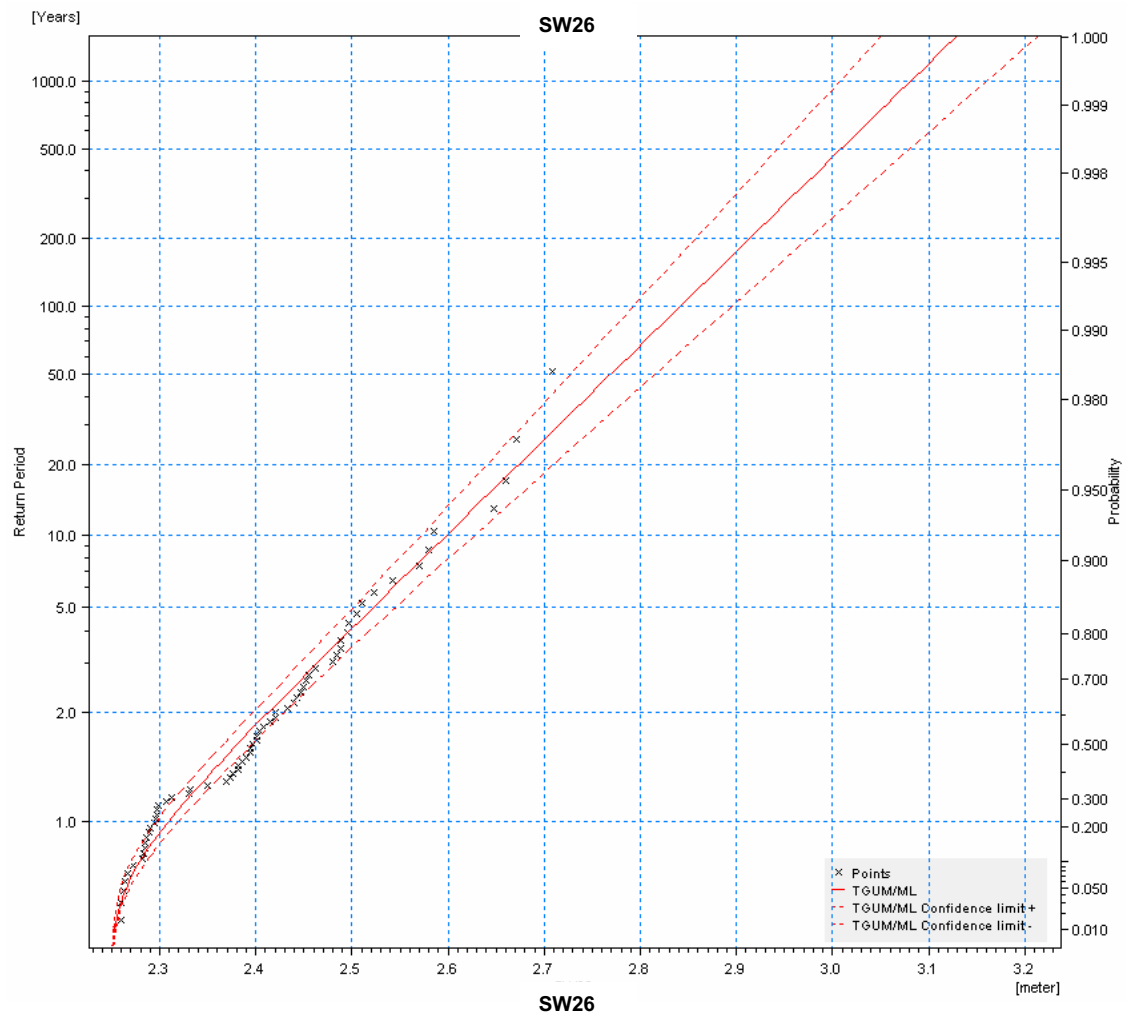


SW26		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.309
	2.00	2.414
	5.00	2.522
	10.00	2.598
	20.00	2.672
	25.00	2.696
	50.00	2.769
	100.00	2.841
	200.00	2.914
	500.00	3.009
	1000.00	3.081
Average quantile	1.00	2.308
	2.00	2.414
	5.00	2.523
	10.00	2.600
	20.00	2.674
	25.00	2.698
	50.00	2.771
	100.00	2.843
	200.00	2.916
	500.00	3.012
	1000.00	3.084
Standard deviation	1.00	0.012
	2.00	0.016
	5.00	0.022
	10.00	0.028
	20.00	0.034
	25.00	0.037
	50.00	0.044
	100.00	0.051
	200.00	0.059
	500.00	0.069
	1000.00	0.076
Goodness-of-fit statistics	CHISQ	15.154
	SLSC	0.028
	PPCC1	0.990
	PPCC2	0.990

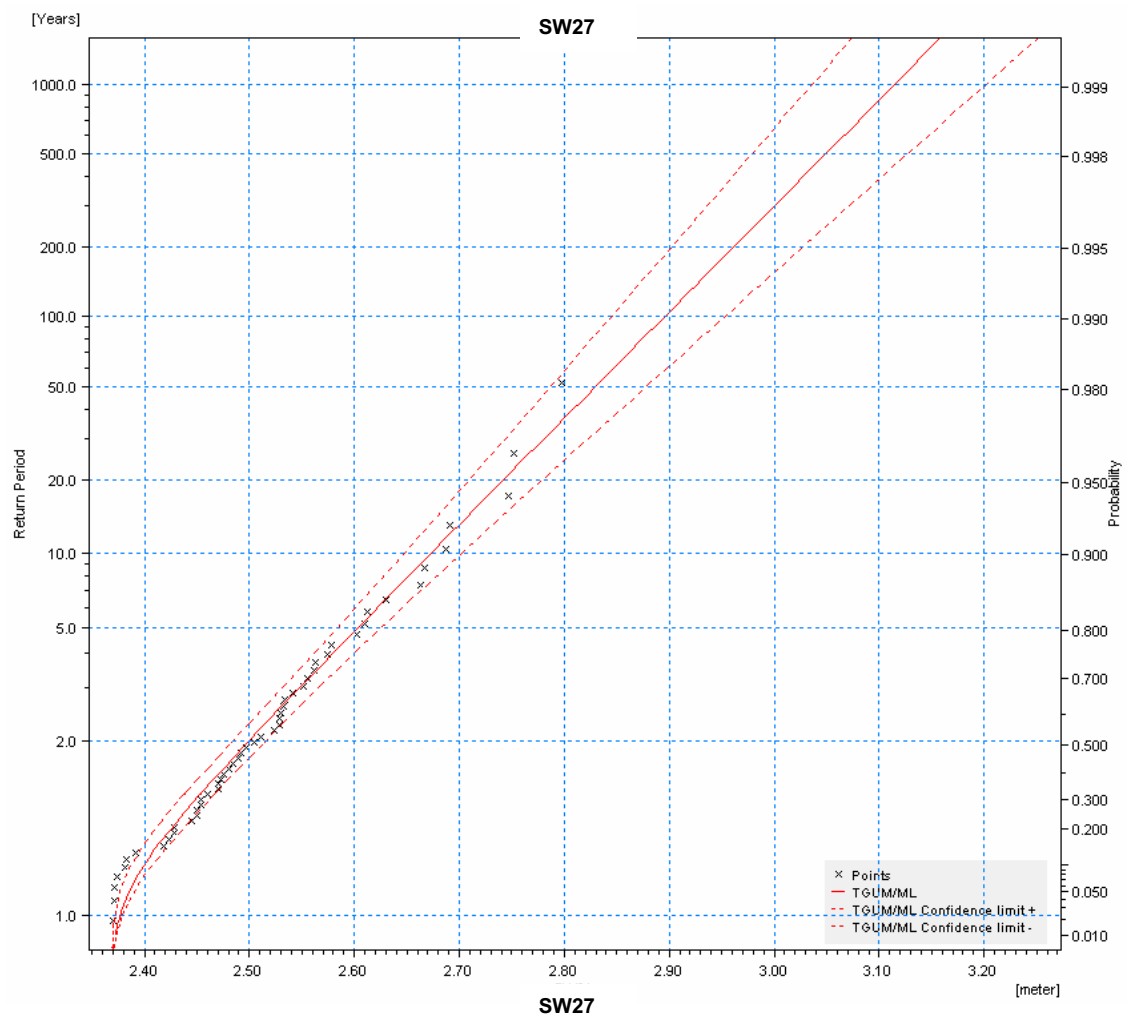


SW27		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.377
	2.00	2.499
	5.00	2.603
	10.00	2.674
	20.00	2.741
	25.00	2.763
	50.00	2.830
	100.00	2.896
	200.00	2.962
	500.00	3.049
	1000.00	3.115
Average quantile	1.00	2.375
	2.00	2.499
	5.00	2.605
	10.00	2.675
	20.00	2.744
	25.00	2.766
	50.00	2.832
	100.00	2.899
	200.00	2.965
	500.00	3.053
	1000.00	3.119
Standard deviation	1.00	0.004
	2.00	0.015
	5.00	0.021
	10.00	0.027
	20.00	0.035
	25.00	0.037
	50.00	0.046
	100.00	0.054
	200.00	0.063
	500.00	0.074
	1000.00	0.083
Goodness-of-fit statistics	CHISQ	8.385
	SLSC	0.021
	PPCC1	0.994
	PPCC2	0.994

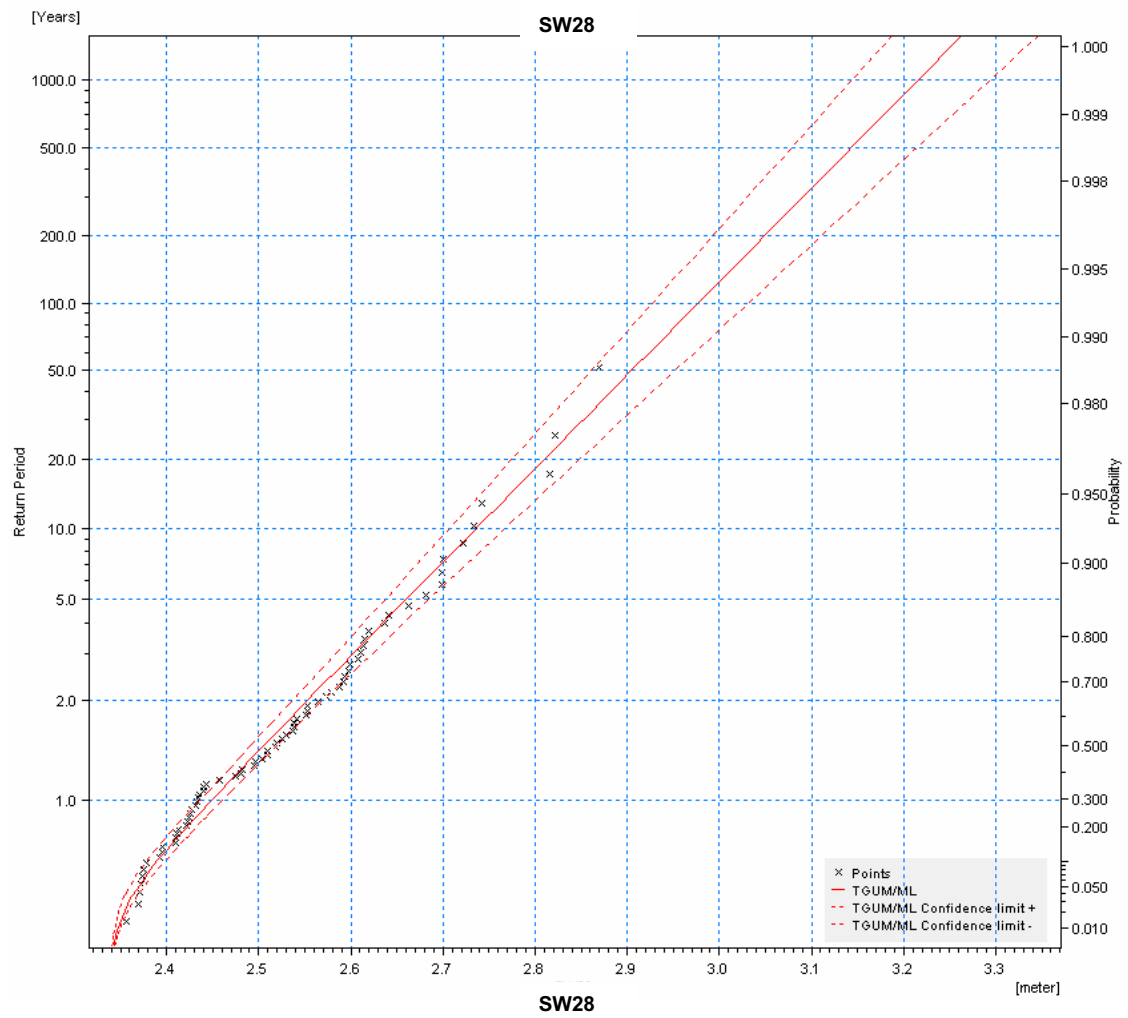


SW28		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.449
	2.00	2.553
	5.00	2.661
	10.00	2.736
	20.00	2.810
	25.00	2.833
	50.00	2.905
	100.00	2.977
	200.00	3.049
	500.00	3.144
	1000.00	3.215
Average quantile	1.00	2.448
	2.00	2.553
	5.00	2.662
	10.00	2.737
	20.00	2.811
	25.00	2.835
	50.00	2.907
	100.00	2.979
	200.00	3.052
	500.00	3.147
	1000.00	3.219
Standard deviation	1.00	0.012
	2.00	0.016
	5.00	0.024
	10.00	0.030
	20.00	0.037
	25.00	0.039
	50.00	0.045
	100.00	0.052
	200.00	0.059
	500.00	0.068
	1000.00	0.075
Goodness-of-fit statistics	CHISQ	11.056
	SLSC	0.022
	PPCC1	0.994
	PPCC2	0.994

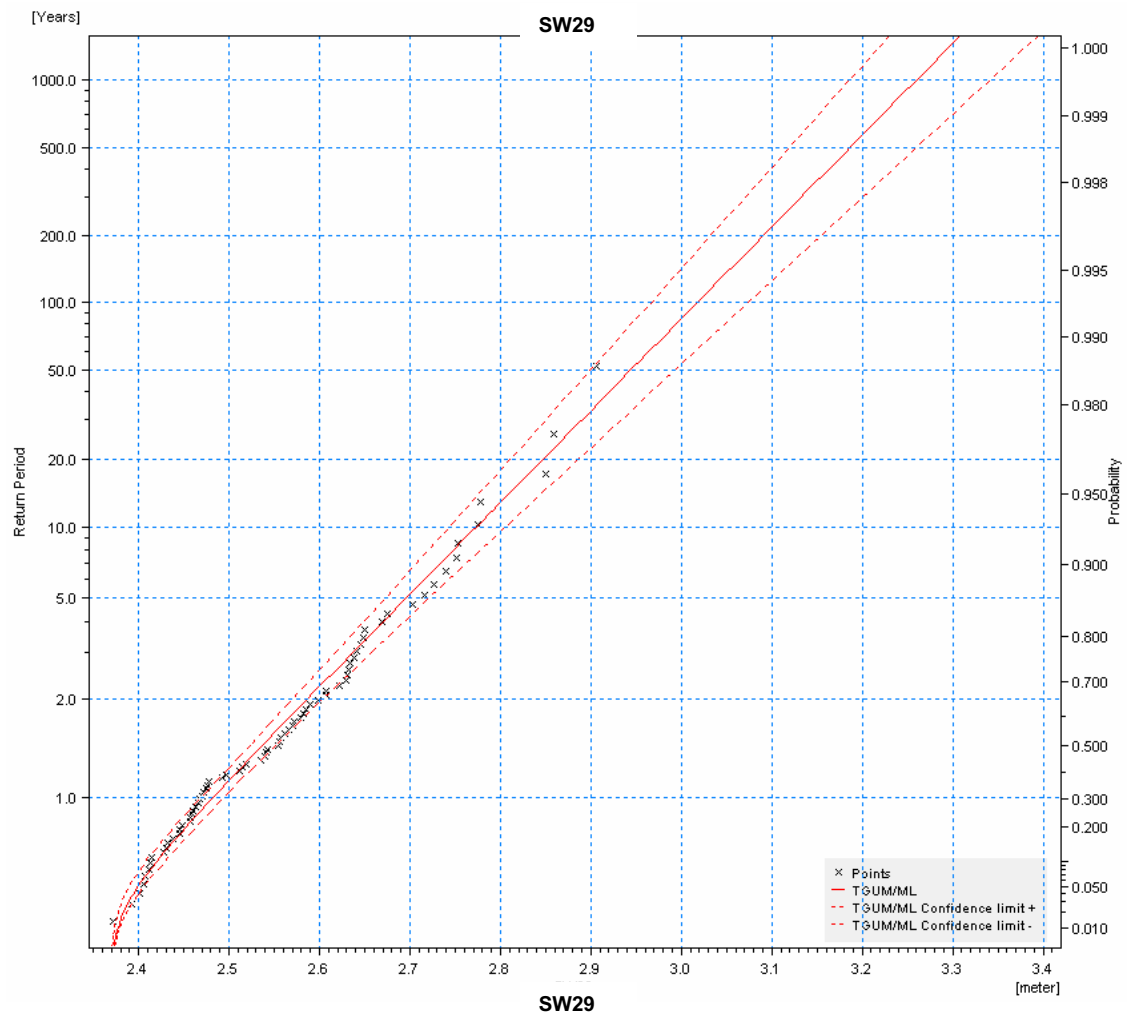


SW2.9		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.482
	2.00	2.587
	5.00	2.696
	10.00	2.773
	20.00	2.847
	25.00	2.871
	50.00	2.945
	100.00	3.018
	200.00	3.090
	500.00	3.187
	1000.00	3.260
Average quantile	1.00	2.482
	2.00	2.587
	5.00	2.697
	10.00	2.774
	20.00	2.849
	25.00	2.873
	50.00	2.947
	100.00	3.020
	200.00	3.093
	500.00	3.190
	1000.00	3.263
Standard deviation	1.00	0.013
	2.00	0.017
	5.00	0.024
	10.00	0.031
	20.00	0.038
	25.00	0.040
	50.00	0.047
	100.00	0.054
	200.00	0.061
	500.00	0.070
	1000.00	0.078
Goodness-of-fit statistics	CHISQ	12.342
	SLSC	0.020
	PPCC1	0.995
	PPCC2	0.995

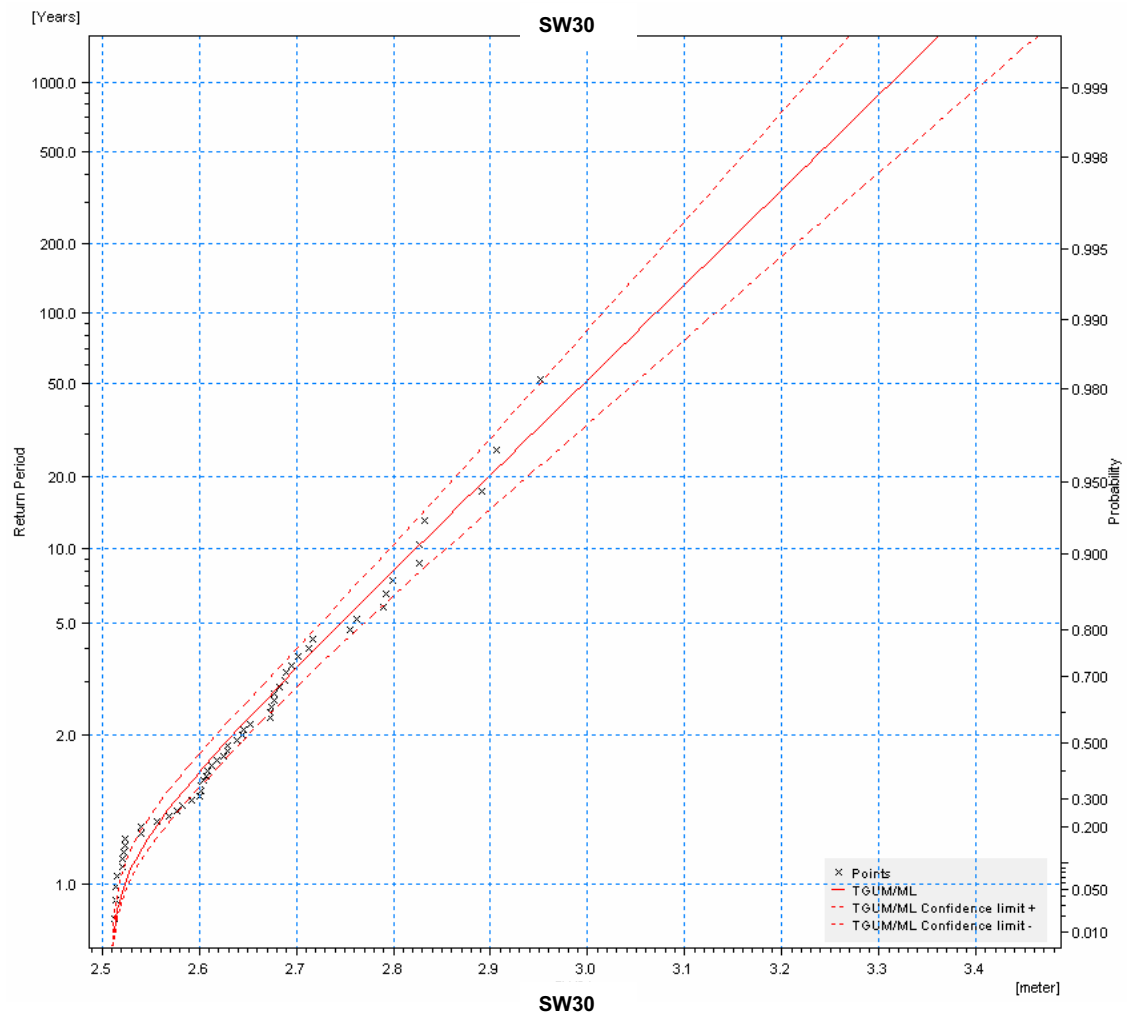


SW30		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.524
	2.00	2.635
	5.00	2.746
	10.00	2.824
	20.00	2.899
	25.00	2.923
	50.00	2.997
	100.00	3.070
	200.00	3.143
	500.00	3.240
	1000.00	3.313
Average quantile	1.00	2.522
	2.00	2.635
	5.00	2.748
	10.00	2.826
	20.00	2.901
	25.00	2.926
	50.00	3.000
	100.00	3.074
	200.00	3.147
	500.00	3.244
	1000.00	3.318
Standard deviation	1.00	0.005
	2.00	0.017
	5.00	0.022
	10.00	0.029
	20.00	0.037
	25.00	0.040
	50.00	0.049
	100.00	0.058
	200.00	0.068
	500.00	0.081
	1000.00	0.090
Goodness-of-fit statistics	CHISQ	9.704
	SLSC	0.026
	PPCC1	0.992
	PPCC2	0.992

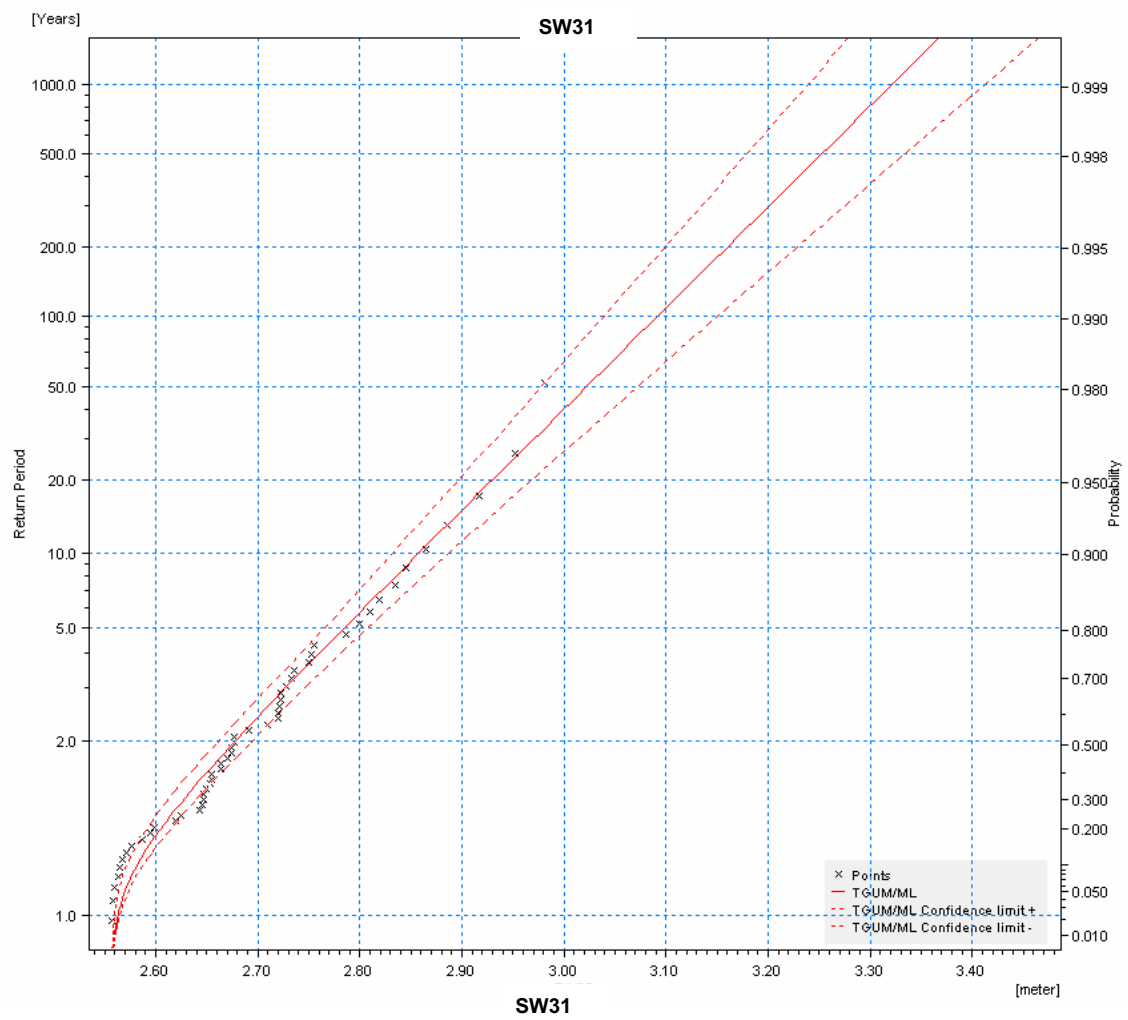


SW31		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.563
	2.00	2.678
	5.00	2.785
	10.00	2.858
	20.00	2.929
	25.00	2.952
	50.00	3.022
	100.00	3.091
	200.00	3.161
	500.00	3.252
	1000.00	3.321
Average quantile	1.00	2.562
	2.00	2.678
	5.00	2.786
	10.00	2.860
	20.00	2.932
	25.00	2.955
	50.00	3.025
	100.00	3.095
	200.00	3.164
	500.00	3.256
	1000.00	3.325
Standard deviation	1.00	0.003
	2.00	0.016
	5.00	0.021
	10.00	0.028
	20.00	0.035
	25.00	0.038
	50.00	0.047
	100.00	0.056
	200.00	0.065
	500.00	0.077
	1000.00	0.087
Goodness-of-fit statistics	CHISQ	9.154
	SLSC	0.024
	PPCC1	0.993
	PPCC2	0.993

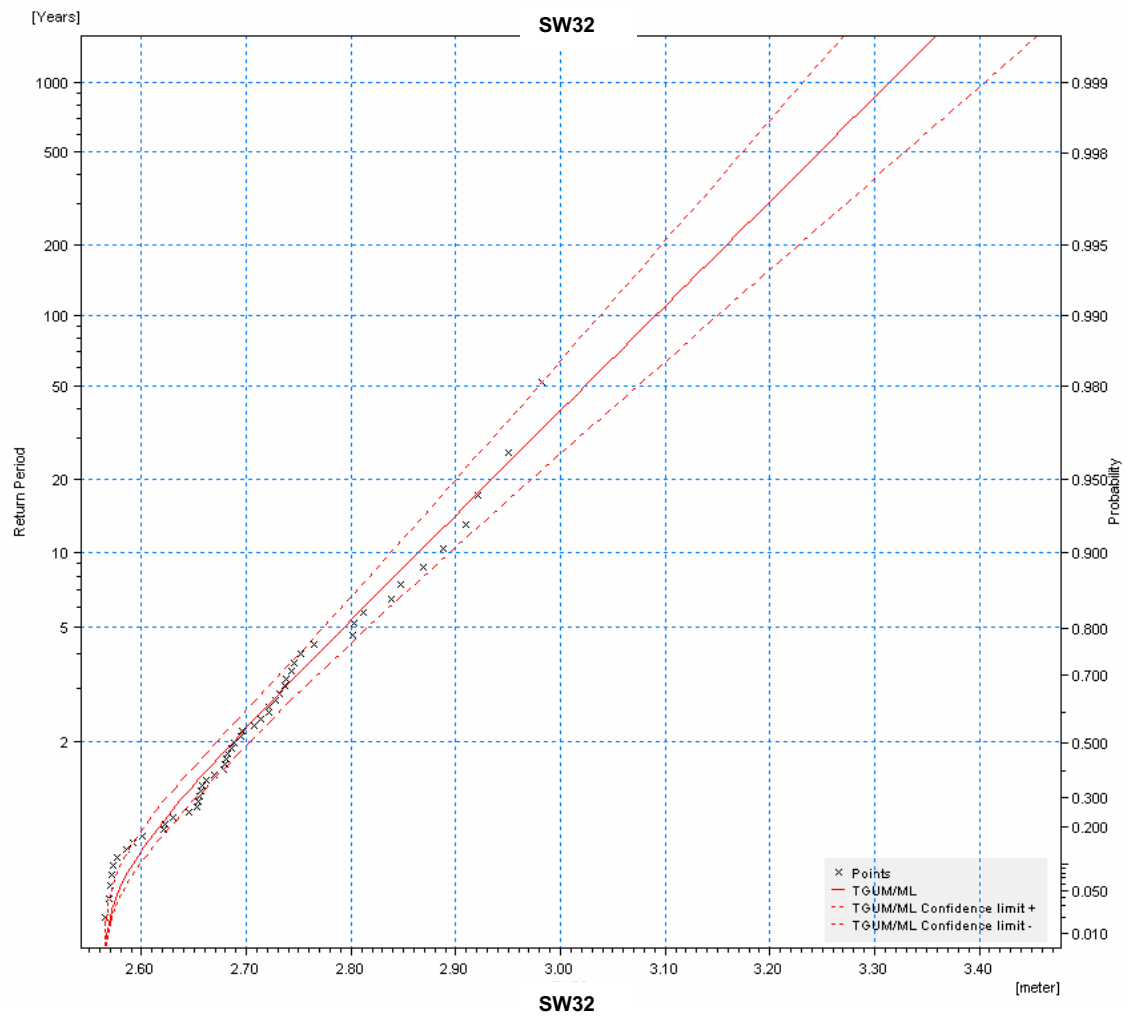


SW32		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.565
	2.00	2.687
	5.00	2.793
	10.00	2.865
	20.00	2.934
	25.00	2.956
	50.00	3.024
	100.00	3.091
	200.00	3.158
	500.00	3.247
	1000.00	3.314
Average quantile	1.00	2.565
	2.00	2.687
	5.00	2.794
	10.00	2.867
	20.00	2.936
	25.00	2.958
	50.00	3.027
	100.00	3.094
	200.00	3.162
	500.00	3.251
	1000.00	3.318
Standard deviation	1.00	0.0005
	2.00	0.016
	5.00	0.021
	10.00	0.028
	20.00	0.036
	25.00	0.039
	50.00	0.047
	100.00	0.056
	200.00	0.065
	500.00	0.077
	1000.00	0.087
Goodness-of-fit statistics	CHISQ	8.020
	SLSC	0.025
	PPCC1	0.992
	PPCC2	0.992

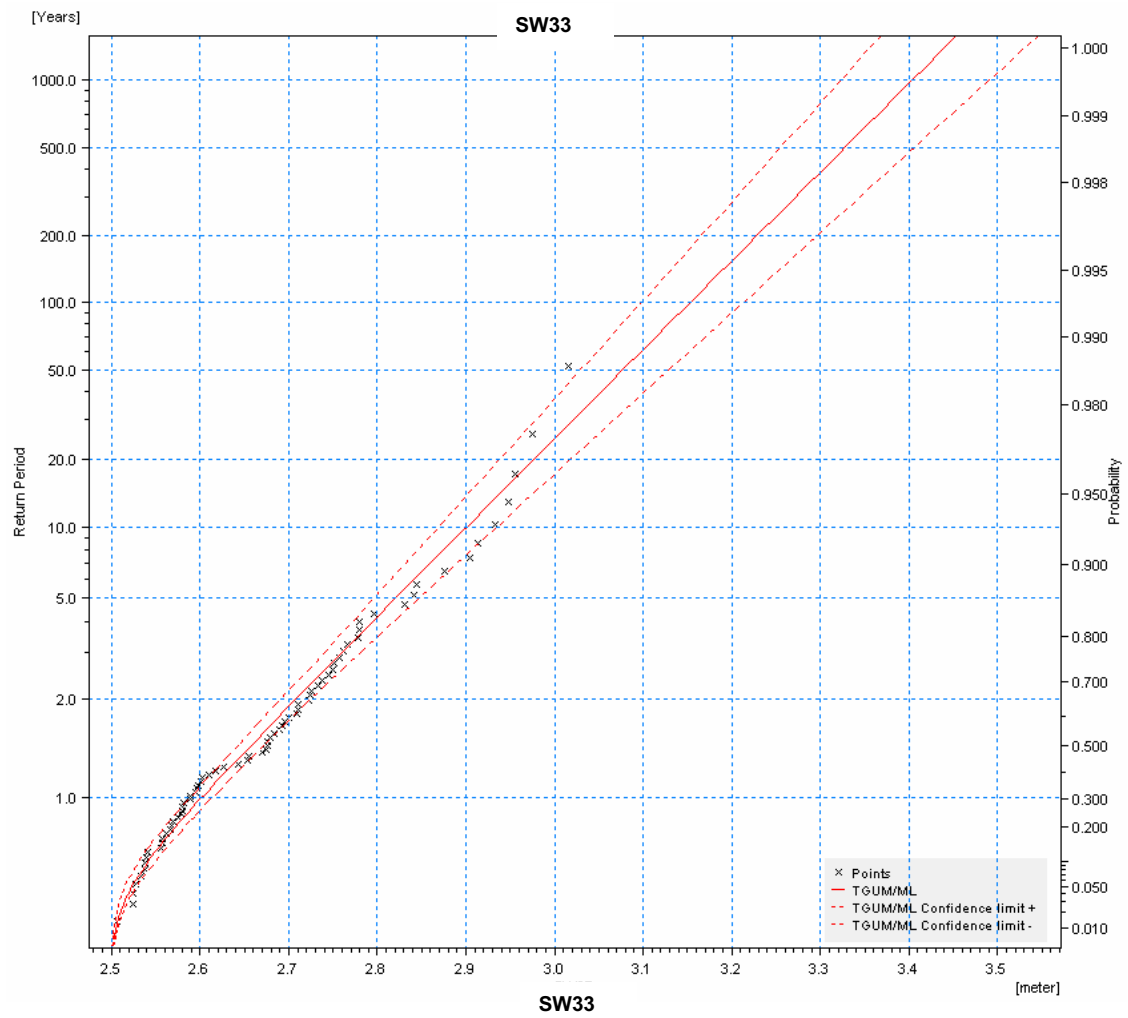


SW33		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.602
	2.00	2.708
	5.00	2.821
	10.00	2.900
	20.00	2.977
	25.00	3.002
	50.00	3.077
	100.00	3.153
	200.00	3.228
	500.00	3.328
	1000.00	3.403
Average quantile	1.00	2.601
	2.00	2.709
	5.00	2.822
	10.00	2.901
	20.00	2.979
	25.00	3.003
	50.00	3.080
	100.00	3.155
	200.00	3.231
	500.00	3.331
	1000.00	3.407
Standard deviation	1.00	0.013
	2.00	0.017
	5.00	0.025
	10.00	0.033
	20.00	0.040
	25.00	0.042
	50.00	0.050
	100.00	0.058
	200.00	0.065
	500.00	0.076
	1000.00	0.083
Goodness-of-fit statistics	CHISQ	6.863
	SLSC	0.026
	PPCC1	0.992
	PPCC2	0.992

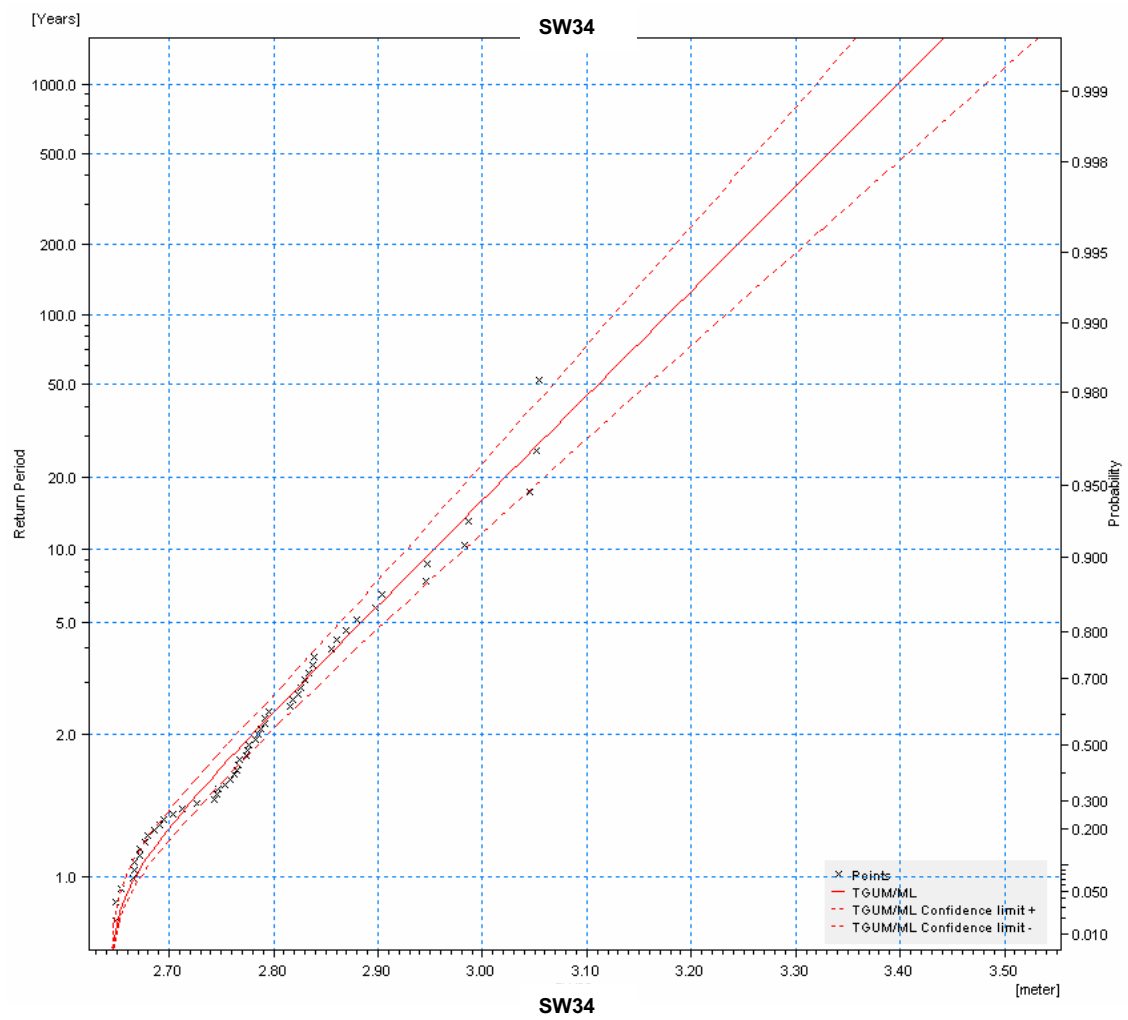


SW34		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.668
	2.00	2.780
	5.00	2.883
	10.00	2.954
	20.00	3.022
	25.00	3.044
	50.00	3.111
	100.00	3.177
	200.00	3.244
	500.00	3.332
	1000.00	3.398
Average quantile	1.00	2.666
	2.00	2.780
	5.00	2.884
	10.00	2.955
	20.00	3.024
	25.00	3.046
	50.00	3.113
	100.00	3.180
	200.00	3.246
	500.00	3.334
	1000.00	3.401
Standard deviation	1.00	0.008
	2.00	0.015
	5.00	0.021
	10.00	0.028
	20.00	0.035
	25.00	0.038
	50.00	0.046
	100.00	0.054
	200.00	0.062
	500.00	0.073
	1000.00	0.081
Goodness-of-fit statistics	CHISQ	9.545
	SLSC	0.027
	PPCC1	0.991
	PPCC2	0.991

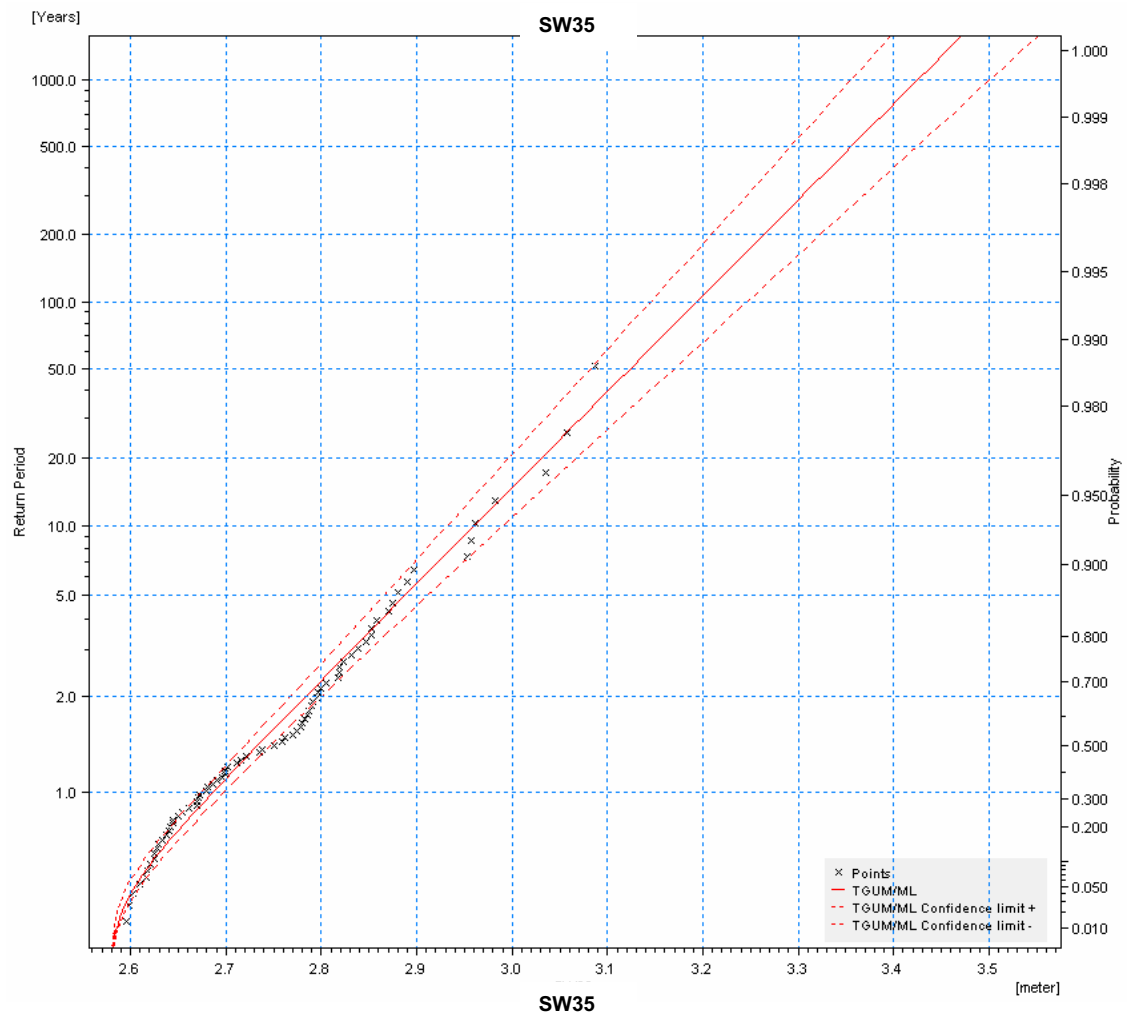


SW35		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.686
	2.00	2.784
	5.00	2.887
	10.00	2.960
	20.00	3.031
	25.00	3.054
	50.00	3.124
	100.00	3.194
	200.00	3.263
	500.00	3.355
	1000.00	3.425
Average quantile	1.00	2.685
	2.00	2.784
	5.00	2.888
	10.00	2.961
	20.00	3.033
	25.00	3.056
	50.00	3.126
	100.00	3.196
	200.00	3.266
	500.00	3.358
	1000.00	3.428
Standard deviation	1.00	0.012
	2.00	0.016
	5.00	0.023
	10.00	0.029
	20.00	0.035
	25.00	0.038
	50.00	0.044
	100.00	0.051
	200.00	0.057
	500.00	0.066
	1000.00	0.073
Goodness-of-fit statistics	CHISQ	7.267
	SLSC	0.022
	PPCC1	0.994
	PPCC2	0.994

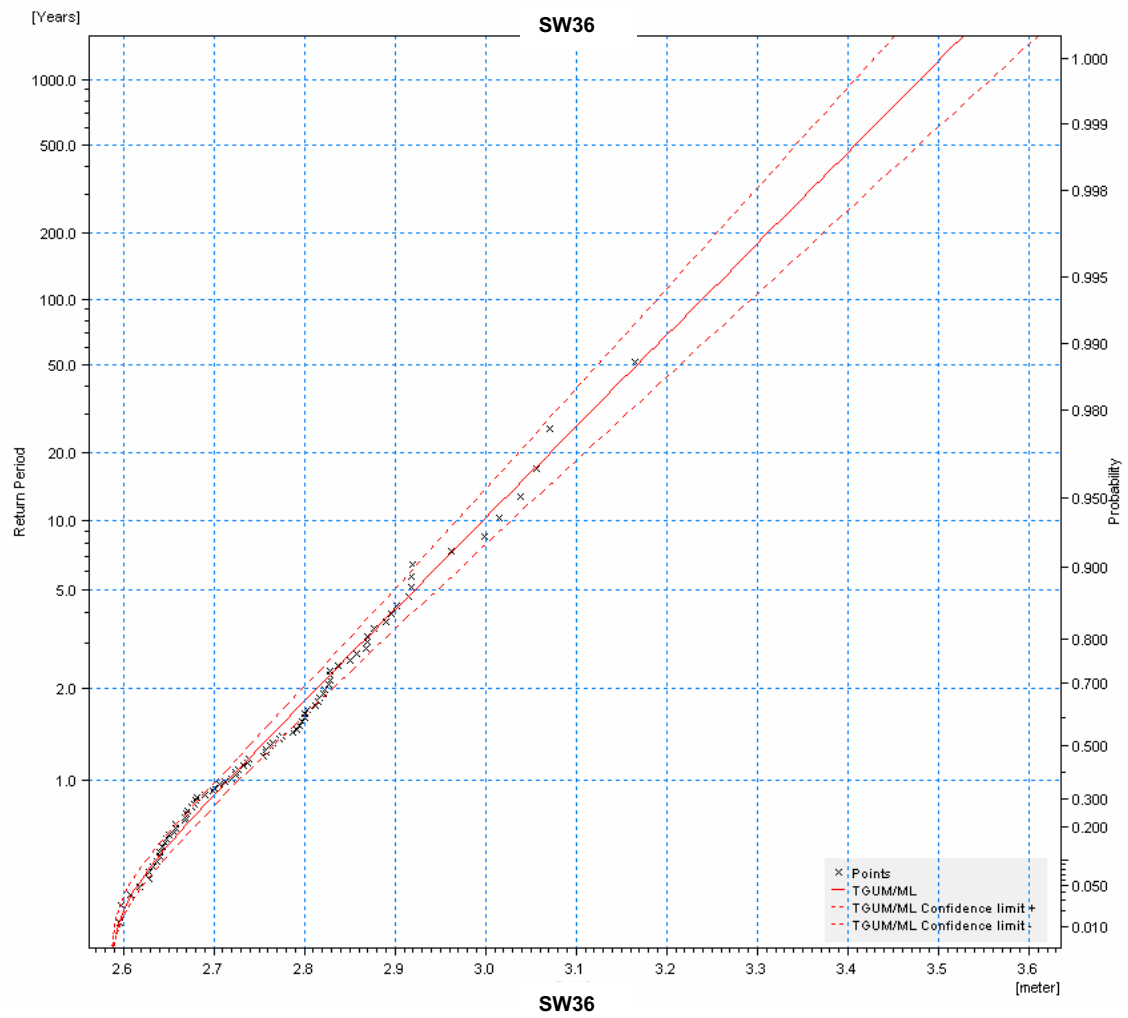


SW36		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.716
	2.00	2.814
	5.00	2.921
	10.00	2.997
	20.00	3.070
	25.00	3.094
	50.00	3.167
	100.00	3.239
	200.00	3.312
	500.00	3.407
	1000.00	3.479
Average quantile	1.00	2.716
	2.00	2.815
	5.00	2.922
	10.00	2.998
	20.00	3.072
	25.00	3.096
	50.00	3.169
	100.00	3.241
	200.00	3.314
	500.00	3.410
	1000.00	3.482
Standard deviation	1.00	0.012
	2.00	0.016
	5.00	0.024
	10.00	0.030
	20.00	0.037
	25.00	0.039
	50.00	0.045
	100.00	0.052
	200.00	0.059
	500.00	0.068
	1000.00	0.075
Goodness-of-fit statistics	CHISQ	4.309
	SLSC	0.018
	PPCC1	0.996
	PPCC2	0.996

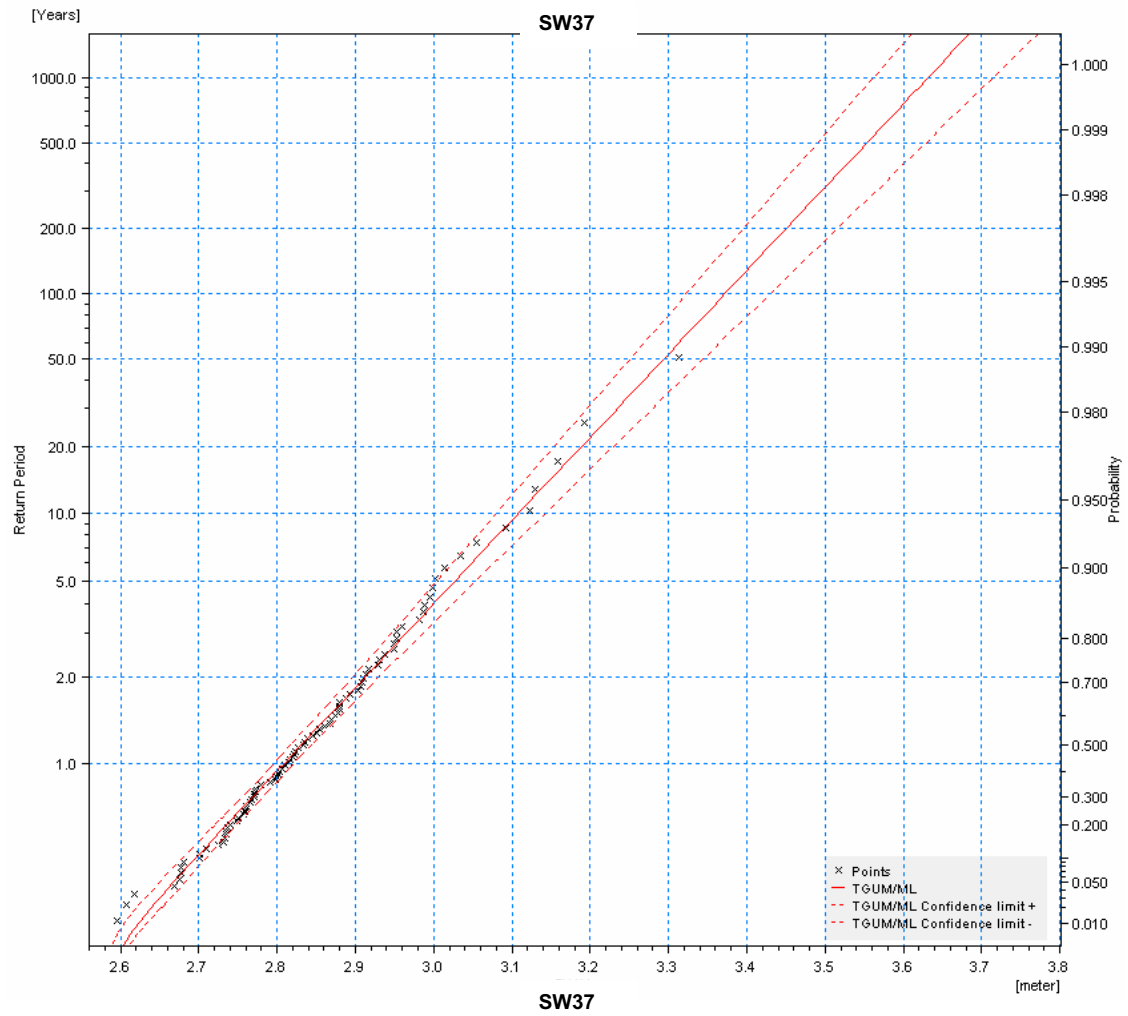


SW37		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.808
	2.00	2.912
	5.00	3.027
	10.00	3.109
	20.00	3.189
	25.00	3.214
	50.00	3.293
	100.00	3.372
	200.00	3.450
	500.00	3.554
	1000.00	3.632
Average quantile	1.00	2.808
	2.00	2.913
	5.00	3.029
	10.00	3.111
	20.00	3.192
	25.00	3.218
	50.00	3.297
	100.00	3.376
	200.00	3.455
	500.00	3.560
	1000.00	3.639
Standard deviation	1.00	0.013
	2.00	0.017
	5.00	0.025
	10.00	0.031
	20.00	0.038
	25.00	0.040
	50.00	0.047
	100.00	0.053
	200.00	0.060
	500.00	0.069
	1000.00	0.076
Goodness-of-fit statistics	CHISQ	3.247
	SLSC	0.016
	PPCC1	0.997
	PPCC2	0.997

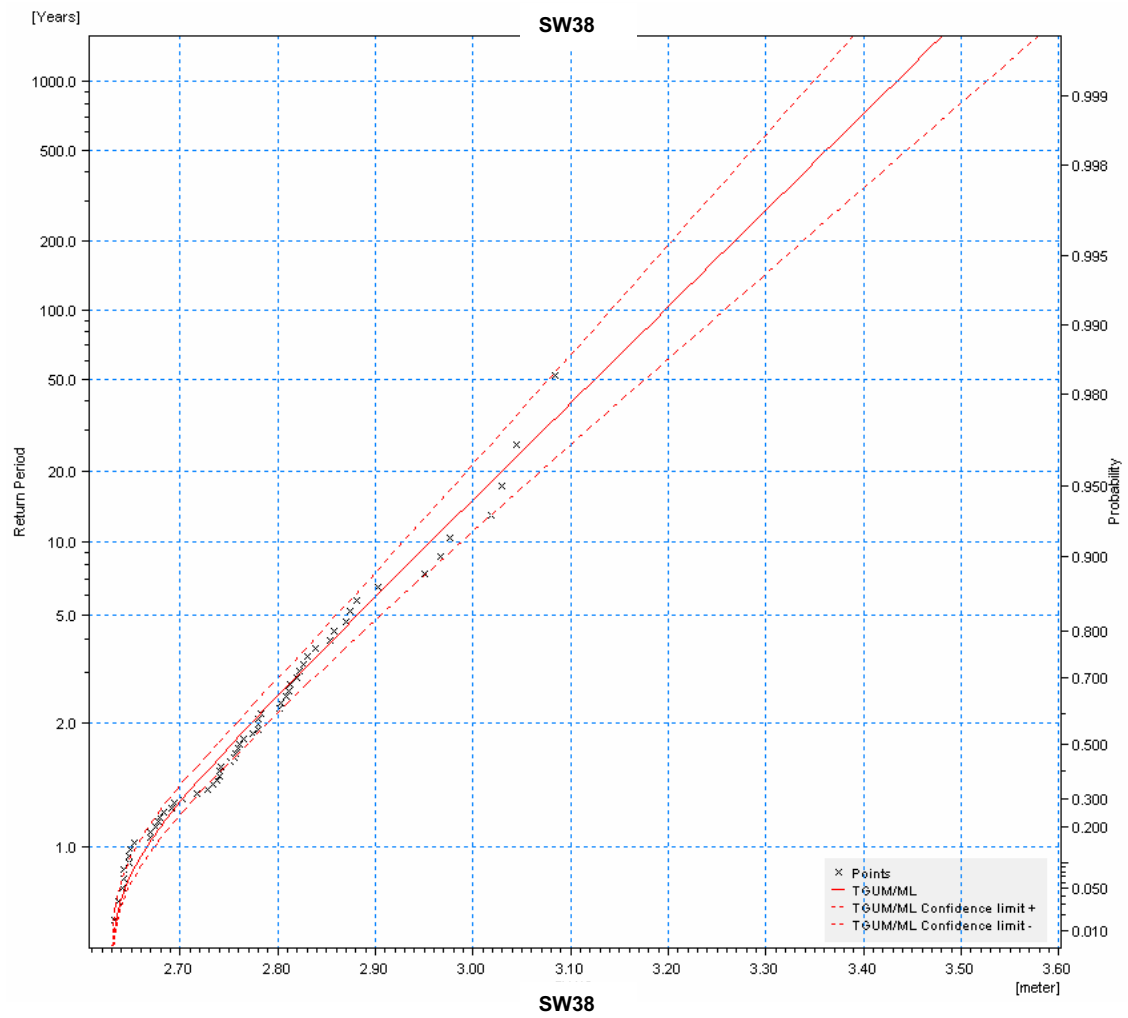


SW38		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.666
	2.00	2.773
	5.00	2.881
	10.00	2.957
	20.00	3.030
	25.00	3.053
	50.00	3.125
	100.00	3.197
	200.00	3.268
	500.00	3.362
	1000.00	3.434
Average quantile	1.00	2.664
	2.00	2.773
	5.00	2.883
	10.00	2.958
	20.00	3.032
	25.00	3.055
	50.00	3.127
	100.00	3.199
	200.00	3.271
	500.00	3.365
	1000.00	3.437
Standard deviation	1.00	0.009
	2.00	0.016
	5.00	0.023
	10.00	0.030
	20.00	0.038
	25.00	0.041
	50.00	0.049
	100.00	0.058
	200.00	0.067
	500.00	0.079
	1000.00	0.089
Goodness-of-fit statistics	CHISQ	9.305
	SLSC	0.024
	PPCC1	0.993
	PPCC2	0.993

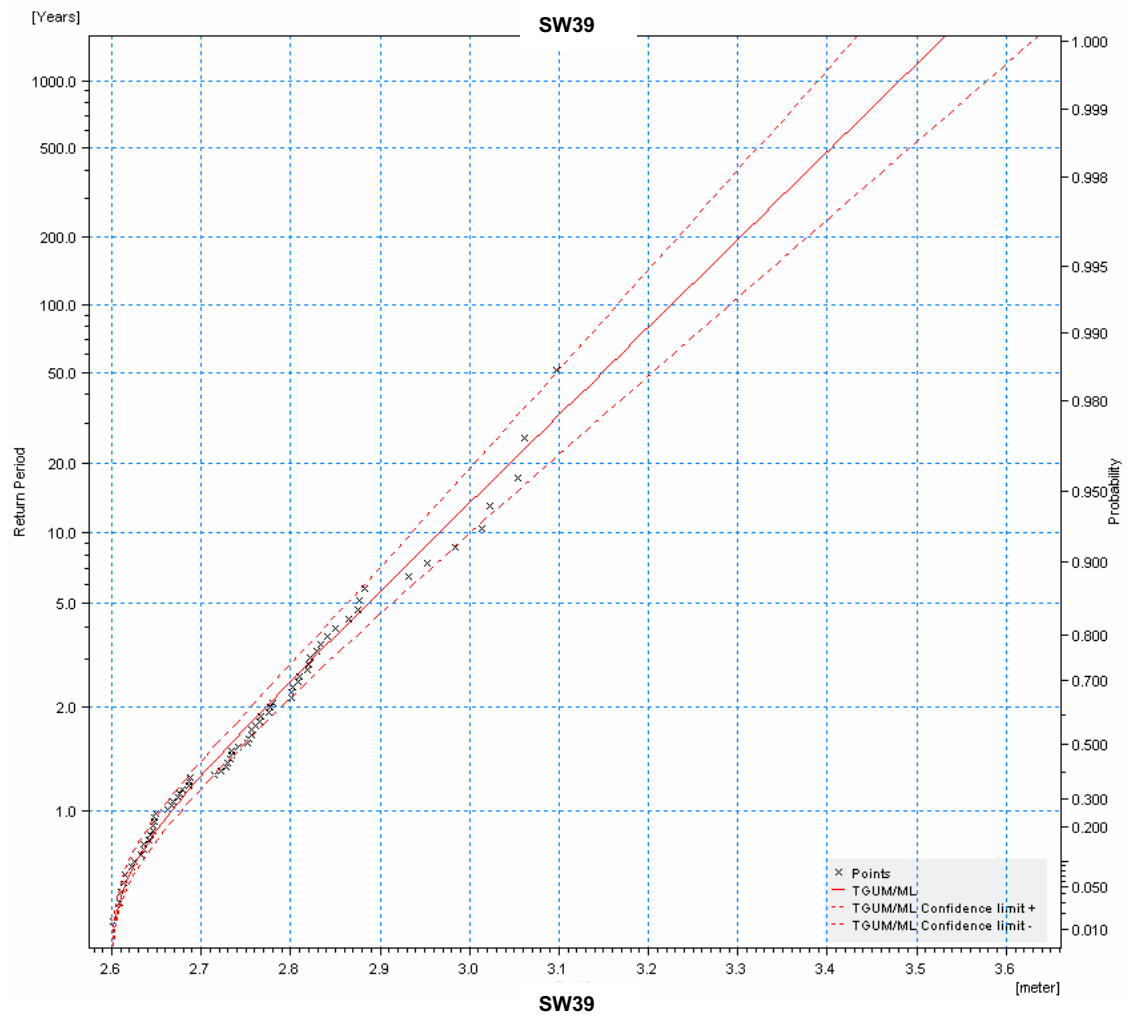


SW39		
		D/E Combination
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.666
	2.00	2.773
	5.00	2.887
	10.00	2.967
	20.00	3.046
	25.00	3.071
	50.00	3.148
	100.00	3.225
	200.00	3.302
	500.00	3.404
	1000.00	3.481
Average quantile	1.00	2.665
	2.00	2.773
	5.00	2.888
	10.00	2.969
	20.00	3.048
	25.00	3.073
	50.00	3.150
	100.00	3.228
	200.00	3.305
	500.00	3.407
	1000.00	3.484
Standard deviation	1.00	0.012
	2.00	0.017
	5.00	0.025
	10.00	0.033
	20.00	0.042
	25.00	0.045
	50.00	0.054
	100.00	0.063
	200.00	0.072
	500.00	0.085
	1000.00	0.094
Goodness -of-fit statistics	CHISQ	6.412
	SLSC	0.024
	PPCC1	0.993
	PPCC2	0.993

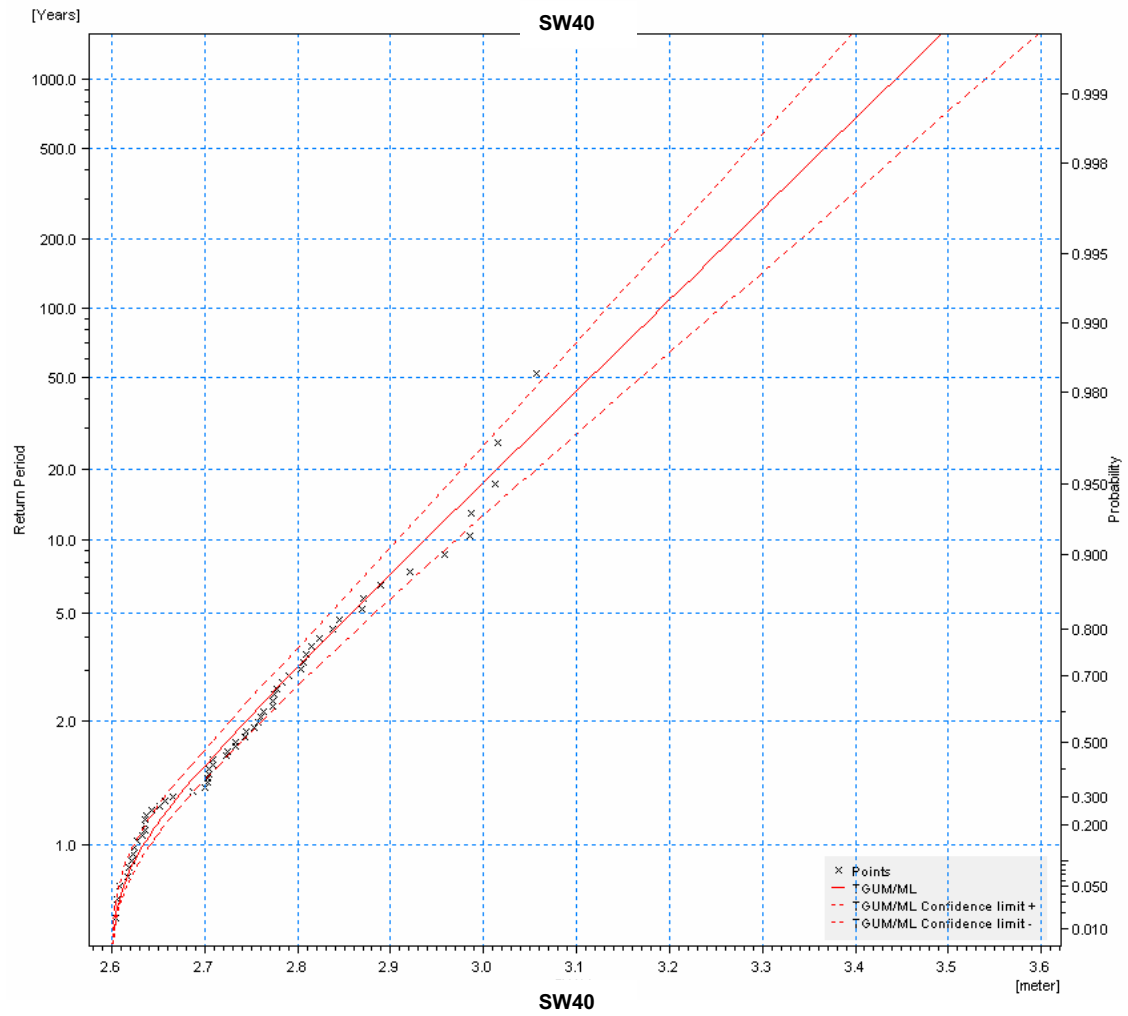


SW40		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.634
	2.00	2.744
	5.00	2.858
	10.00	2.937
	20.00	3.015
	25.00	3.039
	50.00	3.116
	100.00	3.191
	200.00	3.267
	500.00	3.367
	1000.00	3.442
Average quantile	1.00	2.632
	2.00	2.744
	5.00	2.859
	10.00	2.939
	20.00	3.017
	25.00	3.042
	50.00	3.118
	100.00	3.194
	200.00	3.270
	500.00	3.370
	1000.00	3.446
Standard deviation	1.00	0.009
	2.00	0.017
	5.00	0.024
	10.00	0.031
	20.00	0.040
	25.00	0.043
	50.00	0.052
	100.00	0.061
	200.00	0.071
	500.00	0.084
	1000.00	0.094
Goodness-of-fit statistics	CHISQ	9.305
	SLSC	0.027
	PPCC1	0.991
	PPCC2	0.991

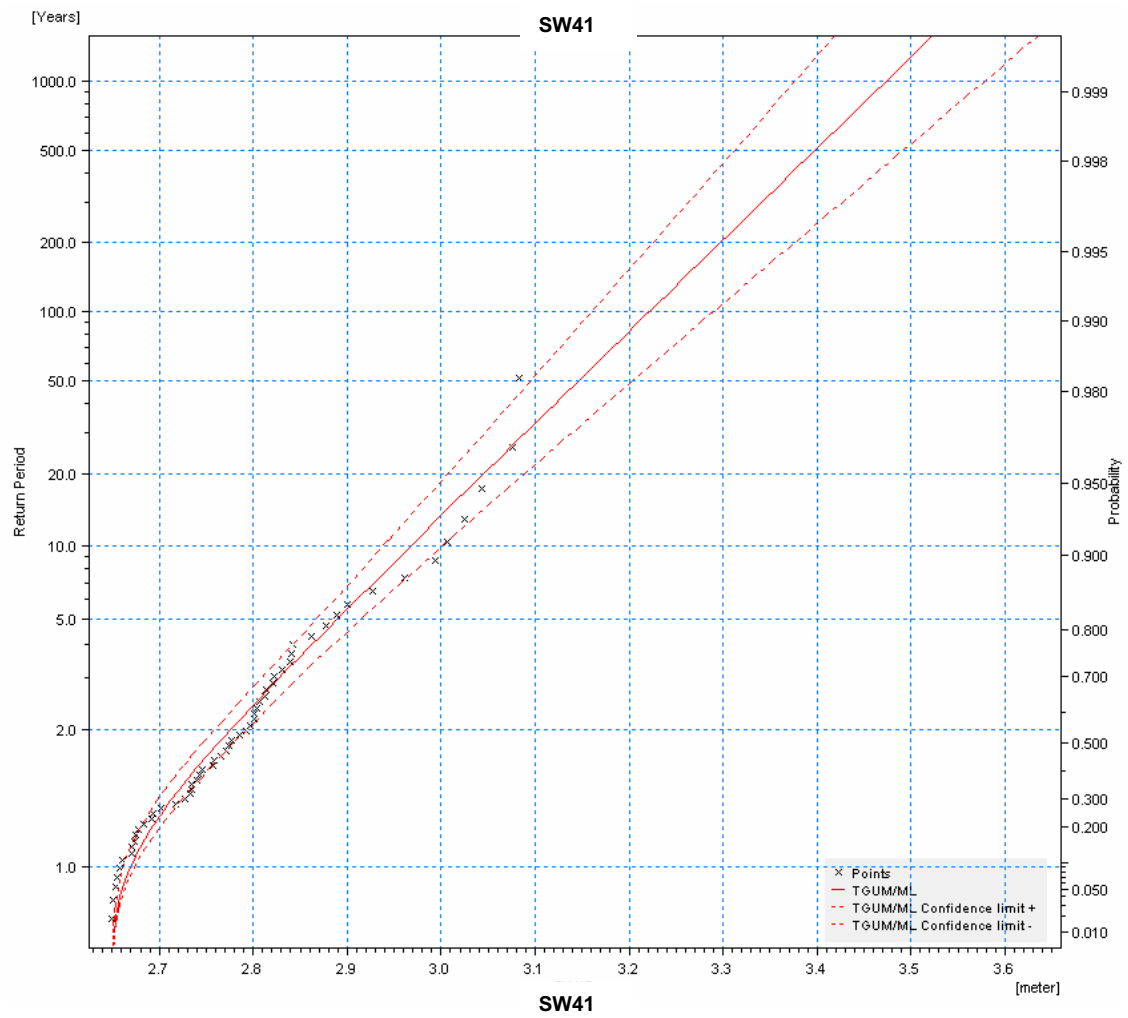


SW41		
		D/E Combination
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.670
	2.00	2.776
	5.00	2.889
	10.00	2.968
	20.00	3.045
	25.00	3.070
	50.00	3.146
	100.00	3.222
	200.00	3.297
	500.00	3.397
	1000.00	3.473
Average quantile	1.00	2.668
	2.00	2.776
	5.00	2.890
	10.00	2.970
	20.00	3.048
	25.00	3.073
	50.00	3.149
	100.00	3.225
	200.00	3.301
	500.00	3.401
	1000.00	3.477
Standard deviation	1.00	0.006
	2.00	0.017
	5.00	0.024
	10.00	0.032
	20.00	0.041
	25.00	0.044
	50.00	0.054
	100.00	0.065
	200.00	0.075
	500.00	0.090
	1000.00	0.101
Goodness -of-fit statistics	CHISQ	5.786
	SLSC	0.029
	PPCC1	0.990
	PPCC2	0.990

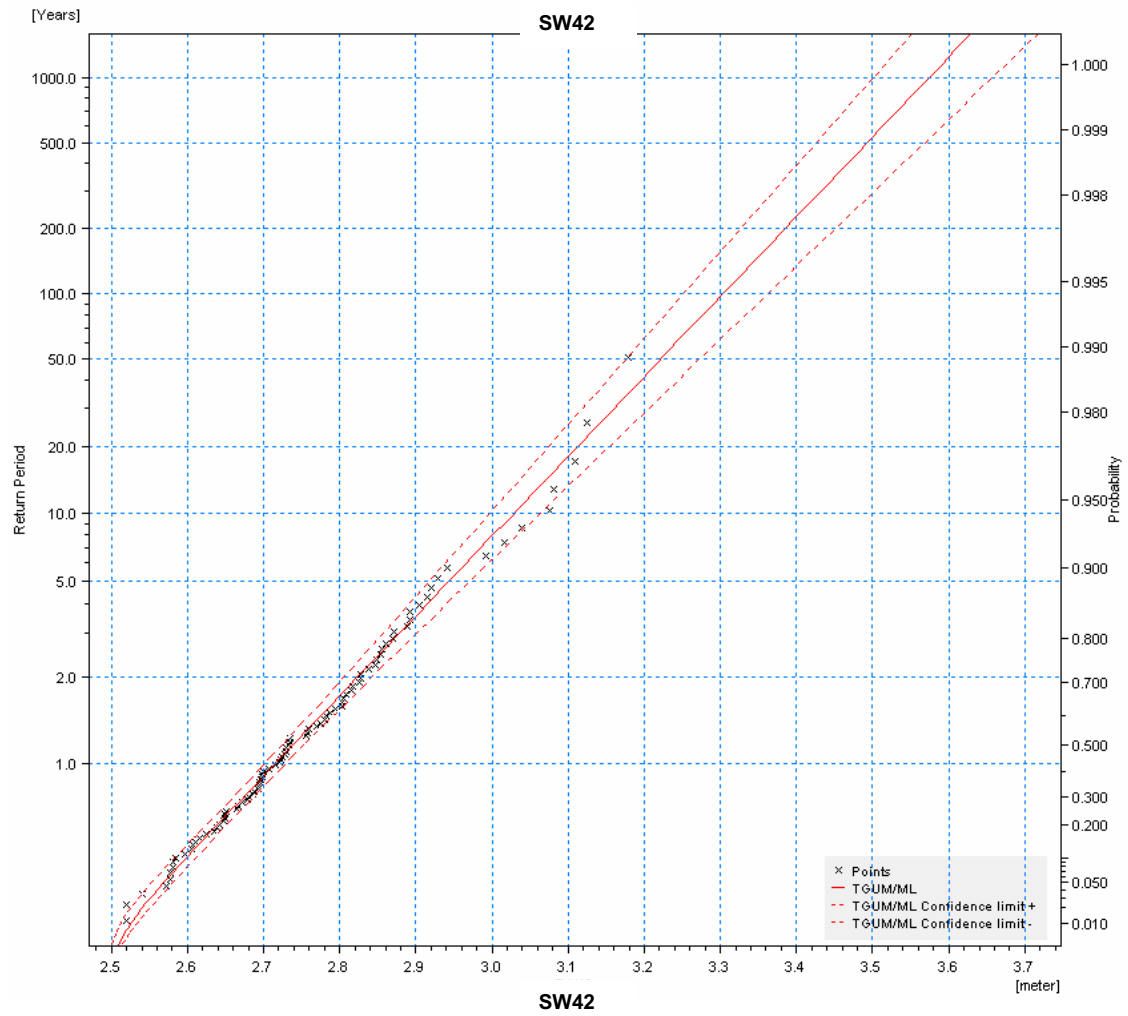


SW42		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.715
	2.00	2.823
	5.00	2.944
	10.00	3.029
	20.00	3.112
	25.00	3.139
	50.00	3.221
	100.00	3.303
	200.00	3.385
	500.00	3.493
	1000.00	3.575
Average quantile	1.00	2.715
	2.00	2.824
	5.00	2.945
	10.00	3.030
	20.00	3.114
	25.00	3.141
	50.00	3.224
	100.00	3.306
	200.00	3.389
	500.00	3.497
	1000.00	3.579
Standard deviation	1.00	0.014
	2.00	0.018
	5.00	0.027
	10.00	0.033
	20.00	0.040
	25.00	0.042
	50.00	0.049
	100.00	0.056
	200.00	0.062
	500.00	0.071
	1000.00	0.078
Goodness-of-fit statistics	CHISQ	5.719
	SLSC	0.016
	PPCC1	0.997
	PPCC2	0.997

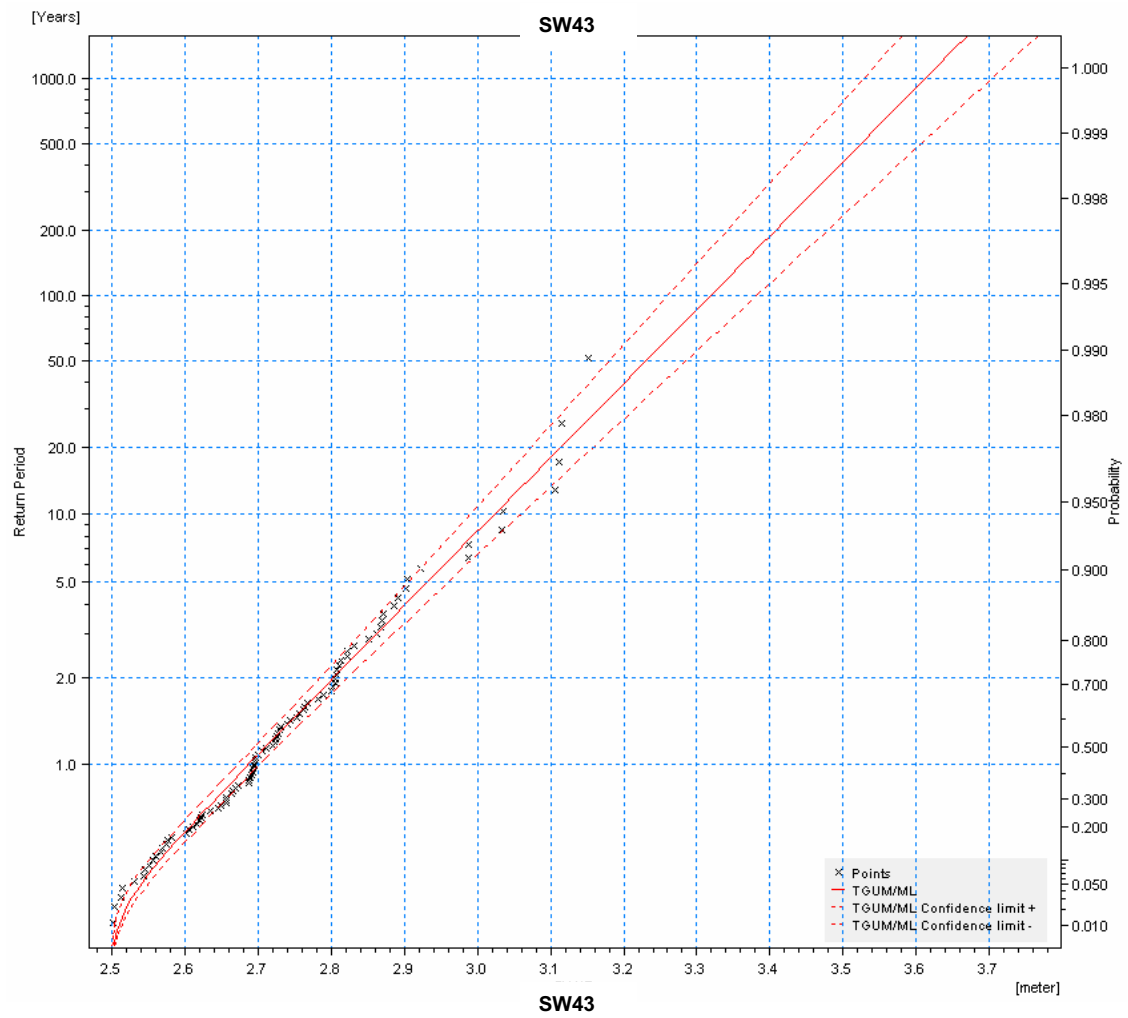


SW43		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.687
	2.00	2.803
	5.00	2.931
	10.00	3.023
	20.00	3.113
	25.00	3.142
	50.00	3.230
	100.00	3.319
	200.00	3.407
	500.00	3.523
	1000.00	3.611
Average quantile	1.00	2.687
	2.00	2.803
	5.00	2.933
	10.00	3.025
	20.00	3.115
	25.00	3.144
	50.00	3.233
	100.00	3.321
	200.00	3.410
	500.00	3.526
	1000.00	3.615
Standard deviation	1.00	0.015
	2.00	0.019
	5.00	0.027
	10.00	0.035
	20.00	0.042
	25.00	0.045
	50.00	0.053
	100.00	0.061
	200.00	0.069
	500.00	0.079
	1000.00	0.087
Goodness-of-fit statistics	CHISQ	4.222
	SLSC	0.022
	PPCC1	0.994
	PPCC2	0.994

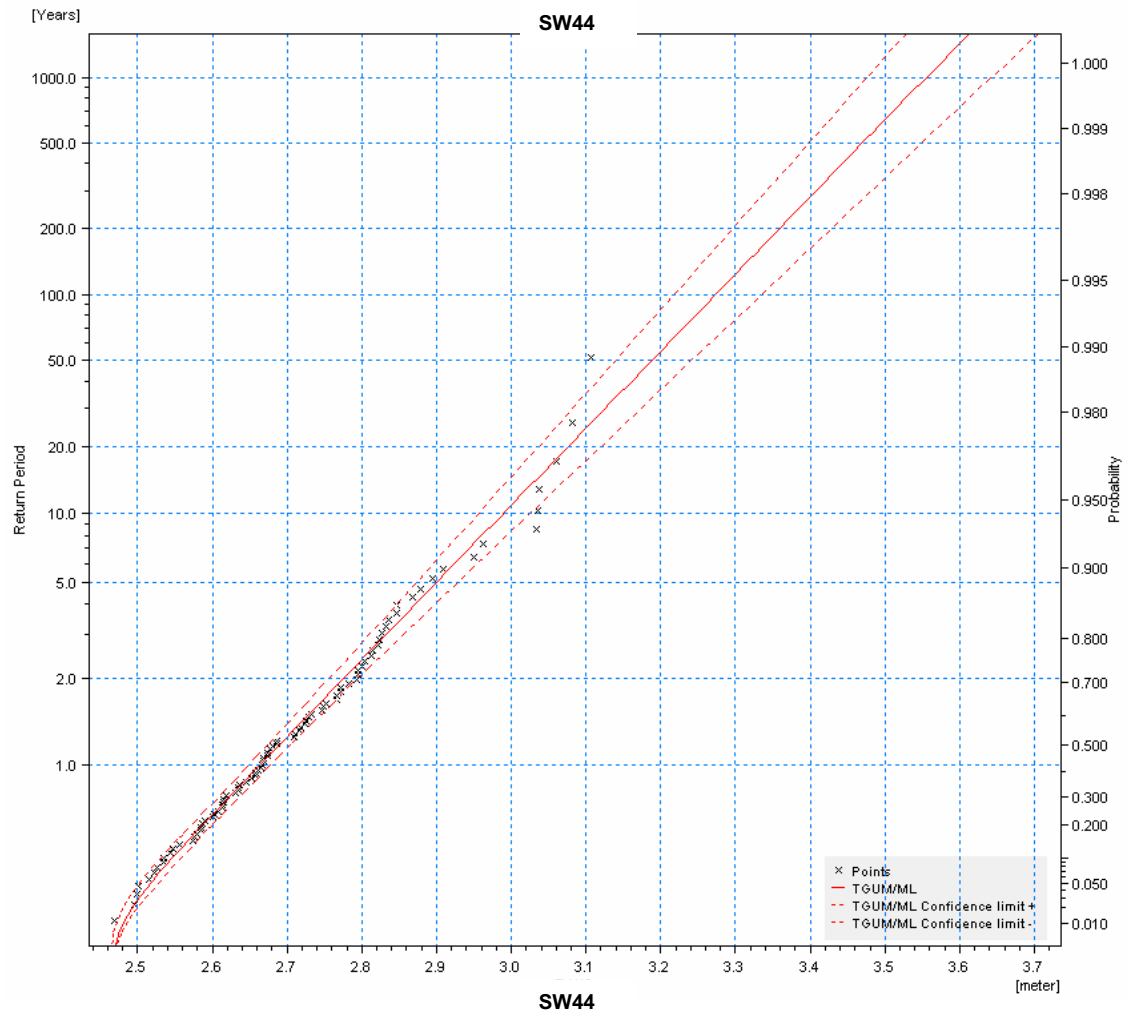


SW44		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.663
	2.00	2.775
	5.00	2.900
	10.00	2.989
	20.00	3.075
	25.00	3.103
	50.00	3.188
	100.00	3.274
	200.00	3.359
	500.00	3.471
	1000.00	3.556
Average quantile	1.00	2.663
	2.00	2.776
	5.00	2.901
	10.00	2.990
	20.00	3.077
	25.00	3.105
	50.00	3.191
	100.00	3.276
	200.00	3.362
	500.00	3.475
	1000.00	3.560
Standard deviation	1.00	0.014
	2.00	0.019
	5.00	0.028
	10.00	0.034
	20.00	0.042
	25.00	0.044
	50.00	0.051
	100.00	0.059
	200.00	0.066
	500.00	0.076
	1000.00	0.083
Goodness-of-fit statistics	CHISQ	6.545
	SLSC	0.021
	PPCC1	0.994
	PPCC2	0.994

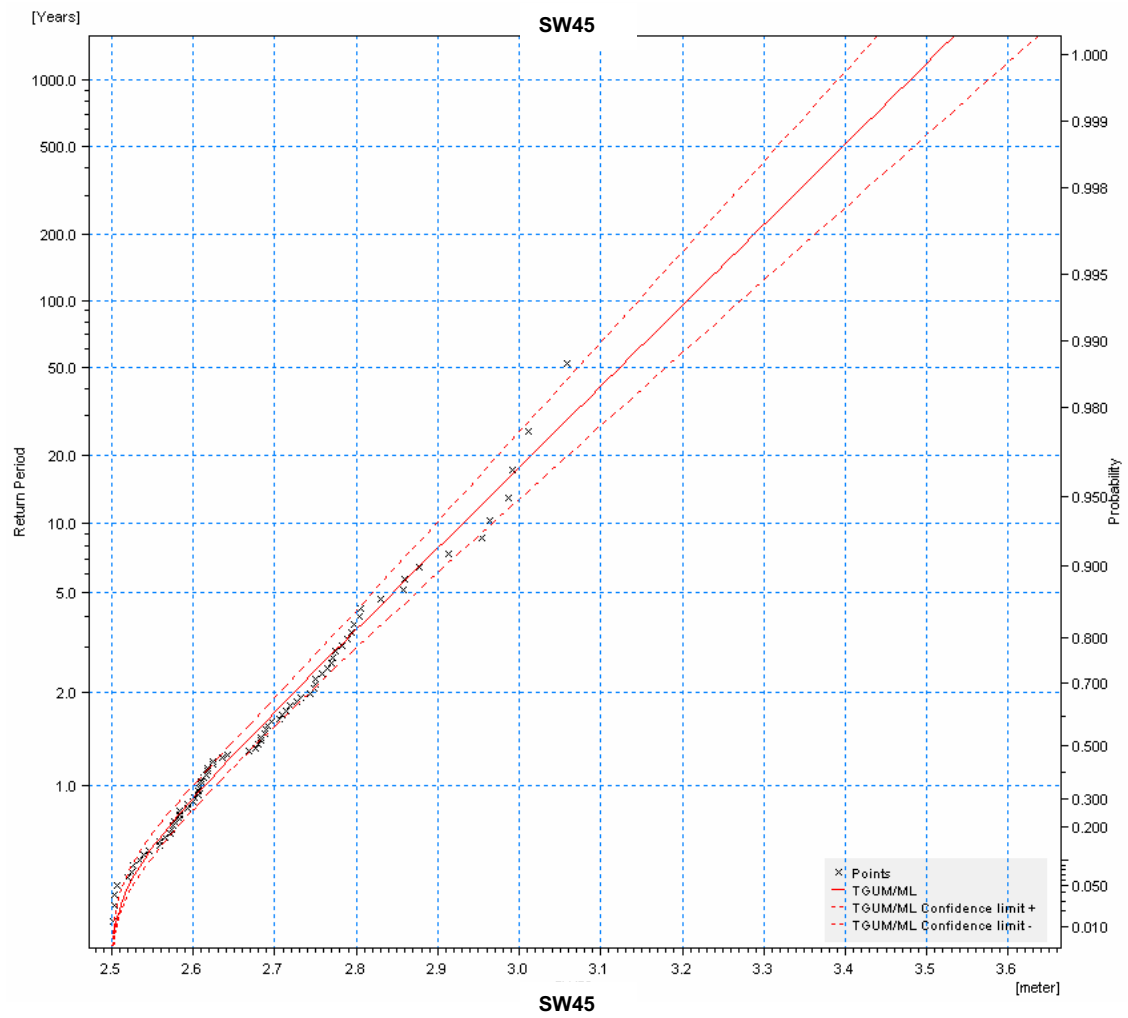


SW45		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.614
	2.00	2.724
	5.00	2.845
	10.00	2.931
	20.00	3.015
	25.00	3.042
	50.00	3.124
	100.00	3.207
	200.00	3.289
	500.00	3.397
	1000.00	3.479
Average quantile	1.00	2.613
	2.00	2.725
	5.00	2.847
	10.00	2.933
	20.00	3.017
	25.00	3.044
	50.00	3.127
	100.00	3.209
	200.00	3.292
	500.00	3.401
	1000.00	3.483
Standard deviation	1.00	0.014
	2.00	0.018
	5.00	0.027
	10.00	0.035
	20.00	0.043
	25.00	0.046
	50.00	0.054
	100.00	0.063
	200.00	0.072
	500.00	0.084
	1000.00	0.093
Goodness-of-fit statistics	CHISQ	10.462
	SLSC	0.023
	PPCC1	0.994
	PPCC2	0.994

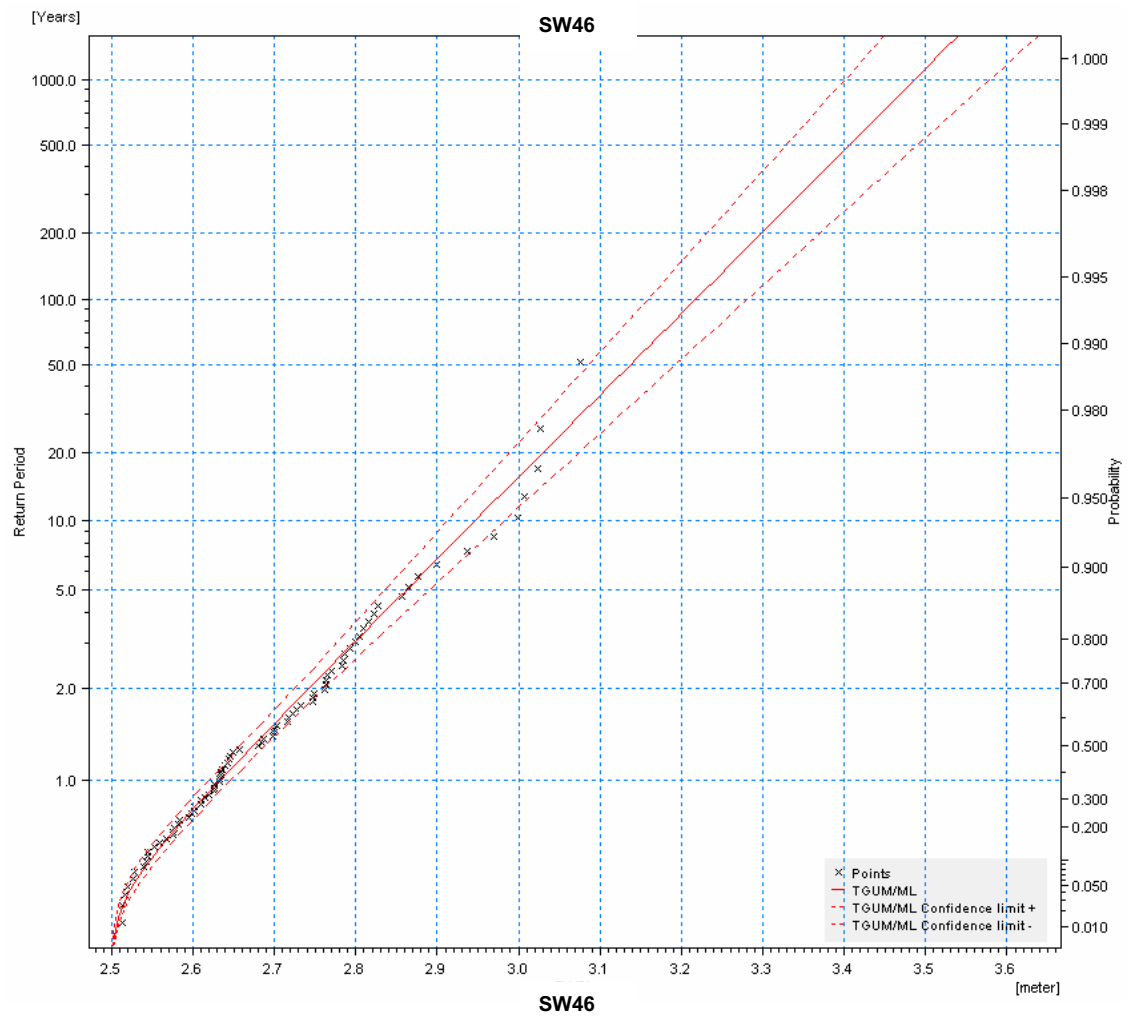


SW46		
		D/E Combination
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.633
	2.00	2.742
	5.00	2.862
	10.00	2.946
	20.00	3.029
	25.00	3.055
	50.00	3.137
	100.00	3.218
	200.00	3.299
	500.00	3.406
	1000.00	3.486
Average quantile	1.00	2.633
	2.00	2.743
	5.00	2.863
	10.00	2.948
	20.00	3.030
	25.00	3.057
	50.00	3.139
	100.00	3.220
	200.00	3.301
	500.00	3.408
	1000.00	3.490
Standard deviation	1.00	0.014
	2.00	0.018
	5.00	0.027
	10.00	0.035
	20.00	0.043
	25.00	0.045
	50.00	0.053
	100.00	0.061
	200.00	0.070
	500.00	0.081
	1000.00	0.089
Goodness-of-fit statistics	CHISQ	3.815
	SLSC	0.022
	PPCC1	0.994
	PPCC2	0.994

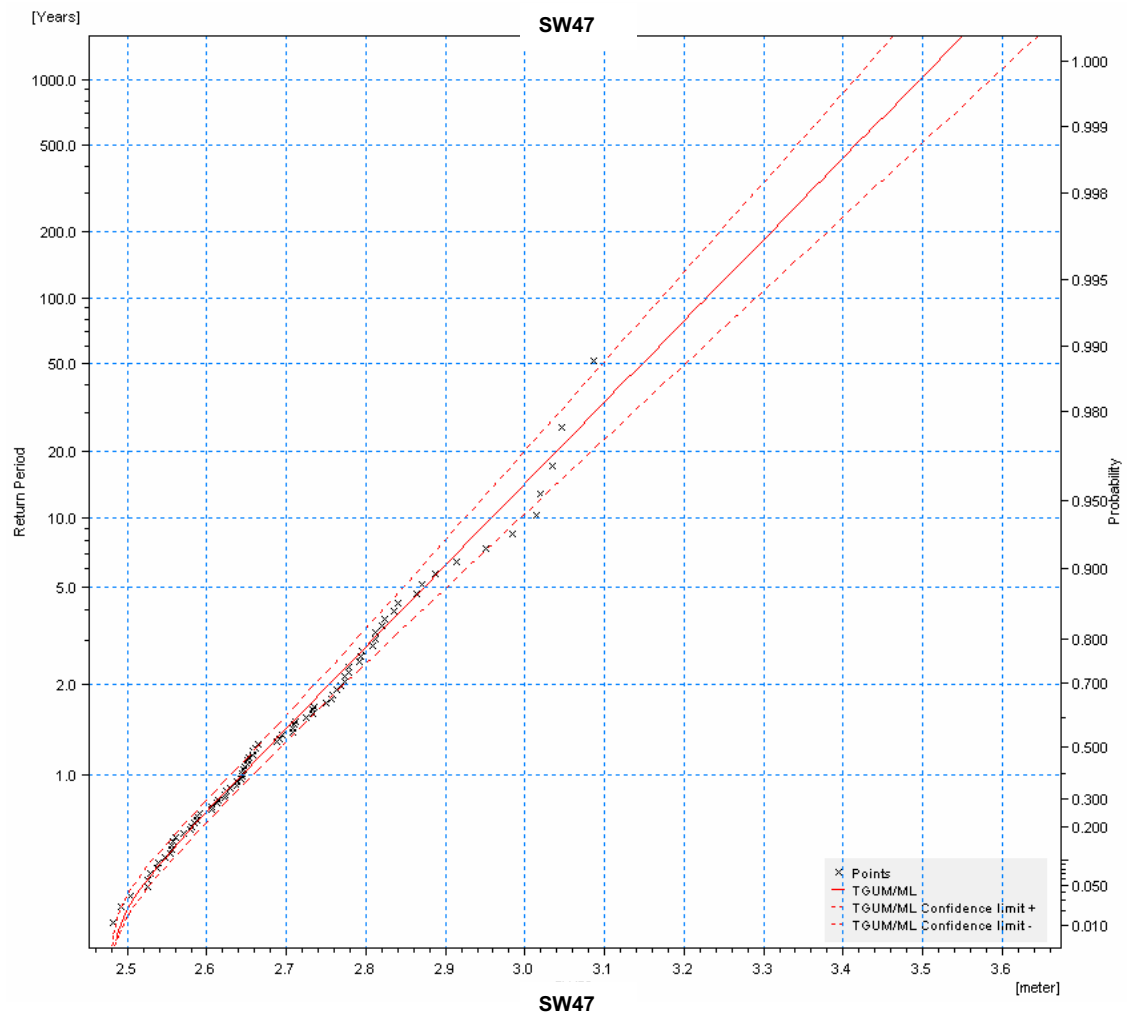


SW4 7		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.644
	2.00	2.753
	5.00	2.873
	10.00	2.957
	20.00	3.039
	25.00	3.066
	50.00	3.147
	100.00	3.228
	200.00	3.309
	500.00	3.416
	1000.00	3.497
Average quantile	1.00	2.644
	2.00	2.754
	5.00	2.874
	10.00	2.958
	20.00	3.041
	25.00	3.068
	50.00	3.149
	100.00	3.231
	200.00	3.312
	500.00	3.419
	1000.00	3.500
Standard deviation	1.00	0.014
	2.00	0.018
	5.00	0.027
	10.00	0.035
	20.00	0.042
	25.00	0.045
	50.00	0.052
	100.00	0.060
	200.00	0.067
	500.00	0.078
	1000.00	0.085
Goodness-of-fit statistics	CHISQ	3.619
	SLSC	0.021
	PPCC1	0.995
	PPCC2	0.995

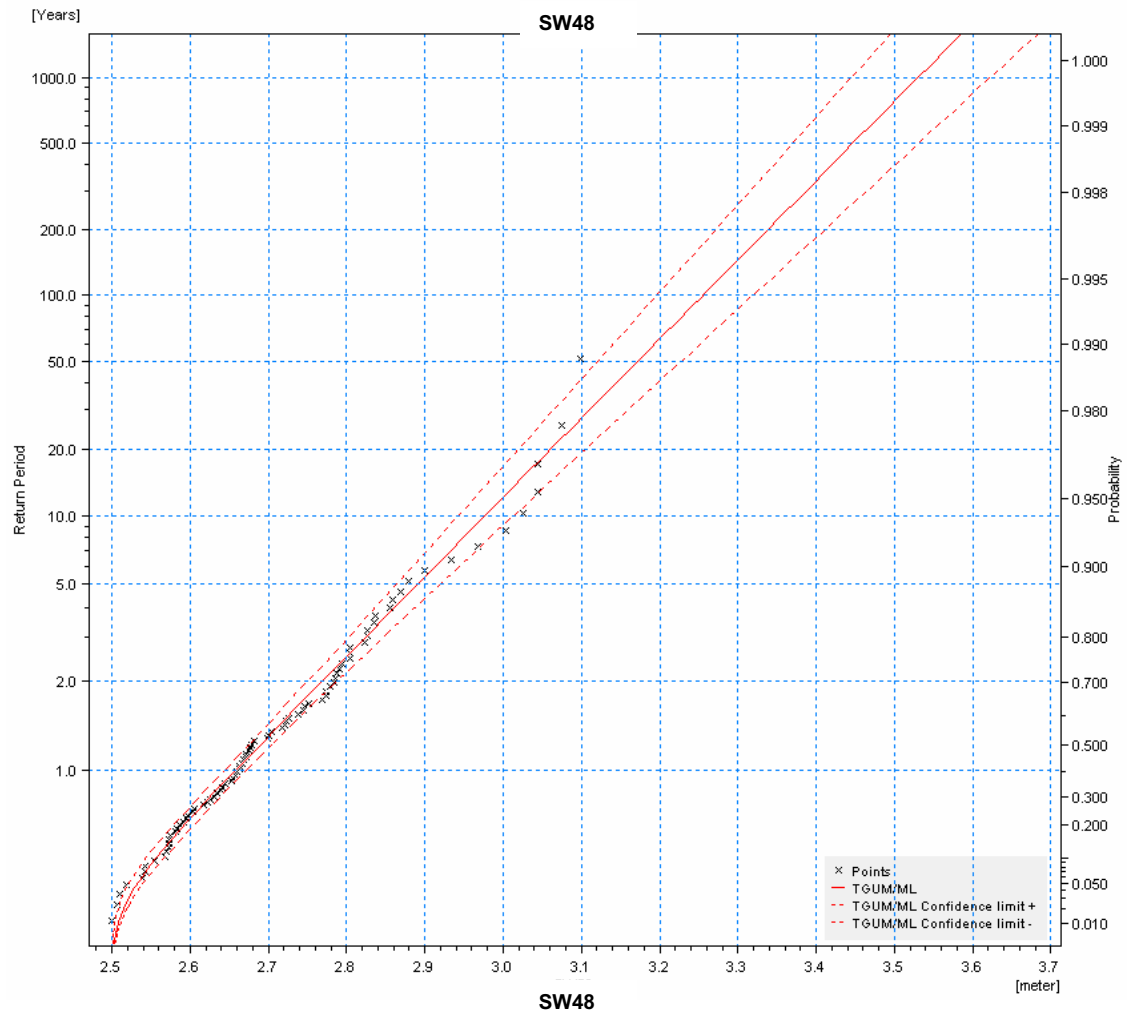


SW48		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.658
	2.00	2.768
	5.00	2.890
	10.00	2.977
	20.00	3.061
	25.00	3.088
	50.00	3.172
	100.00	3.255
	200.00	3.338
	500.00	3.448
	1000.00	3.530
Average quantile	1.00	2.658
	2.00	2.769
	5.00	2.891
	10.00	2.978
	20.00	3.063
	25.00	3.090
	50.00	3.174
	100.00	3.258
	200.00	3.341
	500.00	3.451
	1000.00	3.534
Standard deviation	1.00	0.014
	2.00	0.019
	5.00	0.028
	10.00	0.035
	20.00	0.043
	25.00	0.045
	50.00	0.053
	100.00	0.062
	200.00	0.070
	500.00	0.080
	1000.00	0.089
Goodness-of-fit statistics	CHISQ	7.118
	SLSC	0.021
	PPCC1	0.995
	PPCC2	0.995

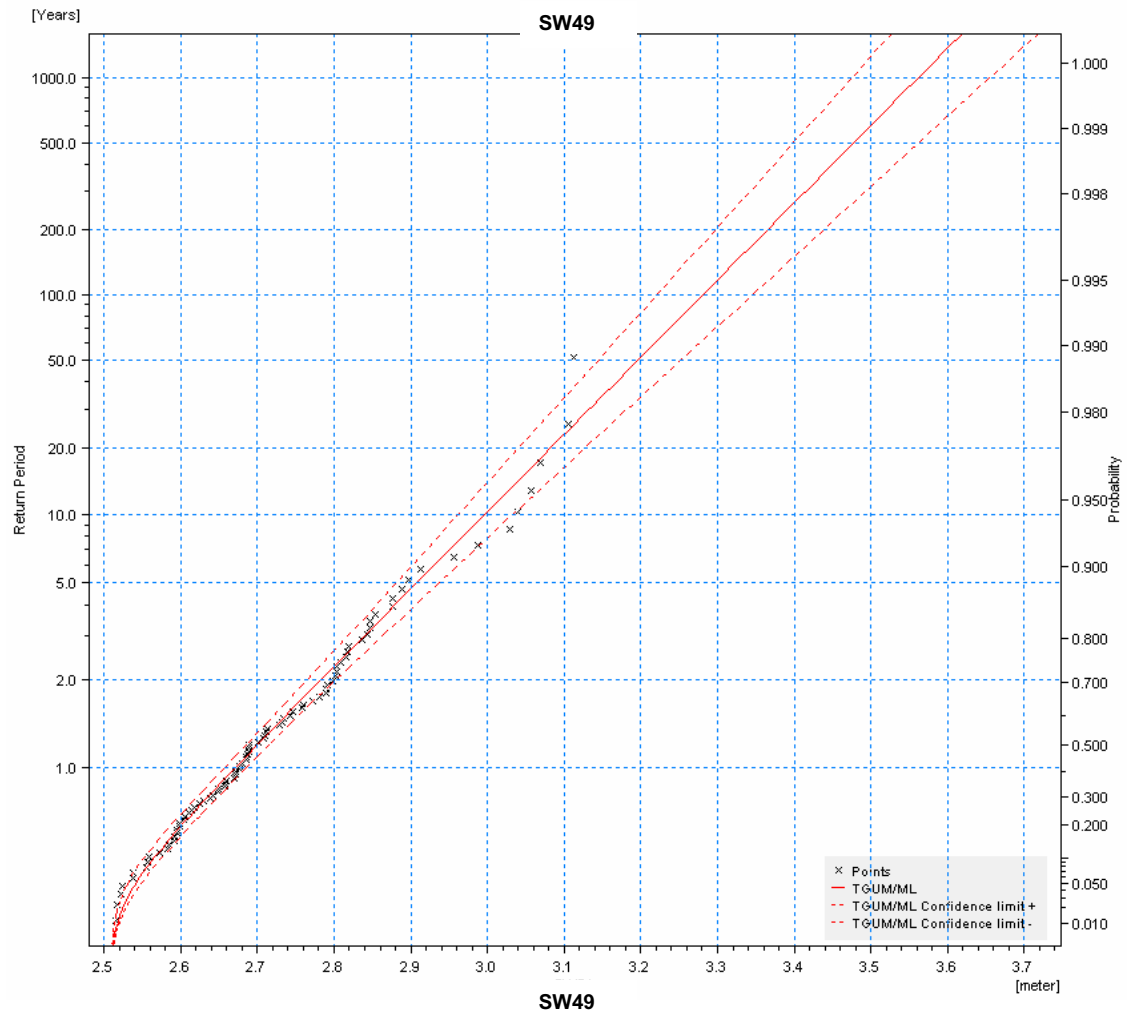


SW49		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.672
	2.00	2.784
	5.00	2.908
	10.00	2.996
	20.00	3.083
	25.00	3.110
	50.00	3.196
	100.00	3.281
	200.00	3.366
	500.00	3.478
	1000.00	3.562
Average quantile	1.00	2.672
	2.00	2.785
	5.00	2.909
	10.00	2.998
	20.00	3.085
	25.00	3.112
	50.00	3.198
	100.00	3.283
	200.00	3.368
	500.00	3.481
	1000.00	3.566
Standard deviation	1.00	0.014
	2.00	0.019
	5.00	0.028
	10.00	0.036
	20.00	0.043
	25.00	0.046
	50.00	0.054
	100.00	0.062
	200.00	0.071
	500.00	0.082
	1000.00	0.090
Goodness -of-fit statistics	CHISQ	5.759
	SLSC	0.021
	PPCC1	0.995
	PPCC2	0.995

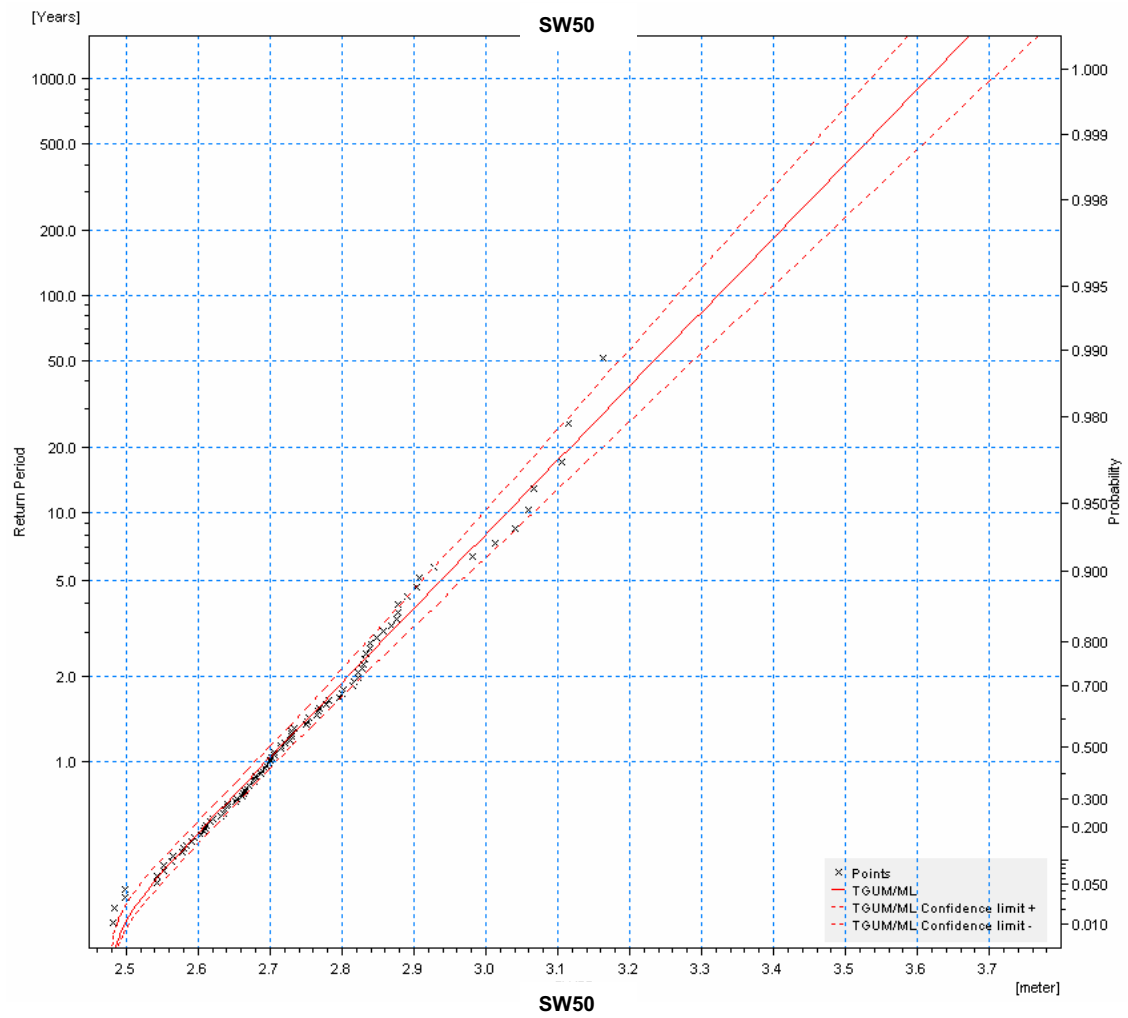


SW50		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.695
	2.00	2.809
	5.00	2.938
	10.00	3.029
	20.00	3.118
	25.00	3.147
	50.00	3.235
	100.00	3.323
	200.00	3.410
	500.00	3.526
	1000.00	3.614
Average quantile	1.00	2.695
	2.00	2.810
	5.00	2.939
	10.00	3.031
	20.00	3.120
	25.00	3.149
	50.00	3.238
	100.00	3.326
	200.00	3.414
	500.00	3.531
	1000.00	3.619
Standard deviation	1.00	0.015
	2.00	0.019
	5.00	0.027
	10.00	0.035
	20.00	0.042
	25.00	0.044
	50.00	0.052
	100.00	0.059
	200.00	0.067
	500.00	0.077
	1000.00	0.085
Goodness-of-fit statistics	CHISQ	3.000
	SLSC	0.020
	PPCC1	0.995
	PPCC2	0.995

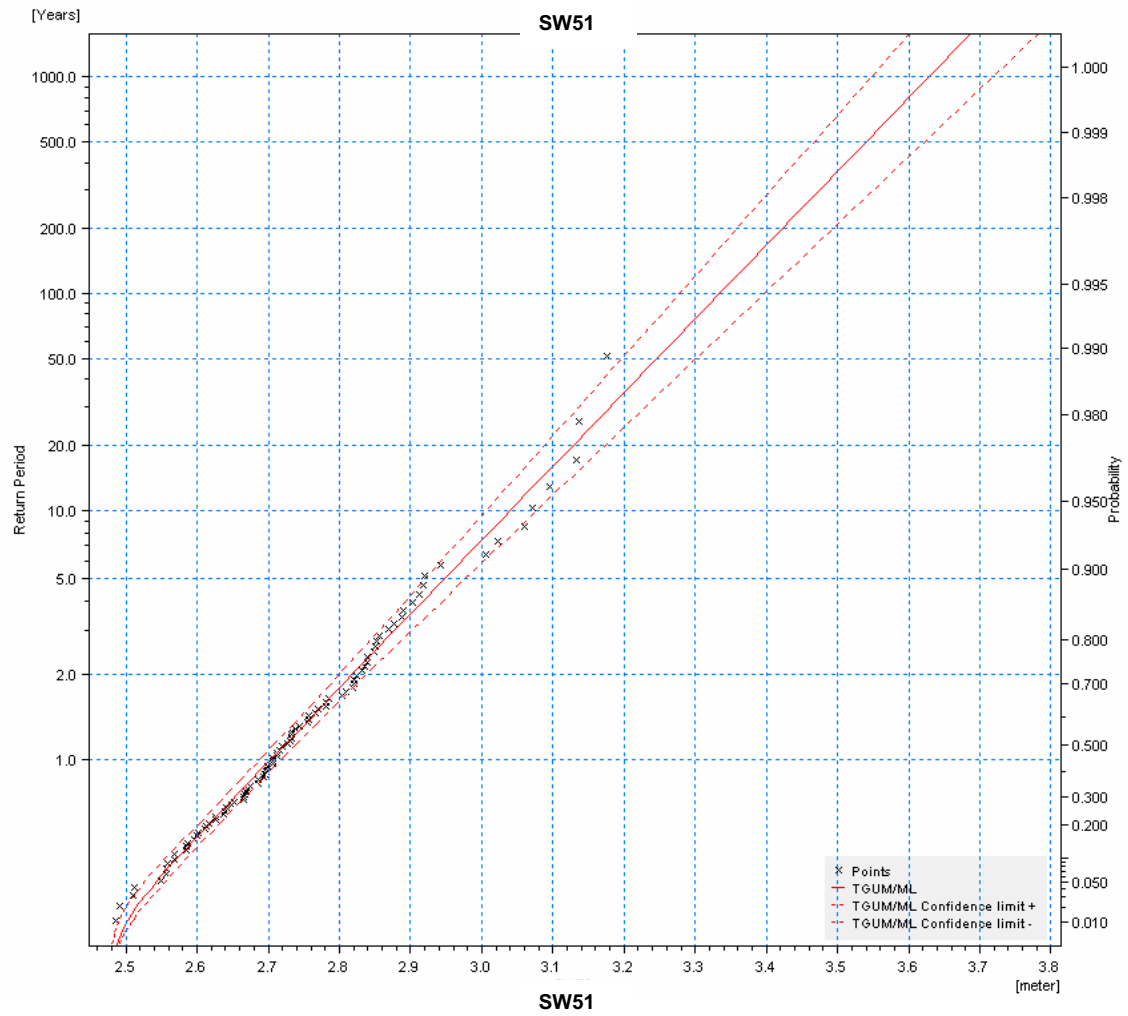


SW51		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.704
	2.00	2.819
	5.00	2.948
	10.00	3.039
	20.00	3.129
	25.00	3.158
	50.00	3.247
	100.00	3.335
	200.00	3.423
	500.00	3.540
	1000.00	3.628
Average quantile	1.00	2.704
	2.00	2.819
	5.00	2.949
	10.00	3.041
	20.00	3.131
	25.00	3.160
	50.00	3.249
	100.00	3.338
	200.00	3.427
	500.00	3.544
	1000.00	3.632
Standard deviation	1.00	0.015
	2.00	0.019
	5.00	0.028
	10.00	0.035
	20.00	0.043
	25.00	0.045
	50.00	0.052
	100.00	0.060
	200.00	0.068
	500.00	0.078
	1000.00	0.085
Goodness-of-fit statistics	CHISQ	4.522
	SLSC	0.019
	PPCC1	0.995
	PPCC2	0.995

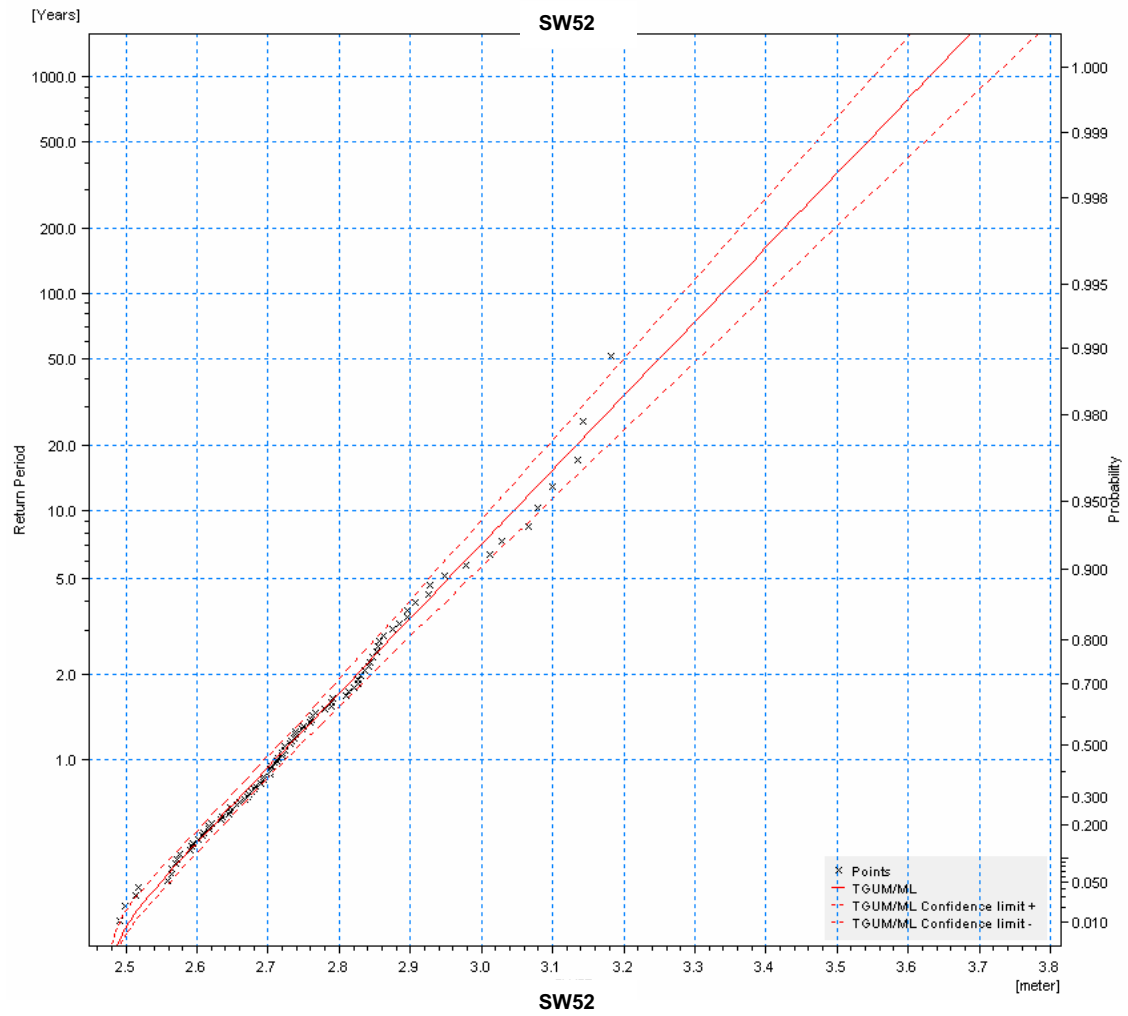


SW52		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.711
	2.00	2.825
	5.00	2.953
	10.00	3.045
	20.00	3.134
	25.00	3.163
	50.00	3.251
	100.00	3.339
	200.00	3.426
	500.00	3.542
	1000.00	3.630
Average quantile	1.00	2.711
	2.00	2.826
	5.00	2.955
	10.00	3.046
	20.00	3.136
	25.00	3.165
	50.00	3.254
	100.00	3.342
	200.00	3.430
	500.00	3.547
	1000.00	3.635
Standard deviation	1.00	0.015
	2.00	0.019
	5.00	0.028
	10.00	0.035
	20.00	0.042
	25.00	0.045
	50.00	0.052
	100.00	0.060
	200.00	0.067
	500.00	0.077
	1000.00	0.084
Goodness-of-fit statistics	CHISQ	5.609
	SLSC	0.018
	PPCC1	0.996
	PPCC2	0.996

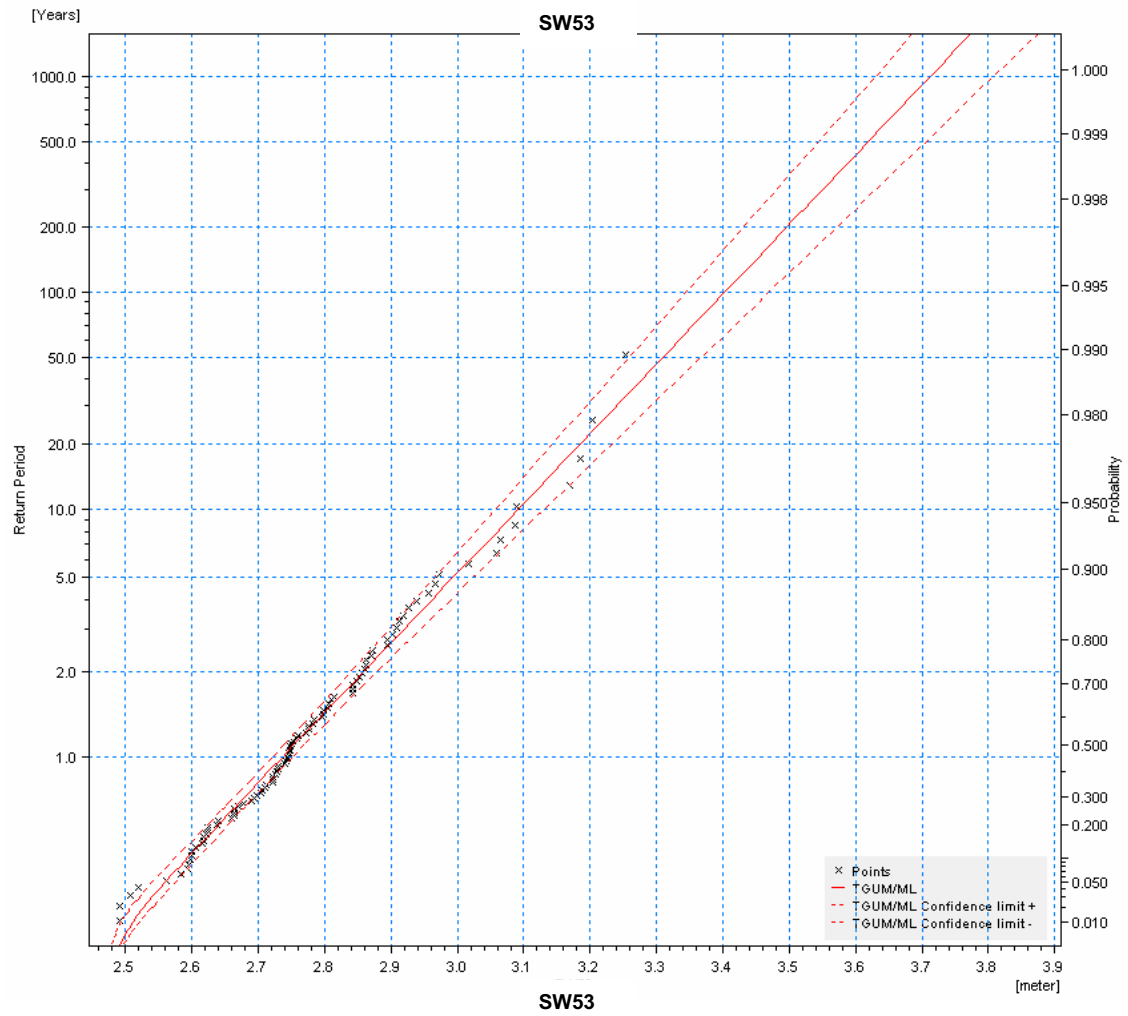


SW53		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.737
	2.00	2.858
	5.00	2.994
	10.00	3.091
	20.00	3.186
	25.00	3.216
	50.00	3.310
	100.00	3.403
	200.00	3.496
	500.00	3.619
	1000.00	3.712
Average quantile	1.00	2.737
	2.00	2.859
	5.00	2.996
	10.00	3.093
	20.00	3.188
	25.00	3.219
	50.00	3.313
	100.00	3.407
	200.00	3.501
	500.00	3.624
	1000.00	3.718
Standard deviation	1.00	0.015
	2.00	0.020
	5.00	0.029
	10.00	0.037
	20.00	0.044
	25.00	0.047
	50.00	0.055
	100.00	0.063
	200.00	0.071
	500.00	0.081
	1000.00	0.089
Goodness-of-fit statistics	CHISQ	13.660
	SLSC	0.019
	PPCC1	0.996
	PPCC2	0.996

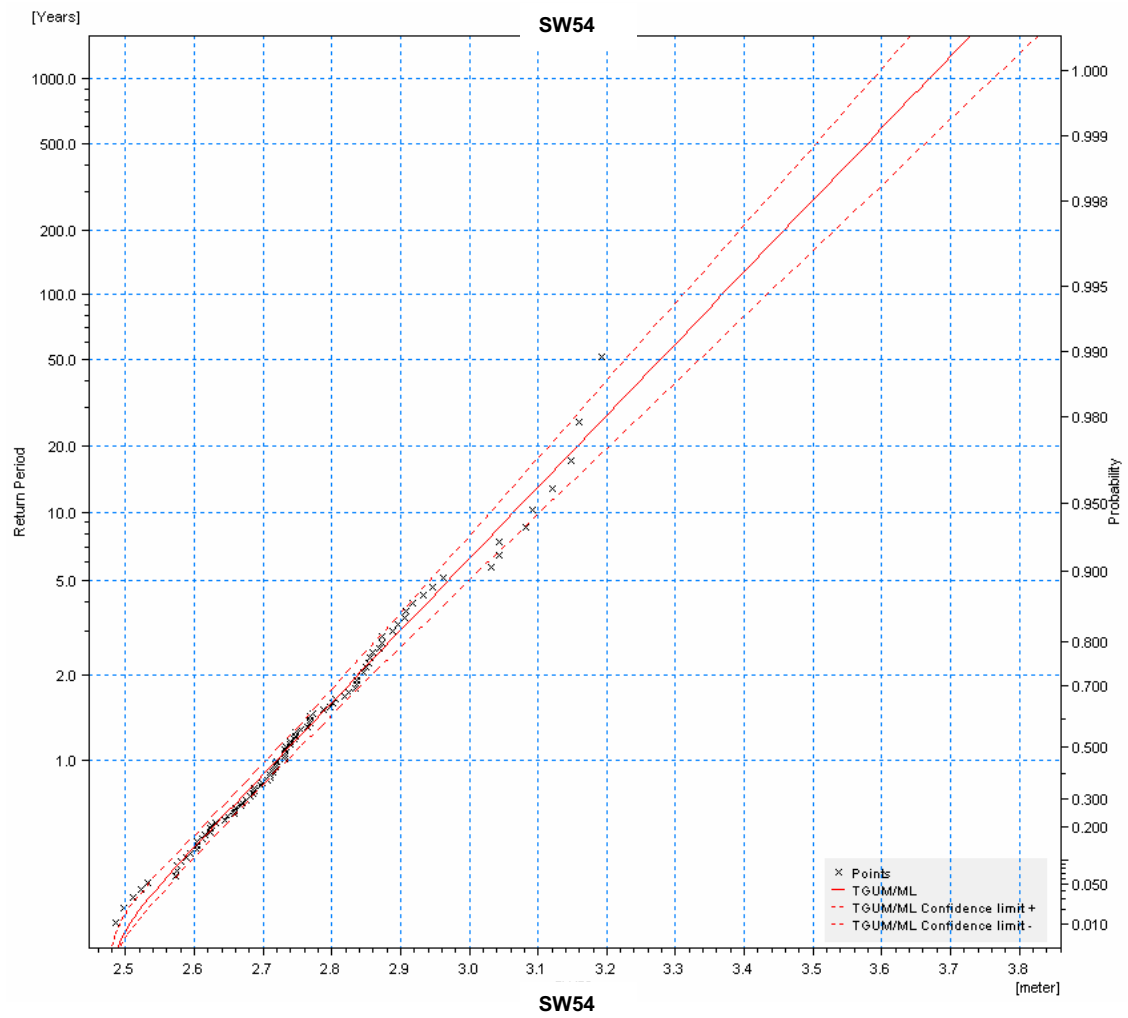


SW54		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.720
	2.00	2.838
	5.00	2.970
	10.00	3.065
	20.00	3.157
	25.00	3.186
	50.00	3.277
	100.00	3.368
	200.00	3.459
	500.00	3.578
	1000.00	3.669
Average quantile	1.00	2.720
	2.00	2.839
	5.00	2.972
	10.00	3.067
	20.00	3.159
	25.00	3.189
	50.00	3.281
	100.00	3.372
	200.00	3.463
	500.00	3.583
	1000.00	3.674
Standard deviation	1.00	0.015
	2.00	0.020
	5.00	0.029
	10.00	0.036
	20.00	0.044
	25.00	0.046
	50.00	0.054
	100.00	0.062
	200.00	0.069
	500.00	0.080
	1000.00	0.088
Goodness-of-fit statistics	CHISQ	6.677
	SLSC	0.021
	PPCC1	0.995
	PPCC2	0.995

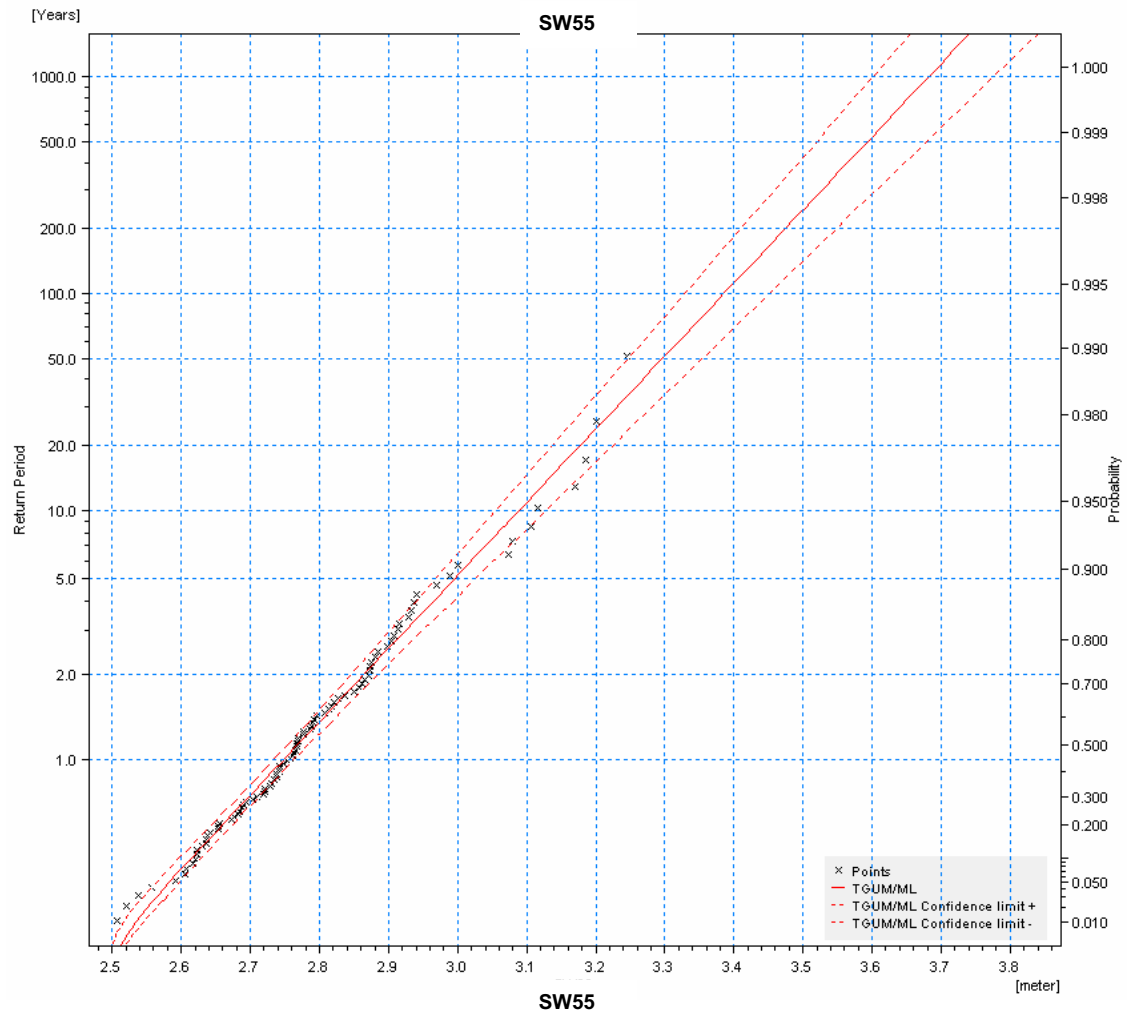


SW55		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.749
	2.00	2.866
	5.00	2.996
	10.00	3.088
	20.00	3.179
	25.00	3.208
	50.00	3.297
	100.00	3.386
	200.00	3.475
	500.00	3.593
	1000.00	3.682
Average quantile	1.00	2.749
	2.00	2.866
	5.00	2.997
	10.00	3.090
	20.00	3.182
	25.00	3.211
	50.00	3.301
	100.00	3.391
	200.00	3.480
	500.00	3.599
	1000.00	3.688
Standard deviation	1.00	0.015
	2.00	0.020
	5.00	0.029
	10.00	0.036
	20.00	0.044
	25.00	0.046
	50.00	0.054
	100.00	0.061
	200.00	0.069
	500.00	0.080
	1000.00	0.087
Goodness-of-fit statistics	CHISQ	6.478
	SLSC	0.020
	PPCC1	0.995
	PPCC2	0.995

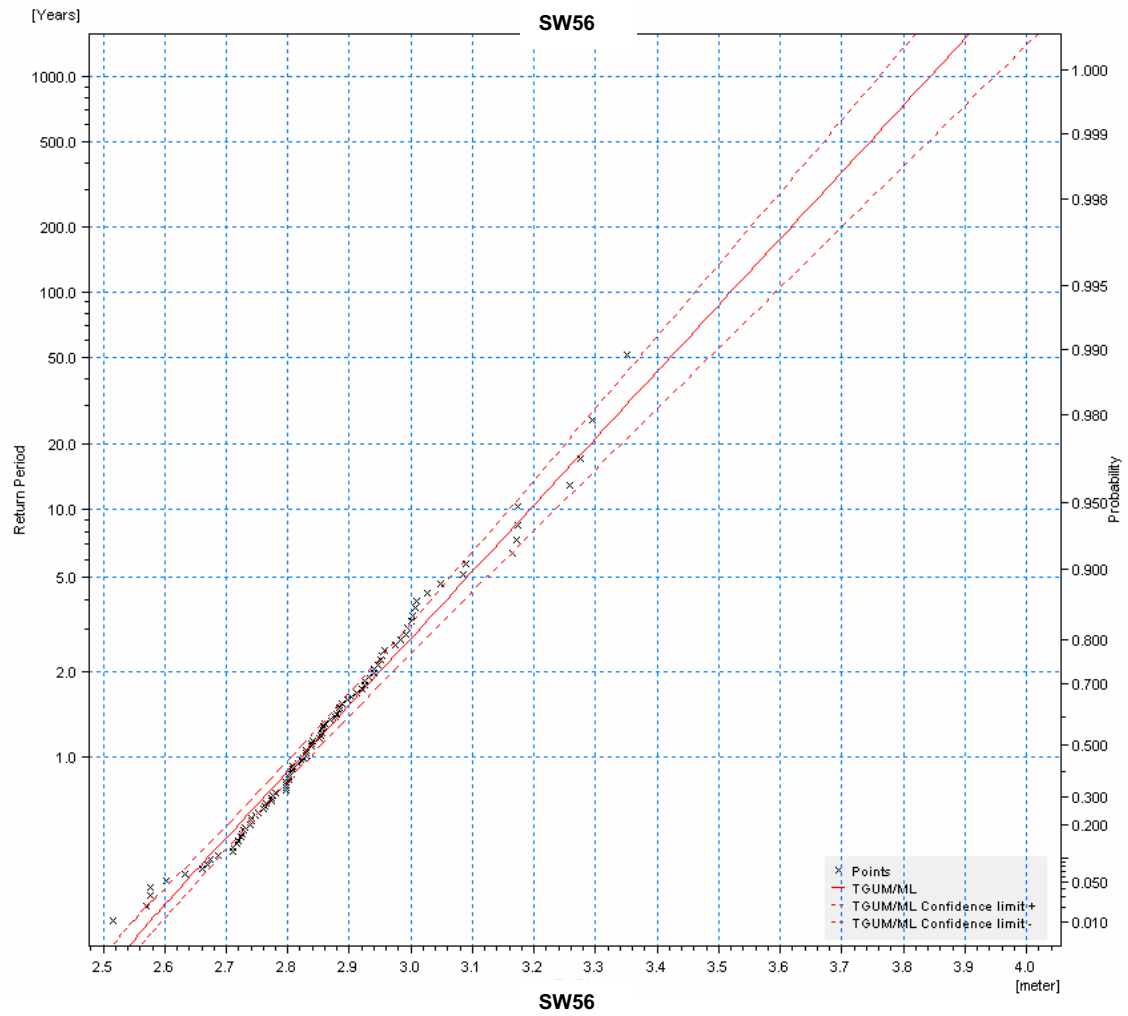


SW56		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.822
	2.00	2.949
	5.00	3.091
	10.00	3.193
	20.00	3.292
	25.00	3.324
	50.00	3.422
	100.00	3.519
	200.00	3.617
	500.00	3.745
	1000.00	3.843
Average quantile	1.00	2.822
	2.00	2.950
	5.00	3.094
	10.00	3.196
	20.00	3.297
	25.00	3.329
	50.00	3.428
	100.00	3.527
	200.00	3.625
	500.00	3.755
	1000.00	3.854
Standard deviation	1.00	0.016
	2.00	0.020
	5.00	0.030
	10.00	0.038
	20.00	0.046
	25.00	0.049
	50.00	0.057
	100.00	0.065
	200.00	0.074
	500.00	0.085
	1000.00	0.094
Goodness-of-fit statistics	CHISQ	3.872
	SLSC	0.024
	PPCC1	0.993
	PPCC2	0.993

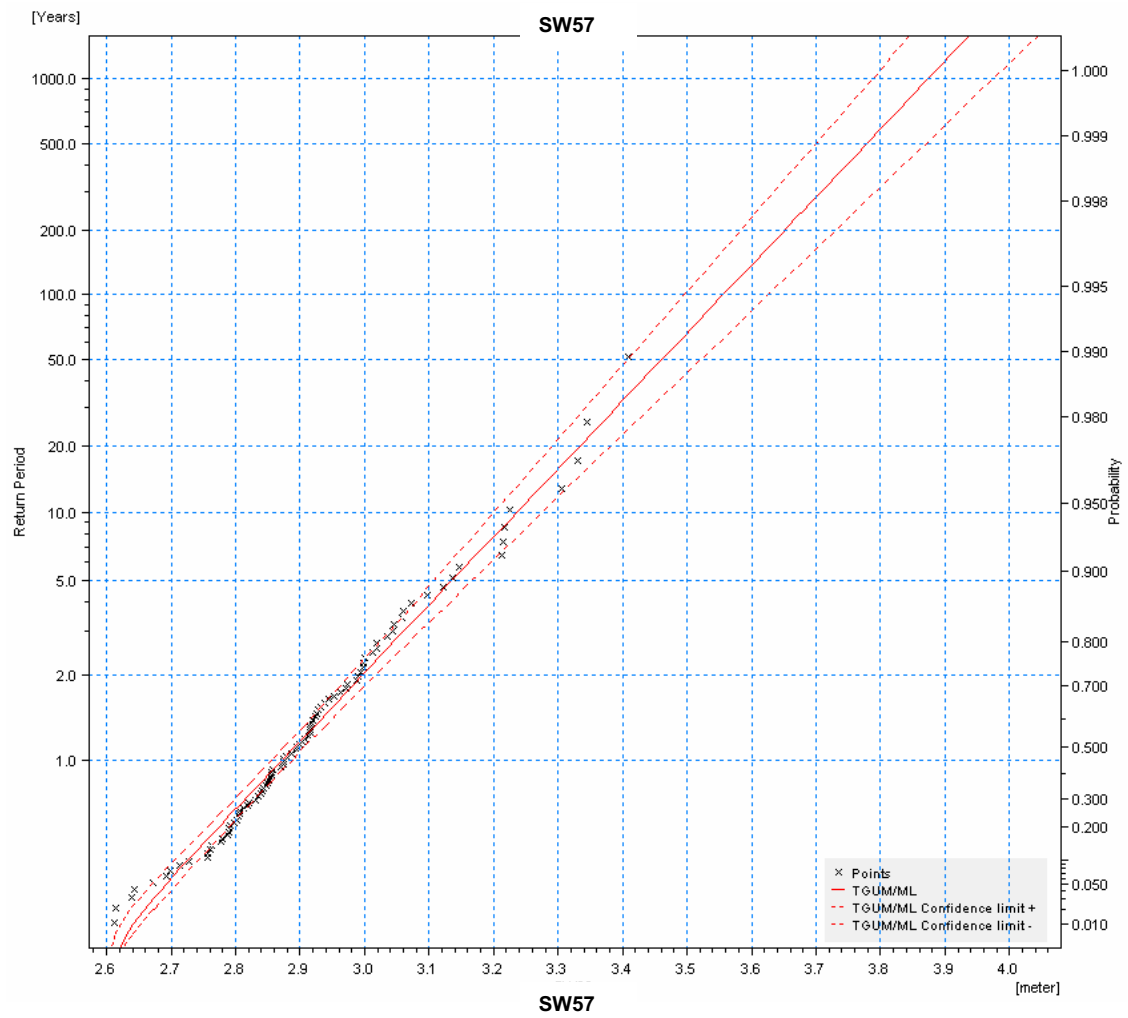


SW57		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.872
	2.00	2.997
	5.00	3.136
	10.00	3.236
	20.00	3.333
	25.00	3.364
	50.00	3.461
	100.00	3.556
	200.00	3.652
	500.00	3.778
	1000.00	3.874
Average quantile	1.00	2.872
	2.00	2.998
	5.00	3.138
	10.00	3.238
	20.00	3.337
	25.00	3.368
	50.00	3.465
	100.00	3.561
	200.00	3.657
	500.00	3.785
	1000.00	3.881
Standard deviation	1.00	0.016
	2.00	0.020
	5.00	0.030
	10.00	0.038
	20.00	0.046
	25.00	0.048
	50.00	0.057
	100.00	0.065
	200.00	0.074
	500.00	0.085
	1000.00	0.094
Goodness-of-fit statistics	CHISQ	9.258
	SLSC	0.022
	PPCC1	0.994
	PPCC2	0.994

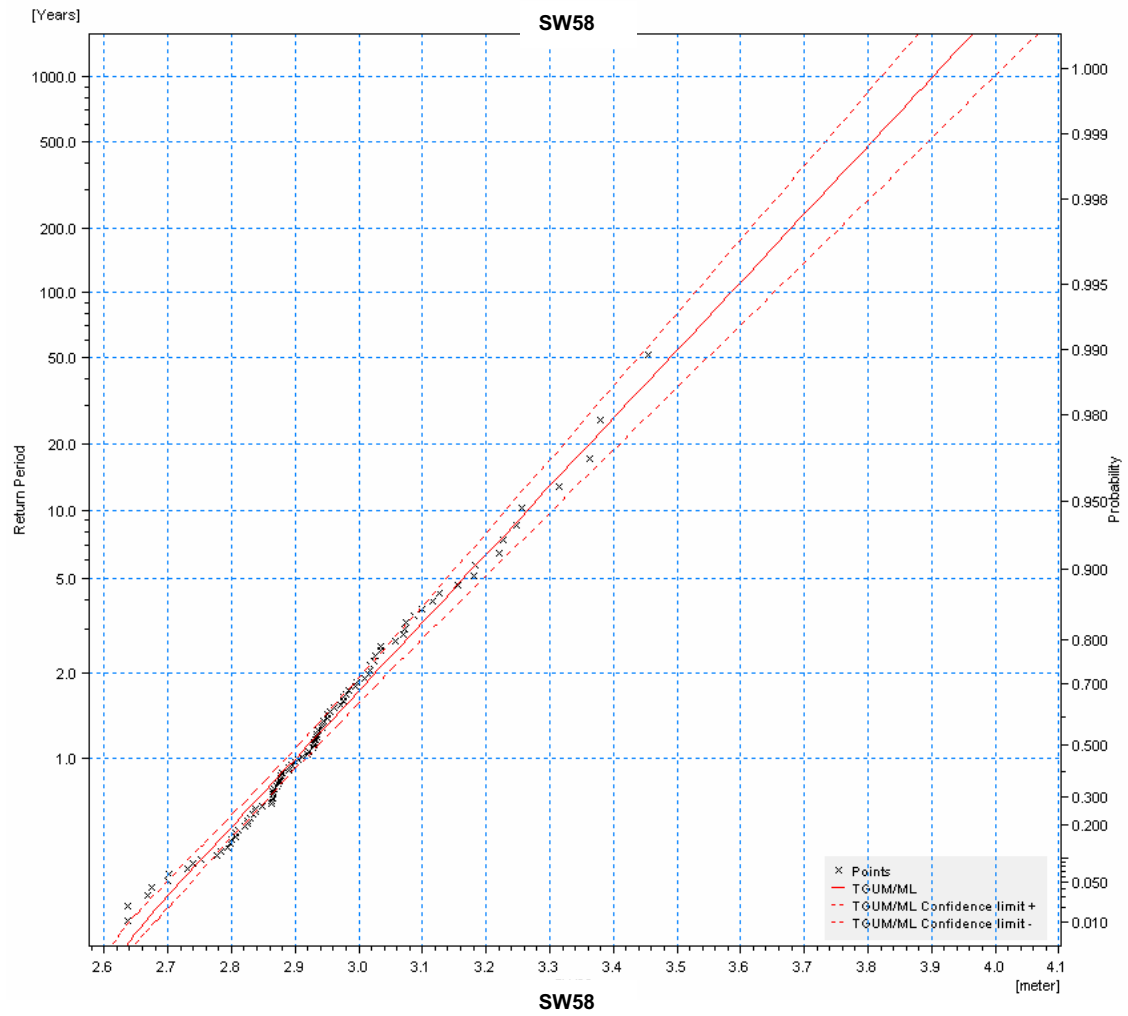


SW58		
	D/E Combination	
	Return Period [years]	TGUM/ML
Estimated quantile	1.00	2.901
	2.00	3.026
	5.00	3.165
	10.00	3.265
	20.00	3.362
	25.00	3.393
	50.00	3.489
	100.00	3.585
	200.00	3.680
	500.00	3.806
	1000.00	3.901
Average quantile	1.00	2.901
	2.00	3.027
	5.00	3.167
	10.00	3.268
	20.00	3.366
	25.00	3.397
	50.00	3.494
	100.00	3.590
	200.00	3.686
	500.00	3.813
	1000.00	3.909
Standard deviation	1.00	0.016
	2.00	0.020
	5.00	0.029
	10.00	0.036
	20.00	0.044
	25.00	0.046
	50.00	0.054
	100.00	0.062
	200.00	0.070
	500.00	0.081
	1000.00	0.089
Goodness-of-fit statistics	CHISQ	12.054
	SLSC	0.020
	PPCC1	0.995
	PPCC2	0.995

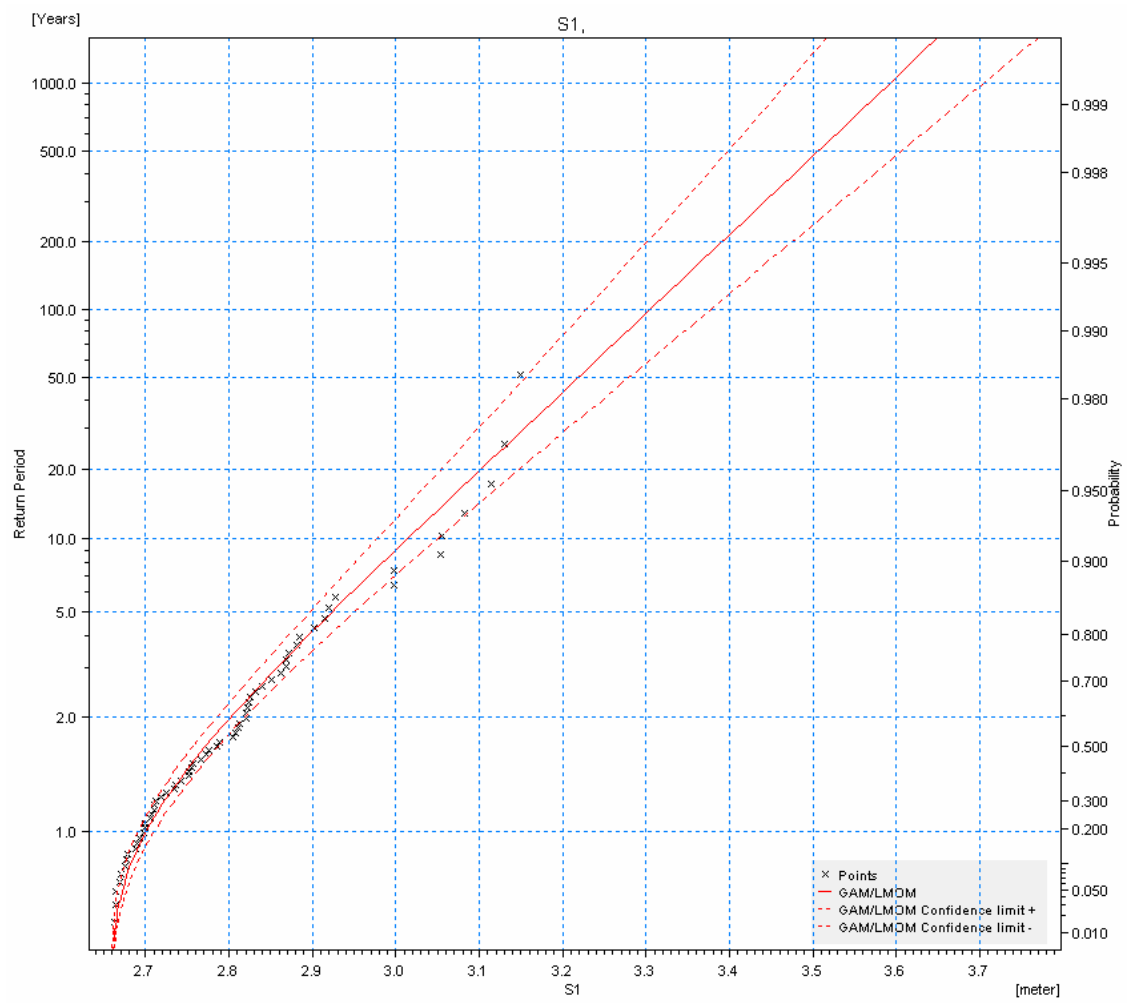


S1		
	D/E Combination	
	Return Period [years]	GAM/LMOM
Estimated quantile	2.00	2.802
	5.00	2.924
	10.00	3.014
	20.00	3.102
	50.00	3.218
	100.00	3.305
	200.00	3.392
	1000.00	3.592
Average quantile	2.00	2.802
	5.00	2.924
	10.00	3.014
	20.00	3.102
	50.00	3.217
	100.00	3.303
	200.00	3.389
	1000.00	3.587
Standard deviation	2.00	0.017
	5.00	0.027
	10.00	0.036
	20.00	0.047
	50.00	0.062
	100.00	0.075
	200.00	0.087
	1000.00	0.118
Goodness-of-fit statistics	SLSC	0.029
	PPCC1	0.991
	PPCC2	0.991

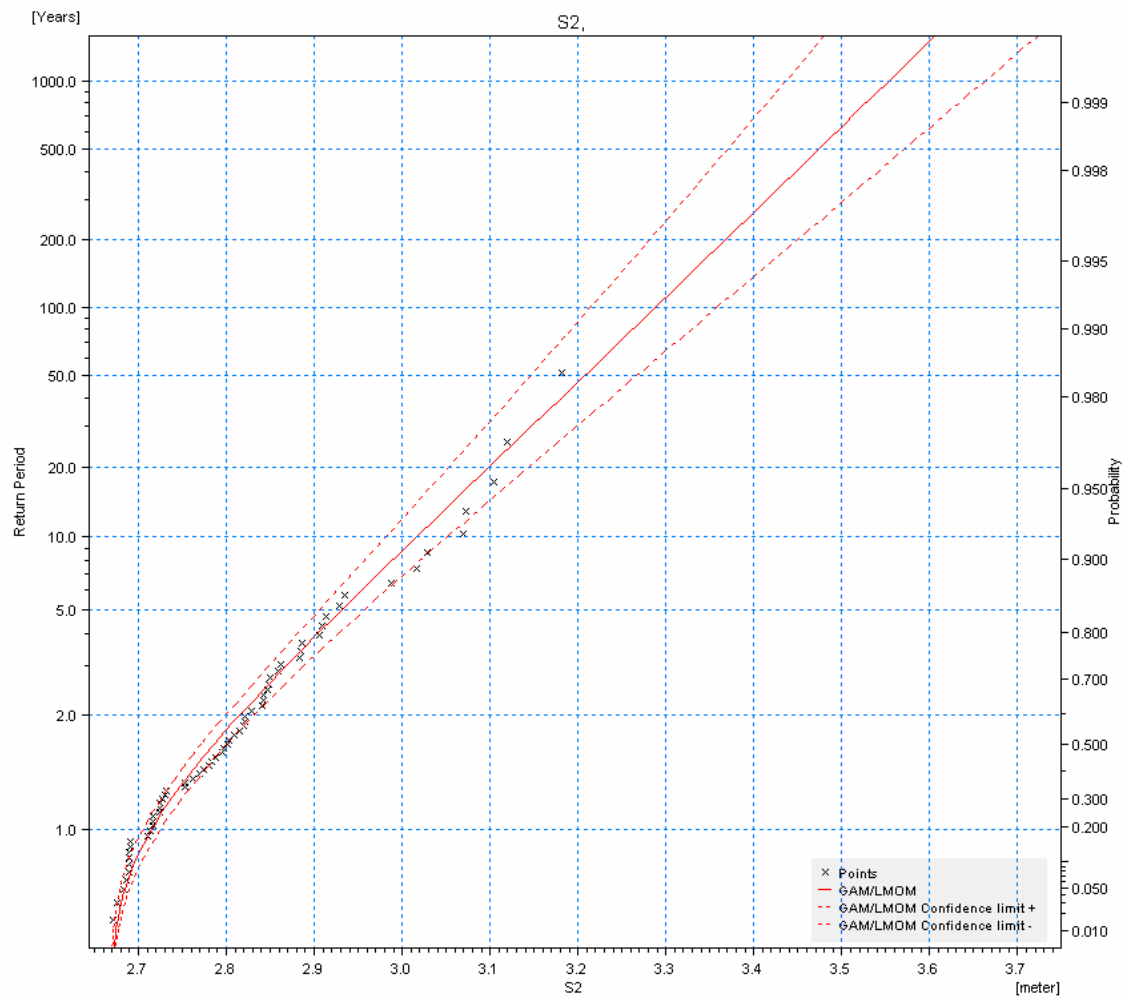


S2		
	D/E Combination	
	Return Period [years]	GAM/LMOM
Estimated quantile	2.00	2.815
	5.00	2.932
	10.00	3.016
	20.00	3.099
	50.00	3.207
	100.00	3.288
	200.00	3.368
	1000.00	3.553
Average quantile	2.00	2.815
	5.00	2.932
	10.00	3.016
	20.00	3.099
	50.00	3.206
	100.00	3.286
	200.00	3.366
	1000.00	3.549
Standard deviation	2.00	0.016
	5.00	0.026
	10.00	0.035
	20.00	0.045
	50.00	0.060
	100.00	0.072
	200.00	0.084
	1000.00	0.113
Goodness-of-fit statistics	SLSC	0.024
	PPCC1	0.994
	PPCC2	0.994

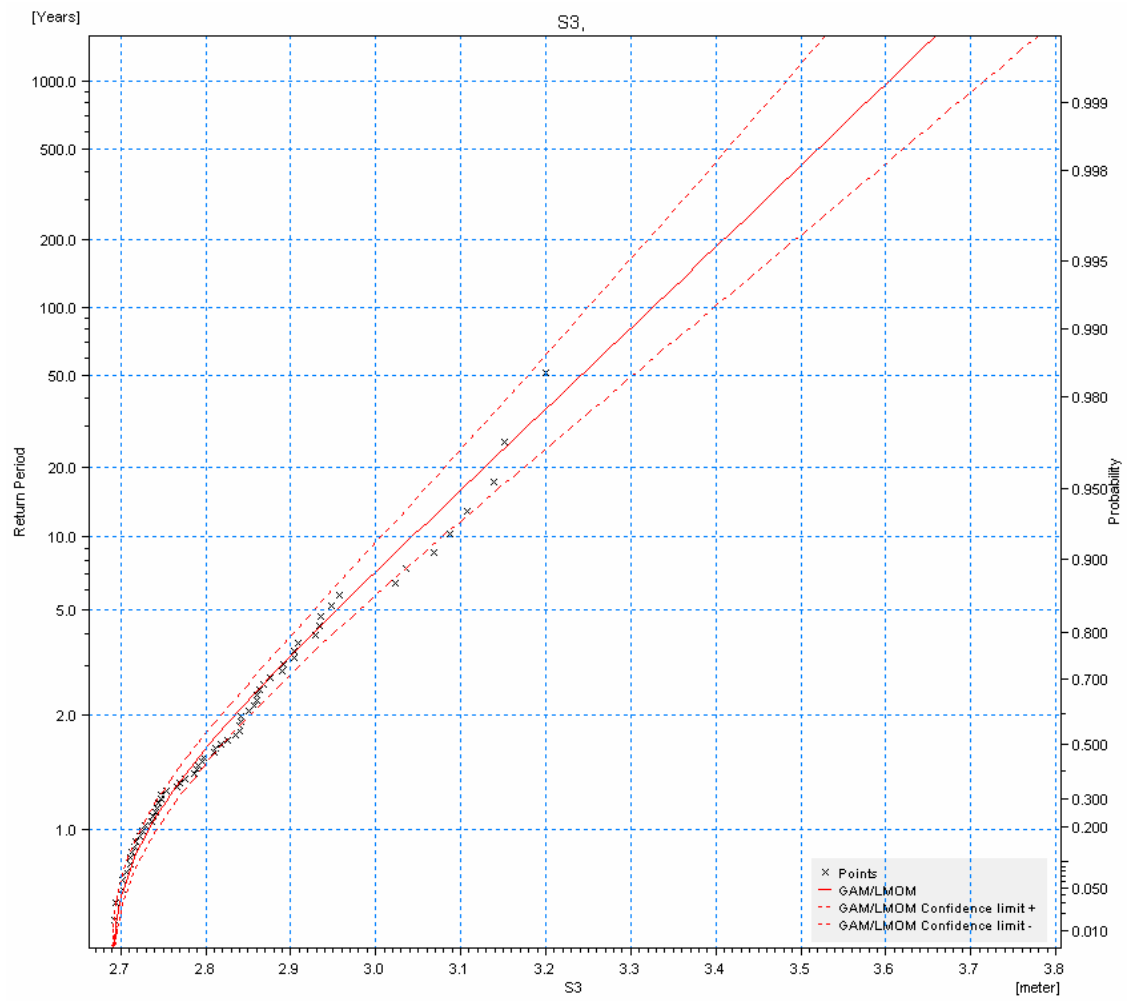


S3		
	D/E Combination	
	Return Period [years]	GAM/LMOM
Estimated quantile	2.00	2.834
	5.00	2.955
	10.00	3.042
	20.00	3.129
	50.00	3.241
	100.00	3.326
	200.00	3.410
	1000.00	3.603
Average quantile	2.00	2.835
	5.00	2.955
	10.00	3.042
	20.00	3.128
	50.00	3.240
	100.00	3.324
	200.00	3.407
	1000.00	3.599
Standard deviation	2.00	0.017
	5.00	0.026
	10.00	0.036
	20.00	0.047
	50.00	0.062
	100.00	0.074
	200.00	0.087
	1000.00	0.116
Goodness-of-fit statistics	SLSC	0.025
	PPCC1	0.993
	PPCC2	0.993

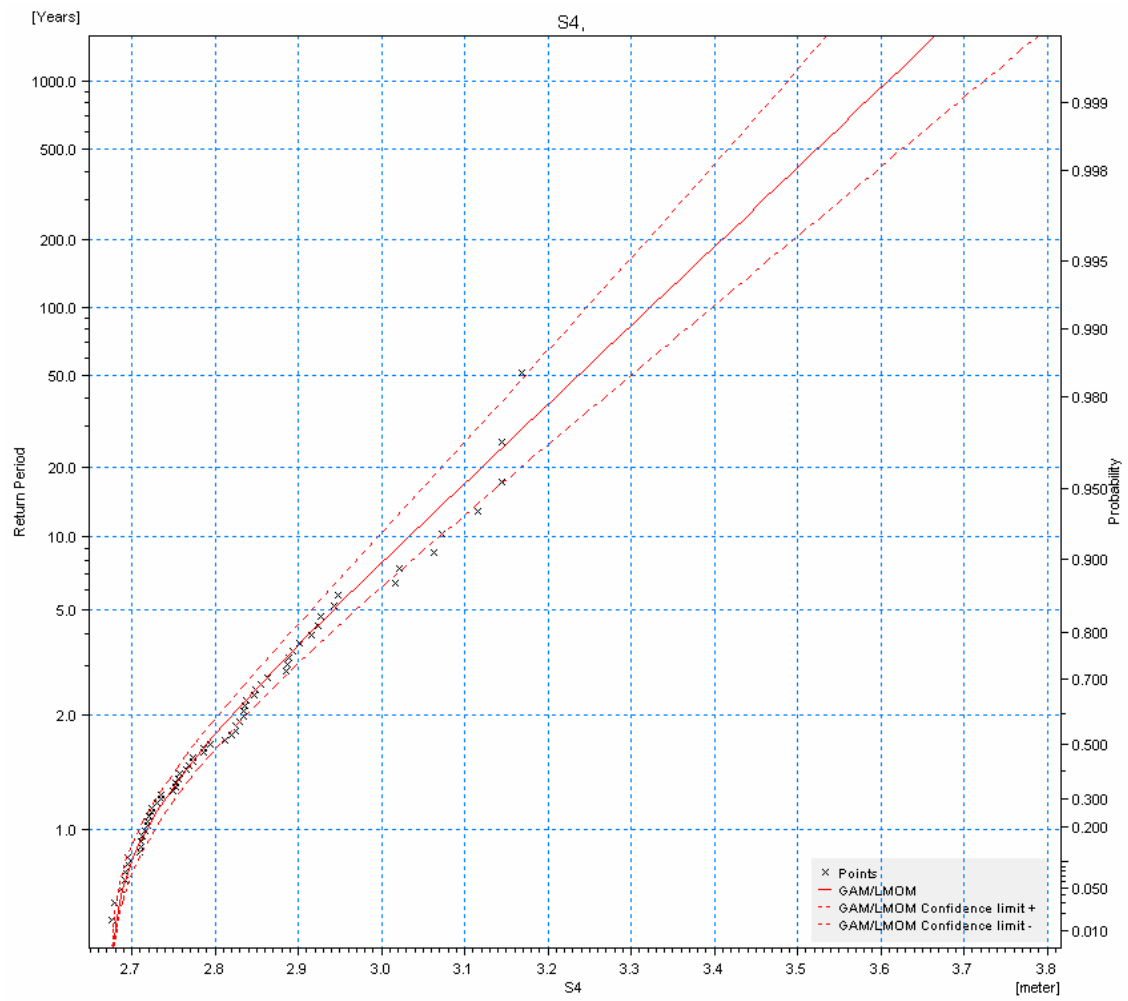


S4		
	D/E Combination	
	Return Period [years]	GAM/LMOM
Estimated quantile	2.00	2.820
	5.00	2.942
	10.00	3.032
	20.00	3.121
	50.00	3.236
	100.00	3.323
	200.00	3.409
	1000.00	3.608
Average quantile	2.00	2.820
	5.00	2.943
	10.00	3.032
	20.00	3.120
	50.00	3.235
	100.00	3.322
	200.00	3.408
	1000.00	3.606
Standard deviation	2.00	0.017
	5.00	0.027
	10.00	0.037
	20.00	0.048
	50.00	0.063
	100.00	0.075
	200.00	0.088
	1000.00	0.118
Goodness-of-fit statistics	SLSC	0.028
	PPCC1	0.991
	PPCC2	0.991

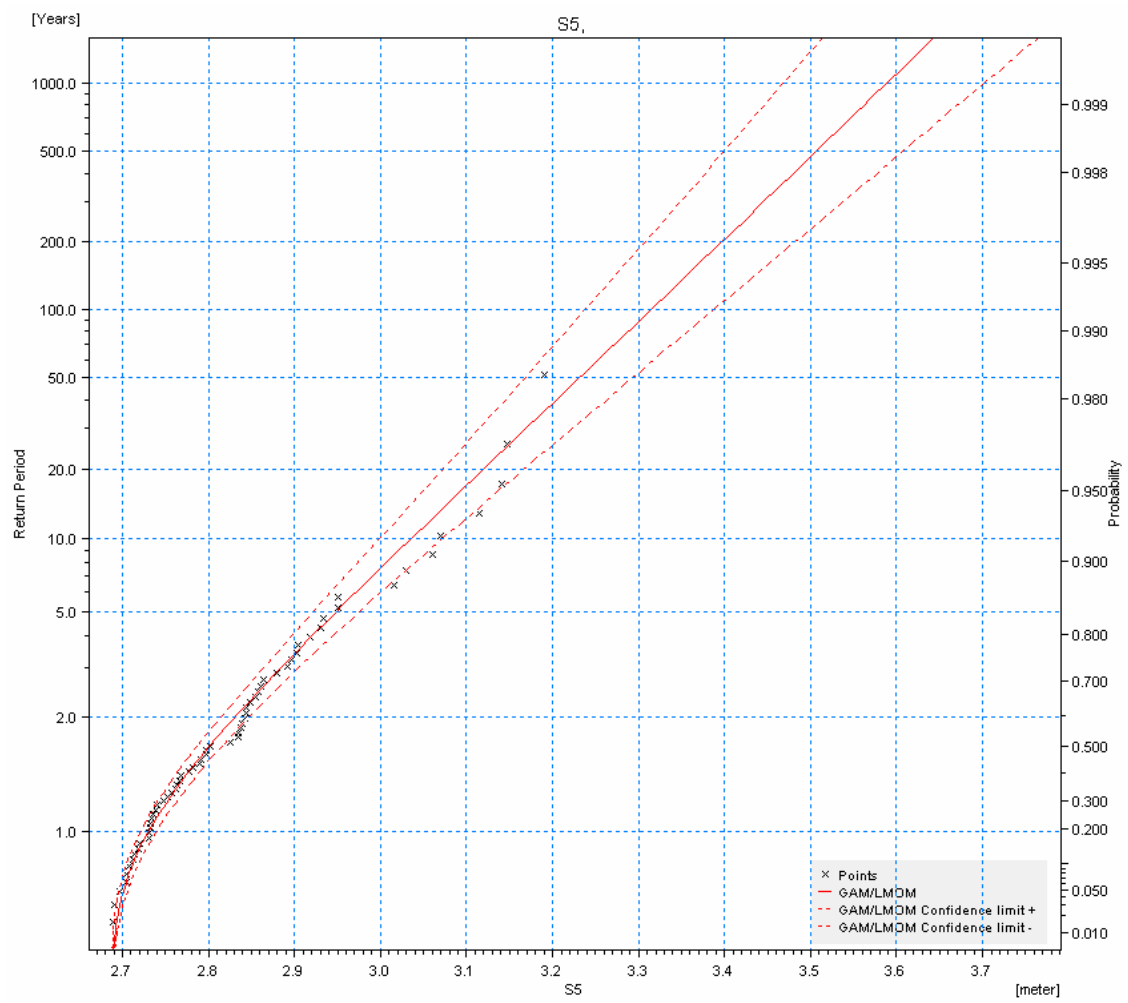


S5		
	D/E Combination	
	Return Period [years]	GAM/LMOM
Estimated quantile	2.00	2.830
	5.00	2.949
	10.00	3.035
	20.00	3.120
	50.00	3.231
	100.00	3.315
	200.00	3.398
	1000.00	3.589
Average quantile	2.00	2.830
	5.00	2.949
	10.00	3.035
	20.00	3.120
	50.00	3.230
	100.00	3.313
	200.00	3.395
	1000.00	3.585
Standard deviation	2.00	0.016
	5.00	0.027
	10.00	0.036
	20.00	0.047
	50.00	0.063
	100.00	0.075
	200.00	0.087
	1000.00	0.117
Goodness-of-fit statistics	SLSC	0.025
	PPCC1	0.993
	PPCC2	0.993

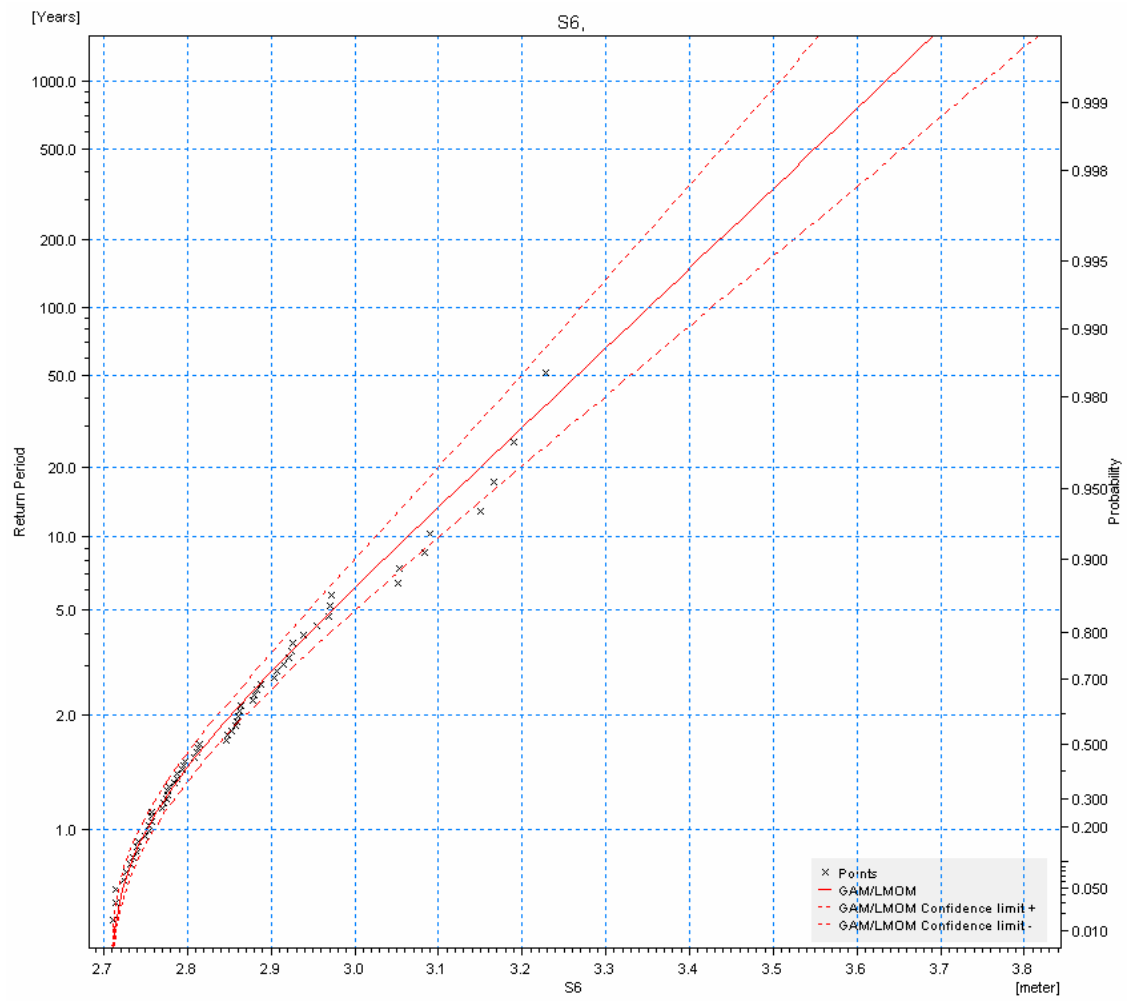


S6		
	D/E Combination	
	Return Period [years]	GAM/LMOM
Estimated quantile	2.00	2.852
	5.00	2.973
	10.00	3.063
	20.00	3.150
	50.00	3.265
	100.00	3.351
	200.00	3.437
	1000.00	3.634
Average quantile	2.00	2.852
	5.00	2.974
	10.00	3.062
	20.00	3.150
	50.00	3.263
	100.00	3.349
	200.00	3.434
	1000.00	3.630
Standard deviation	2.00	0.017
	5.00	0.028
	10.00	0.038
	20.00	0.049
	50.00	0.065
	100.00	0.078
	200.00	0.091
	1000.00	0.122
Goodness-of-fit statistics	SLSC	0.024
	PPCC1	0.994
	PPCC2	0.994

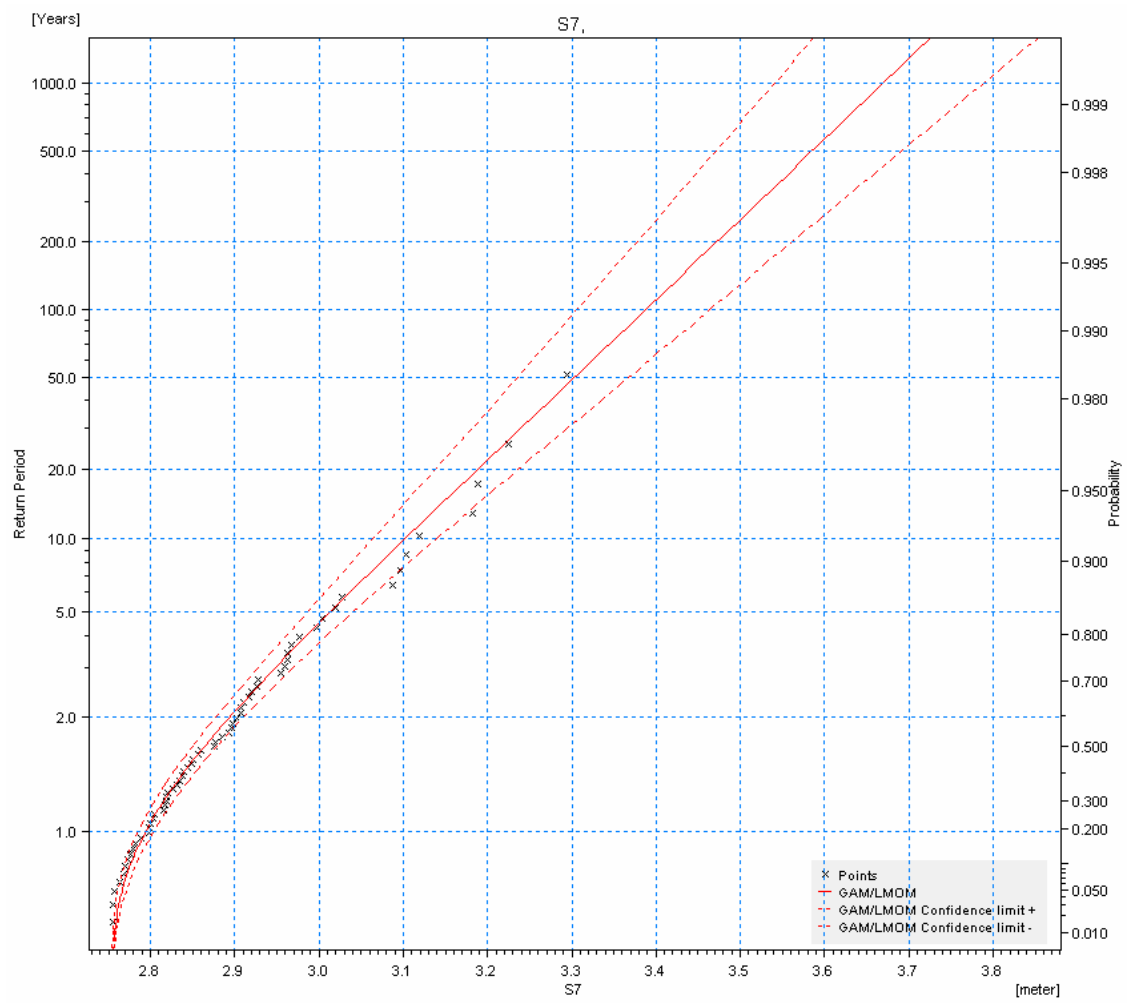


S7		
	D/E Combination	
	Return Period [years]	GAM/LMOM
Estimated quantile	2.00	2.893
	5.00	3.013
	10.00	3.102
	20.00	3.189
	50.00	3.302
	100.00	3.388
	200.00	3.473
	1000.00	3.669
Average quantile	2.00	2.894
	5.00	3.014
	10.00	3.101
	20.00	3.188
	50.00	3.301
	100.00	3.386
	200.00	3.470
	1000.00	3.665
Standard deviation	2.00	0.016
	5.00	0.027
	10.00	0.038
	20.00	0.049
	50.00	0.066
	100.00	0.079
	200.00	0.092
	1000.00	0.124
Goodness-of-fit statistics	SLSC	0.019
	PPCC1	0.997
	PPCC2	0.997

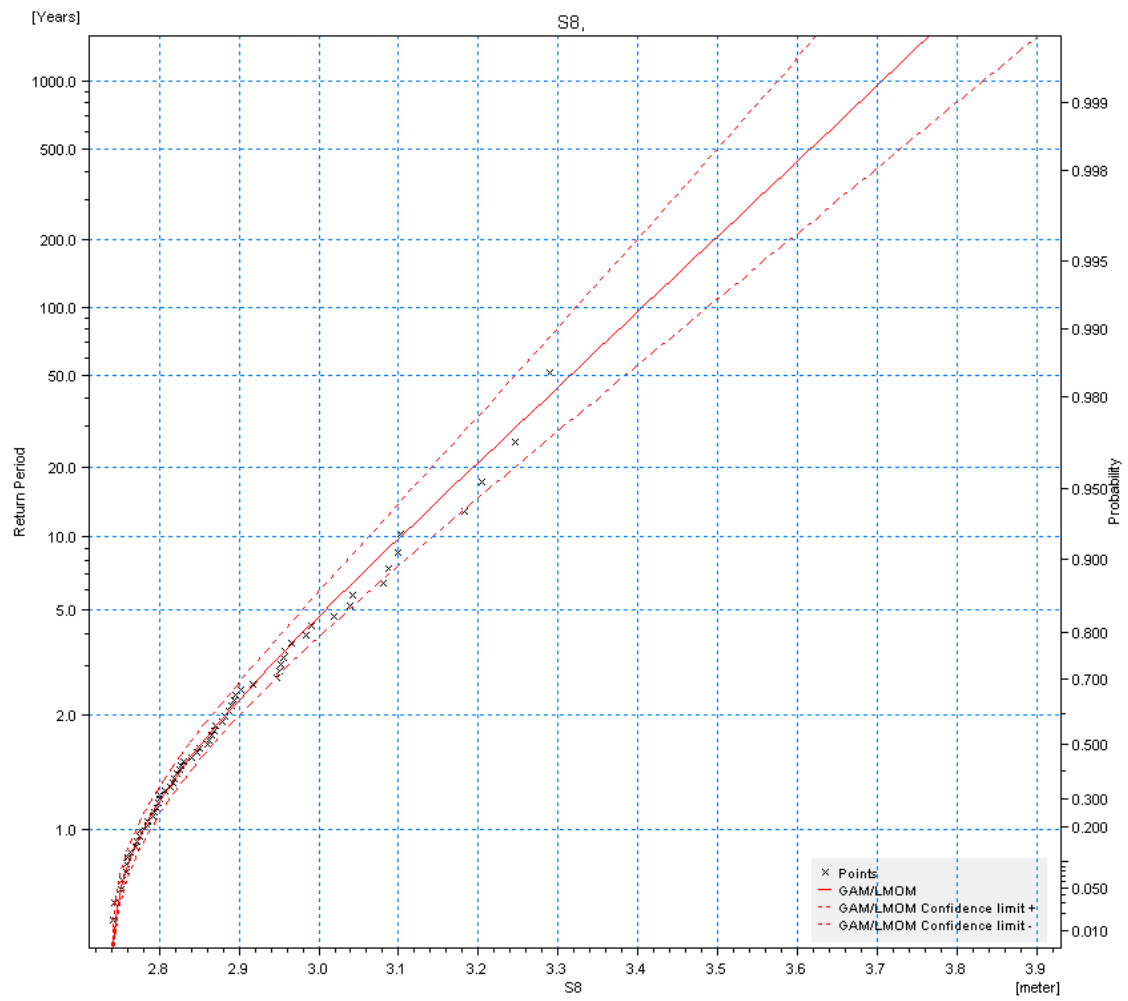


S8		
	D/E Combination	
	Return Period [years]	GAM/LMOM
Estimated quantile	2.00	2.882
	5.00	3.009
	10.00	3.102
	20.00	3.194
	50.00	3.315
	100.00	3.406
	200.00	3.497
	1000.00	3.706
Average quantile	2.00	2.883
	5.00	3.009
	10.00	3.102
	20.00	3.194
	50.00	3.314
	100.00	3.405
	200.00	3.495
	1000.00	3.703
Standard deviation	2.00	0.017
	5.00	0.029
	10.00	0.040
	20.00	0.052
	50.00	0.069
	100.00	0.082
	200.00	0.096
	1000.00	0.129
Goodness-of-fit statistics	SLSC	0.020
	PPCC1	0.997
	PPCC2	0.997

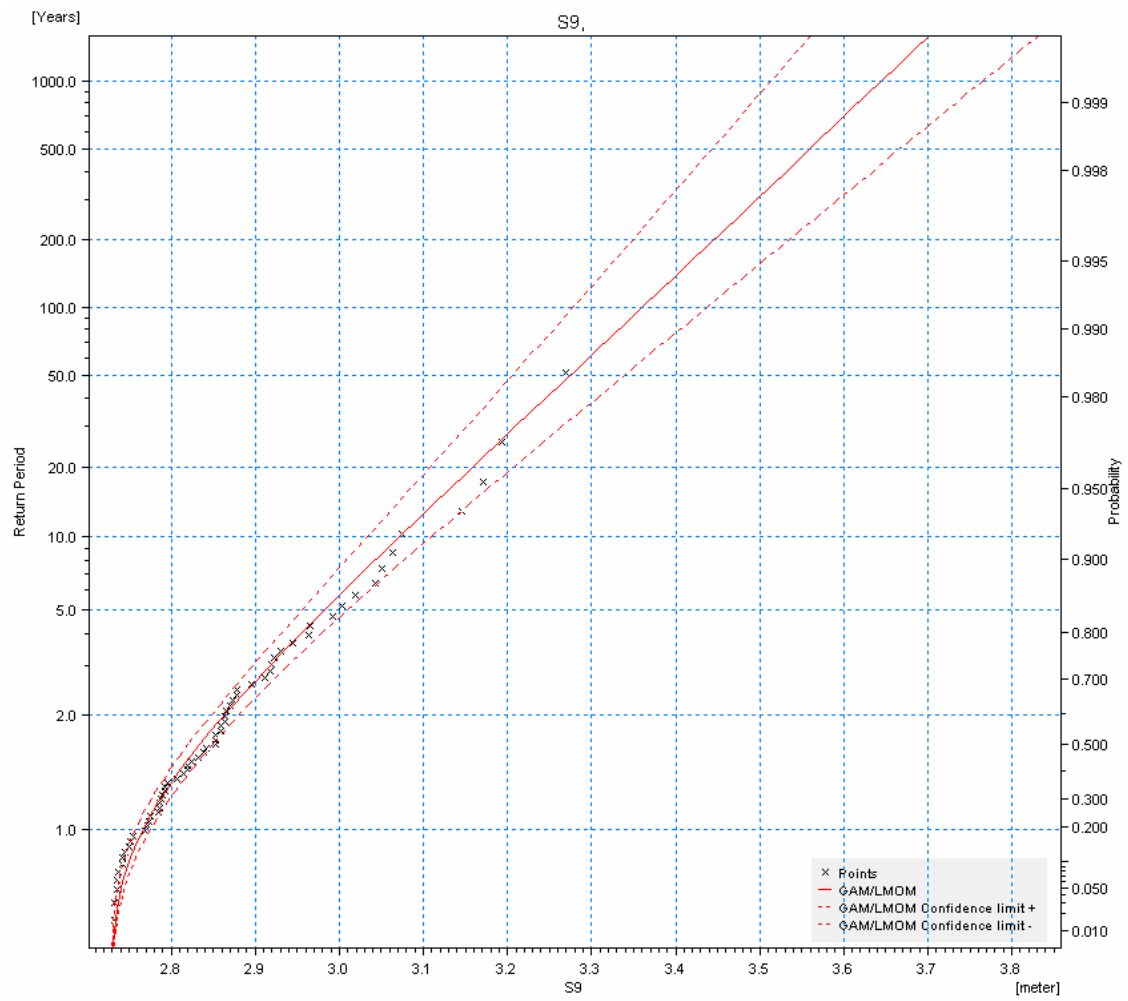


S9		
	D/E Combination	
	Return Period [years]	GAM/LMOM
Estimated quantile	2.00	2.863
	5.00	2.983
	10.00	3.071
	20.00	3.159
	50.00	3.274
	100.00	3.360
	200.00	3.446
	1000.00	3.645
Average quantile	2.00	2.864
	5.00	2.983
	10.00	3.071
	20.00	3.158
	50.00	3.272
	100.00	3.357
	200.00	3.442
	1000.00	3.639
Standard deviation	2.00	0.016
	5.00	0.027
	10.00	0.038
	20.00	0.050
	50.00	0.066
	100.00	0.080
	200.00	0.093
	1000.00	0.126
Goodness-of-fit statistics	SLSC	0.018
	PPCC1	0.997
	PPCC2	0.997

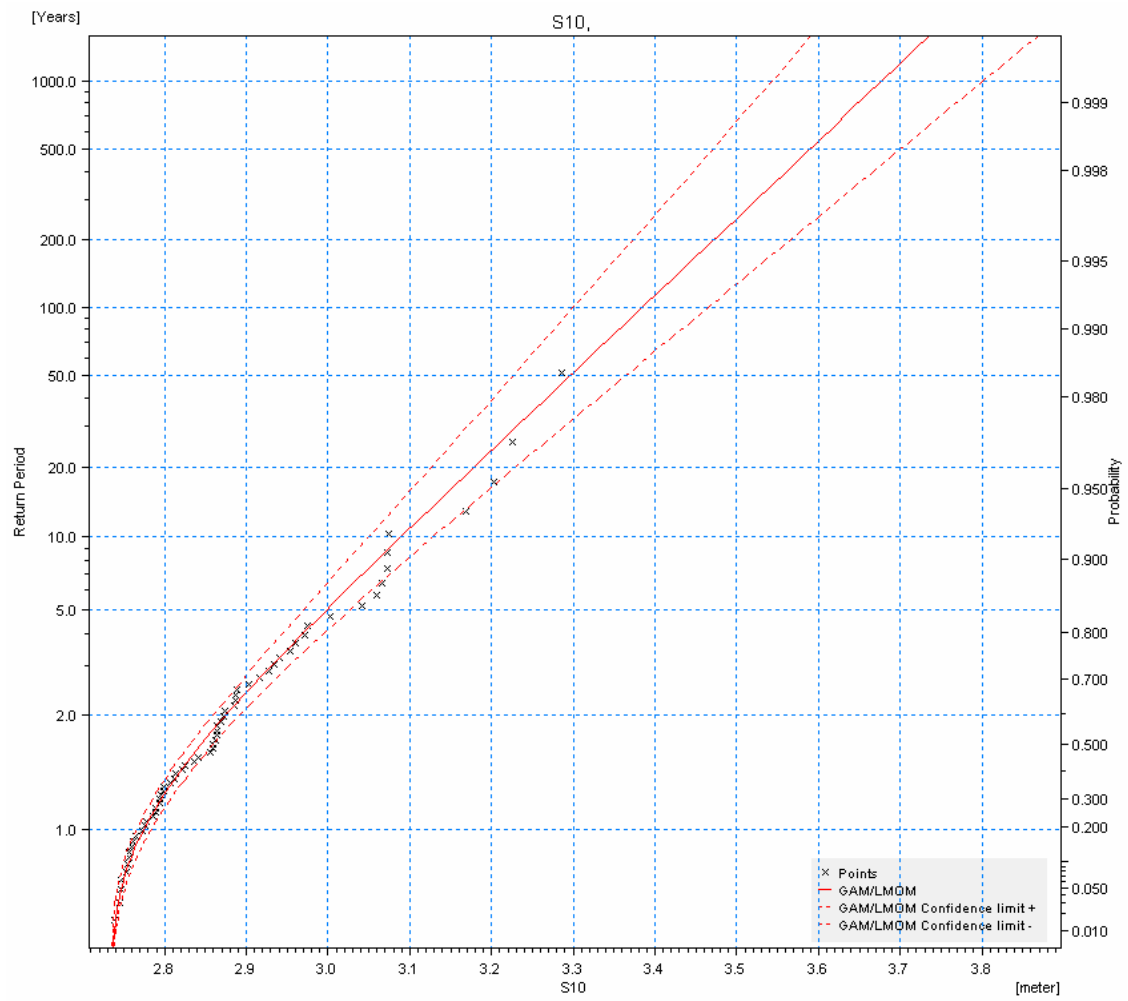


S10		
	D/E Combination	
	Return Period [years]	GAM/LMOM
Estimated quantile	2.00	2.875
	5.00	2.998
	10.00	3.089
	20.00	3.179
	50.00	3.297
	100.00	3.385
	200.00	3.473
	1000.00	3.677
Average quantile	2.00	2.875
	5.00	2.998
	10.00	3.089
	20.00	3.178
	50.00	3.295
	100.00	3.383
	200.00	3.470
	1000.00	3.672
Standard deviation	2.00	0.017
	5.00	0.028
	10.00	0.039
	20.00	0.052
	50.00	0.069
	100.00	0.082
	200.00	0.096
	1000.00	0.129
Goodness-of-fit statistics	SLSC	0.023
	PPCC1	0.995
	PPCC2	0.995

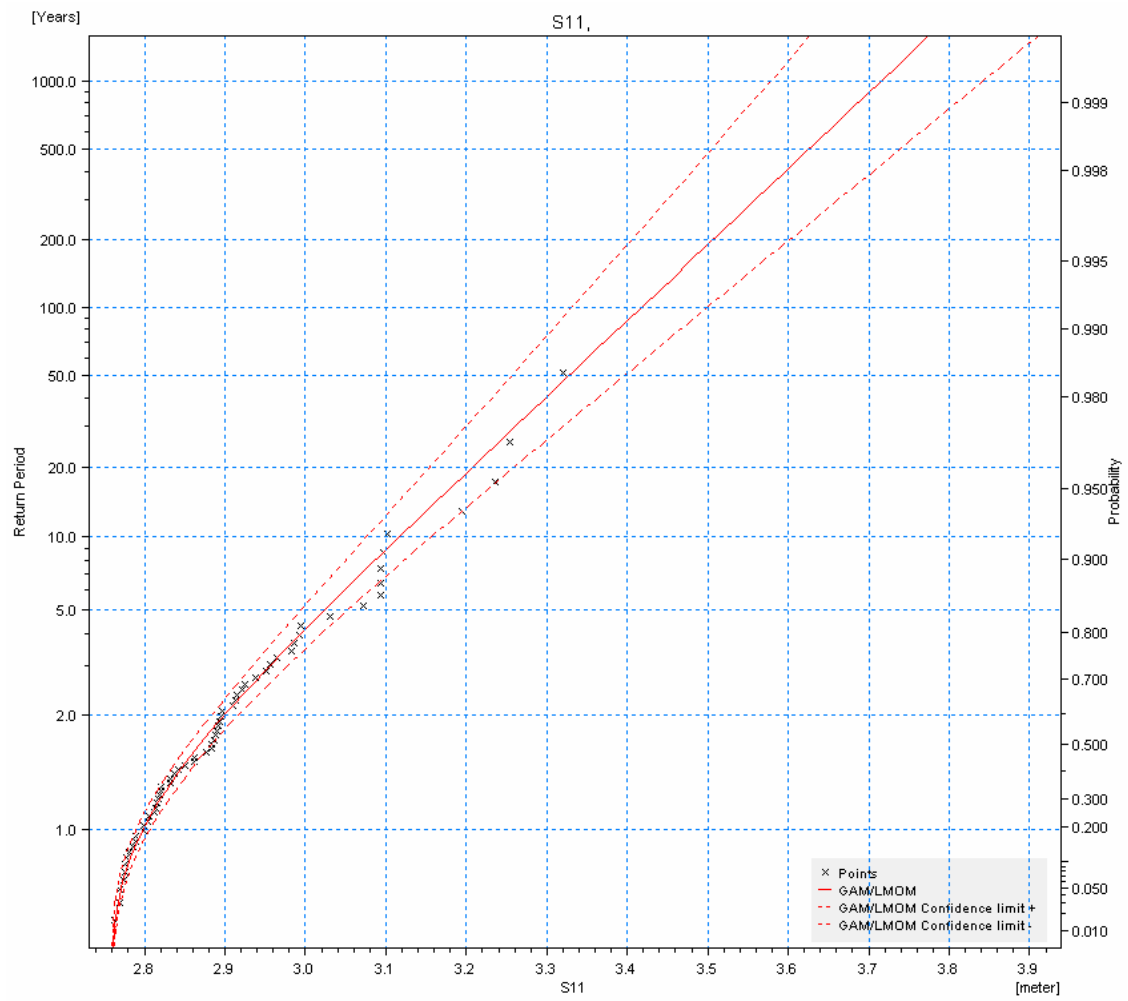


S11		
	D/E Combination	
	Return Period [years]	GAM/LMOM
Estimated quantile	2.00	2.899
	5.00	3.024
	10.00	3.116
	20.00	3.208
	50.00	3.328
	100.00	3.418
	200.00	3.508
	1000.00	3.715
Average quantile	2.00	2.900
	5.00	3.024
	10.00	3.116
	20.00	3.207
	50.00	3.326
	100.00	3.415
	200.00	3.504
	1000.00	3.710
Standard deviation	2.00	0.017
	5.00	0.029
	10.00	0.040
	20.00	0.053
	50.00	0.070
	100.00	0.084
	200.00	0.098
	1000.00	0.132
Goodness-of-fit statistics	SLSC	0.023
	PPCC1	0.995
	PPCC2	0.995

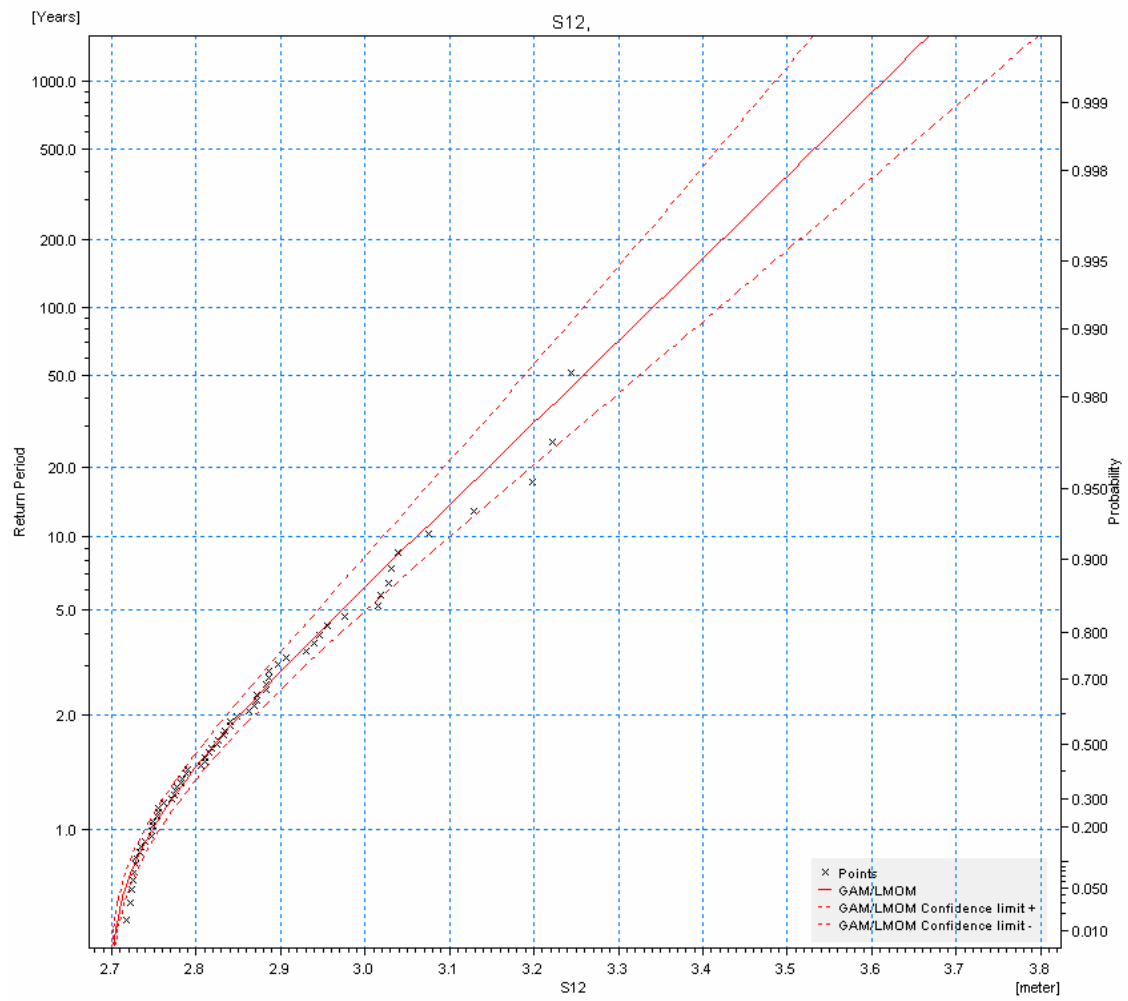


S12		
		D/E Combination
	Return Period [years]	GAM/LMOM
Estimated quantile	2.00	2.852
	5.00	2.973
	10.00	3.060
	20.00	3.146
	50.00	3.257
	100.00	3.341
	200.00	3.423
	1000.00	3.614
Average quantile	2.00	2.852
	5.00	2.973
	10.00	3.060
	20.00	3.145
	50.00	3.256
	100.00	3.339
	200.00	3.421
	1000.00	3.610
Standard deviation	2.00	0.016
	5.00	0.029
	10.00	0.040
	20.00	0.051
	50.00	0.068
	100.00	0.081
	200.00	0.094
	1000.00	0.124
Goodness-of-fit statistics	SLSC	0.024
	PPCC1	0.995
	PPCC2	0.995

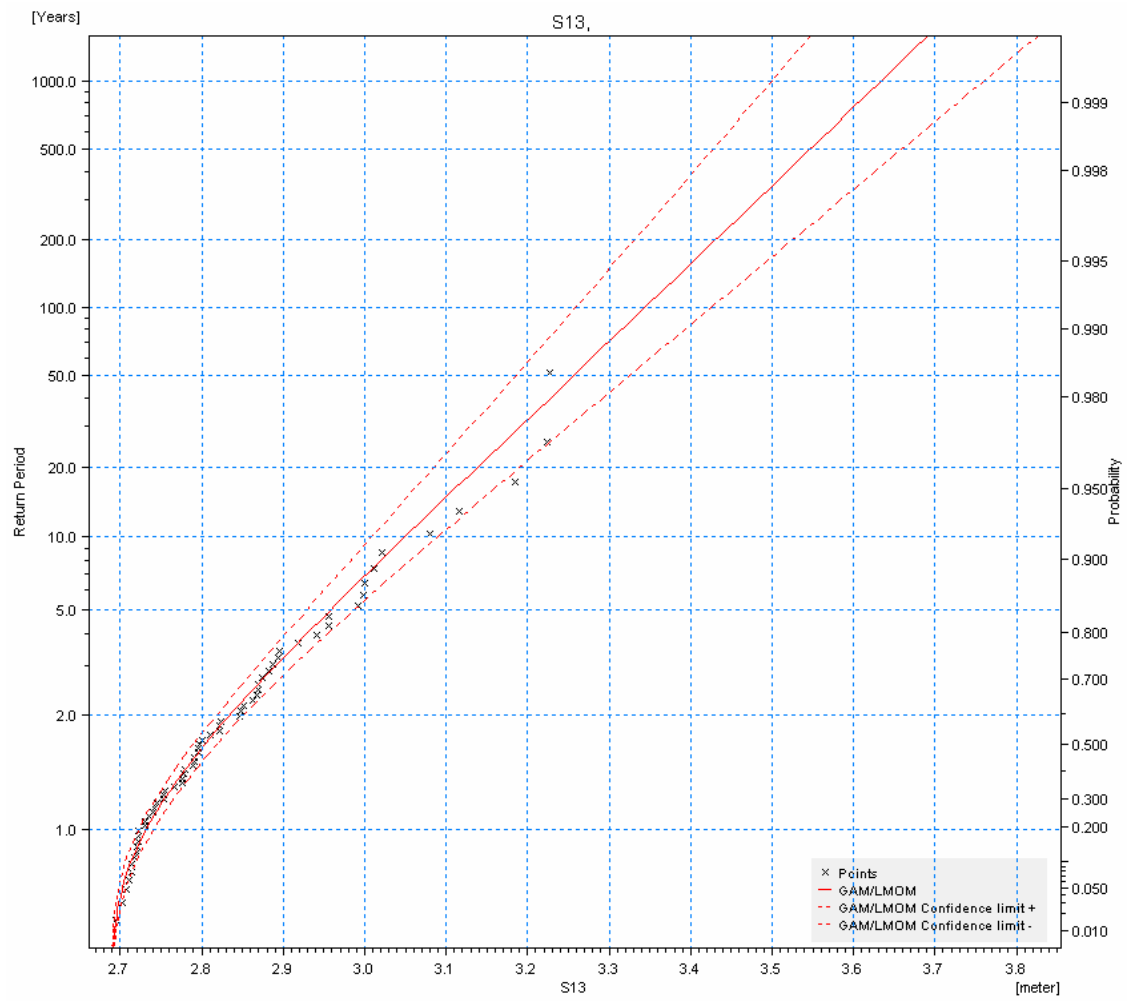


S13		
		D/E Combination
	Return Period [years]	GAM/LMOM
Estimated quantile	2.00	2.834
	5.00	2.958
	10.00	3.049
	20.00	3.139
	50.00	3.256
	100.00	3.344
	200.00	3.431
	1000.00	3.634
Average quantile	2.00	2.834
	5.00	2.958
	10.00	3.049
	20.00	3.138
	50.00	3.255
	100.00	3.342
	200.00	3.429
	1000.00	3.629
Standard deviation	2.00	0.017
	5.00	0.029
	10.00	0.040
	20.00	0.053
	50.00	0.070
	100.00	0.083
	200.00	0.097
	1000.00	0.130
Goodness-of-fit statistics	SLSC	0.023
	PPCC1	0.995
	PPCC2	0.995

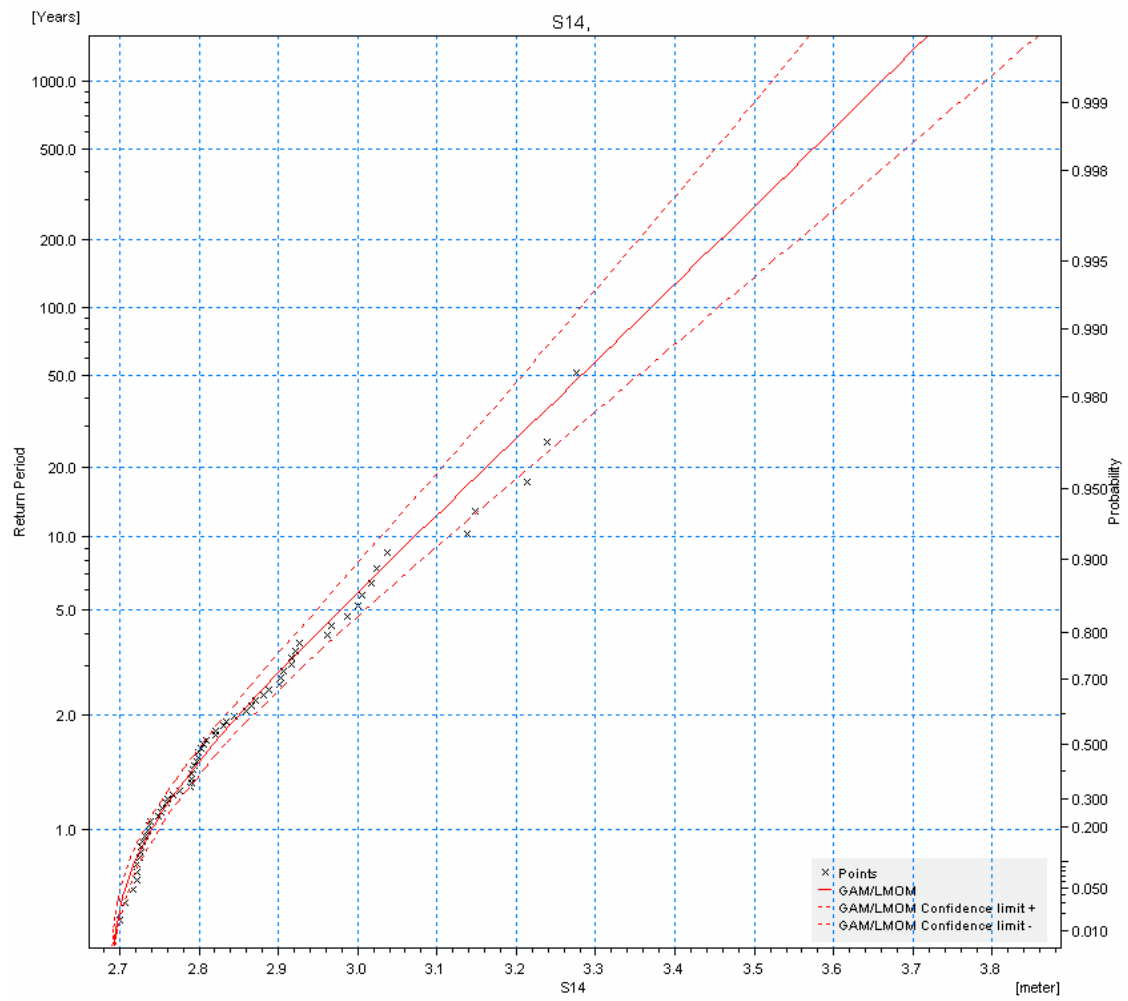


S14		
	D/E Combination	
	Return Period [years]	GAM/LMOM
Estimated quantile	2.00	2.850
	5.00	2.979
	10.00	3.072
	20.00	3.163
	50.00	3.281
	100.00	3.370
	200.00	3.458
	1000.00	3.661
Average quantile	2.00	2.851
	5.00	2.979
	10.00	3.071
	20.00	3.162
	50.00	3.280
	100.00	3.368
	200.00	3.455
	1000.00	3.656
Standard deviation	2.00	0.017
	5.00	0.031
	10.00	0.043
	20.00	0.055
	50.00	0.073
	100.00	0.087
	200.00	0.101
	1000.00	0.134
Goodness-of-fit statistics	SLSC	0.025
	PPCC1	0.995
	PPCC2	0.995

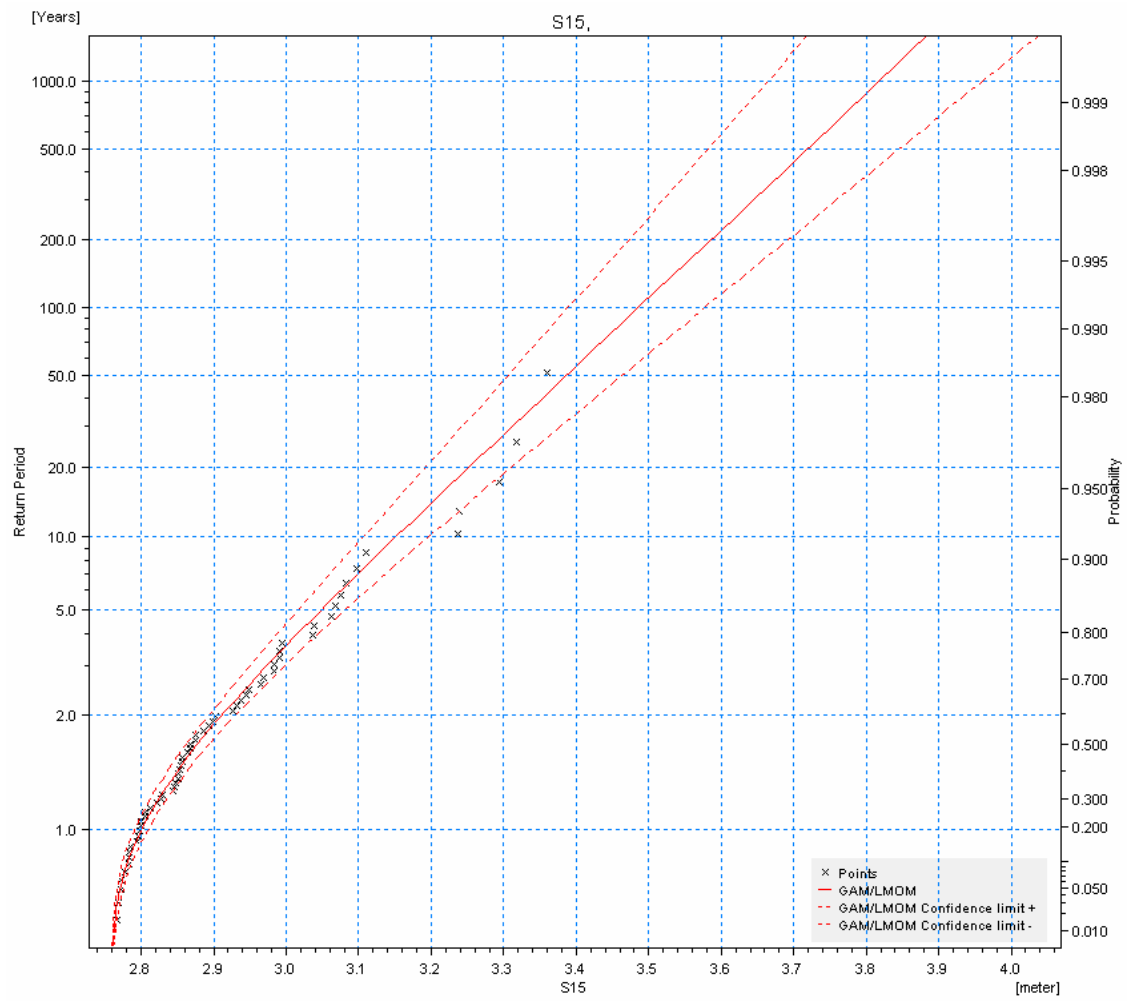


S15		
	D/E Combination	
	Return Period [years]	GAM/LMOM
Estimated quantile	2.00	2.911
	5.00	3.049
	10.00	3.151
	20.00	3.253
	50.00	3.386
	100.00	3.486
	200.00	3.586
	1000.00	3.818
Average quantile	2.00	2.911
	5.00	3.049
	10.00	3.151
	20.00	3.252
	50.00	3.384
	100.00	3.484
	200.00	3.583
	1000.00	3.812
Standard deviation	2.00	0.018
	5.00	0.032
	10.00	0.045
	20.00	0.059
	50.00	0.079
	100.00	0.094
	200.00	0.110
	1000.00	0.148
Goodness-of-fit statistics	SLSC	0.025
	PPCC1	0.994
	PPCC2	0.994

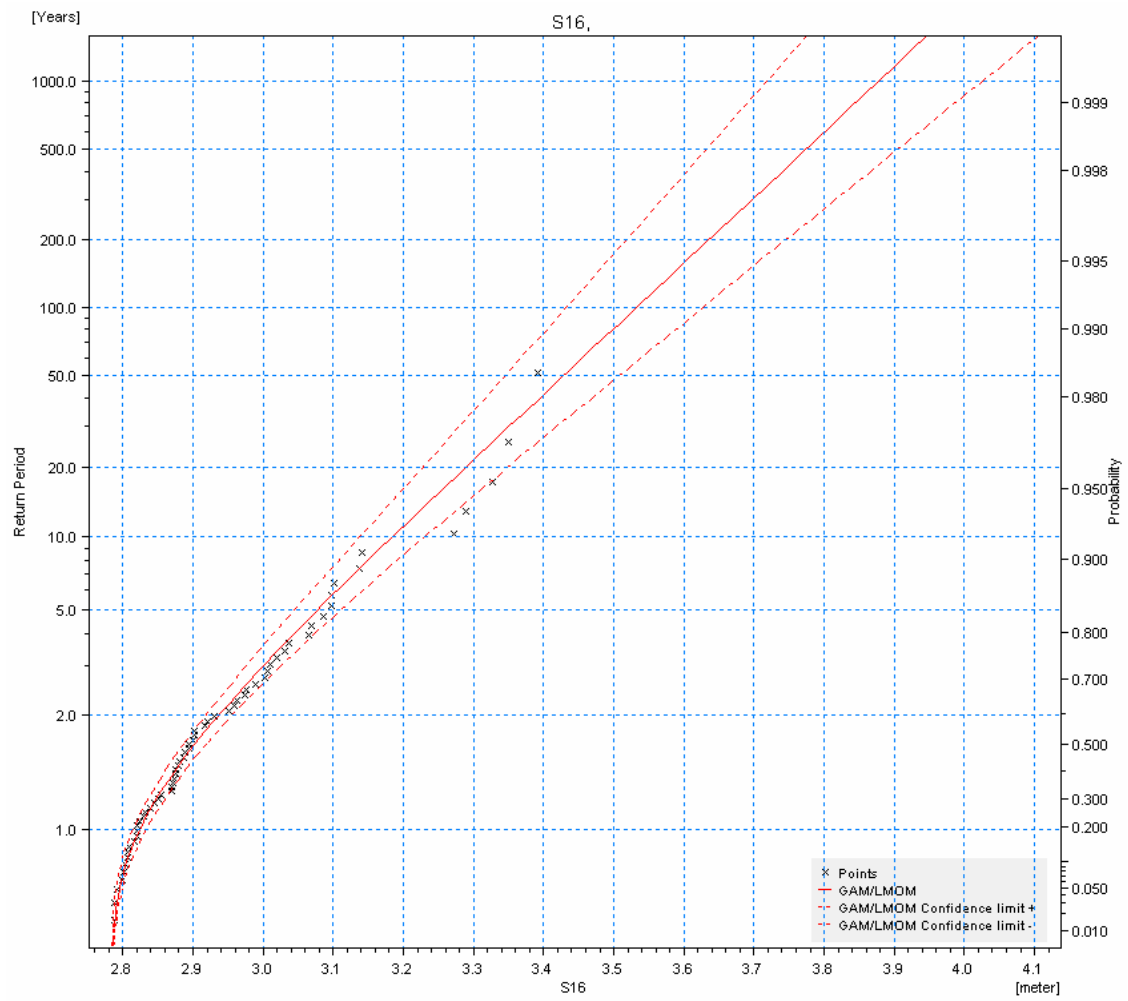


S16		
	D/E Combination	
	Return Period [years]	GAM/LMOM
Estimated quantile	2.00	2.936
	5.00	3.078
	10.00	3.184
	20.00	3.290
	50.00	3.428
	100.00	3.532
	200.00	3.637
	1000.00	3.878
Average quantile	2.00	2.937
	5.00	3.079
	10.00	3.184
	20.00	3.289
	50.00	3.426
	100.00	3.530
	200.00	3.633
	1000.00	3.872
Standard deviation	2.00	0.019
	5.00	0.033
	10.00	0.046
	20.00	0.061
	50.00	0.081
	100.00	0.097
	200.00	0.114
	1000.00	0.153
Goodness-of-fit statistics	SLSC	0.026
	PPCC1	0.993
	PPCC2	0.993

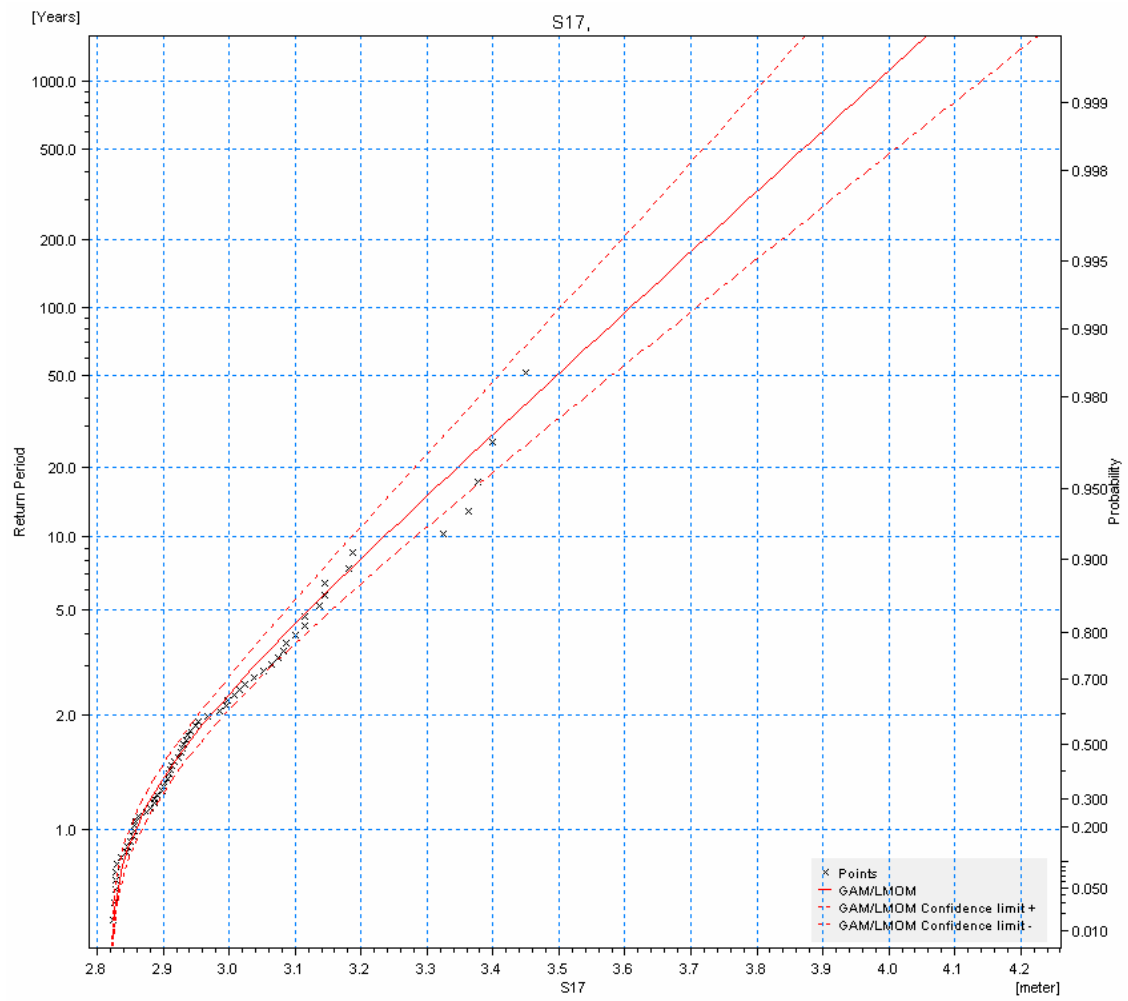


S17		
	D/E Combination	
	Return Period [years]	GAM/LMOM
Estimated quantile	2.00	2.972
	5.00	3.121
	10.00	3.234
	20.00	3.347
	50.00	3.496
	100.00	3.608
	200.00	3.721
	1000.00	3.982
Average quantile	2.00	2.972
	5.00	3.122
	10.00	3.234
	20.00	3.346
	50.00	3.493
	100.00	3.605
	200.00	3.717
	1000.00	3.975
Standard deviation	2.00	0.020
	5.00	0.034
	10.00	0.048
	20.00	0.064
	50.00	0.086
	100.00	0.103
	200.00	0.121
	1000.00	0.164
Goodness-of-fit statistics	SLSC	0.027
	PPCC1	0.992
	PPCC2	0.992

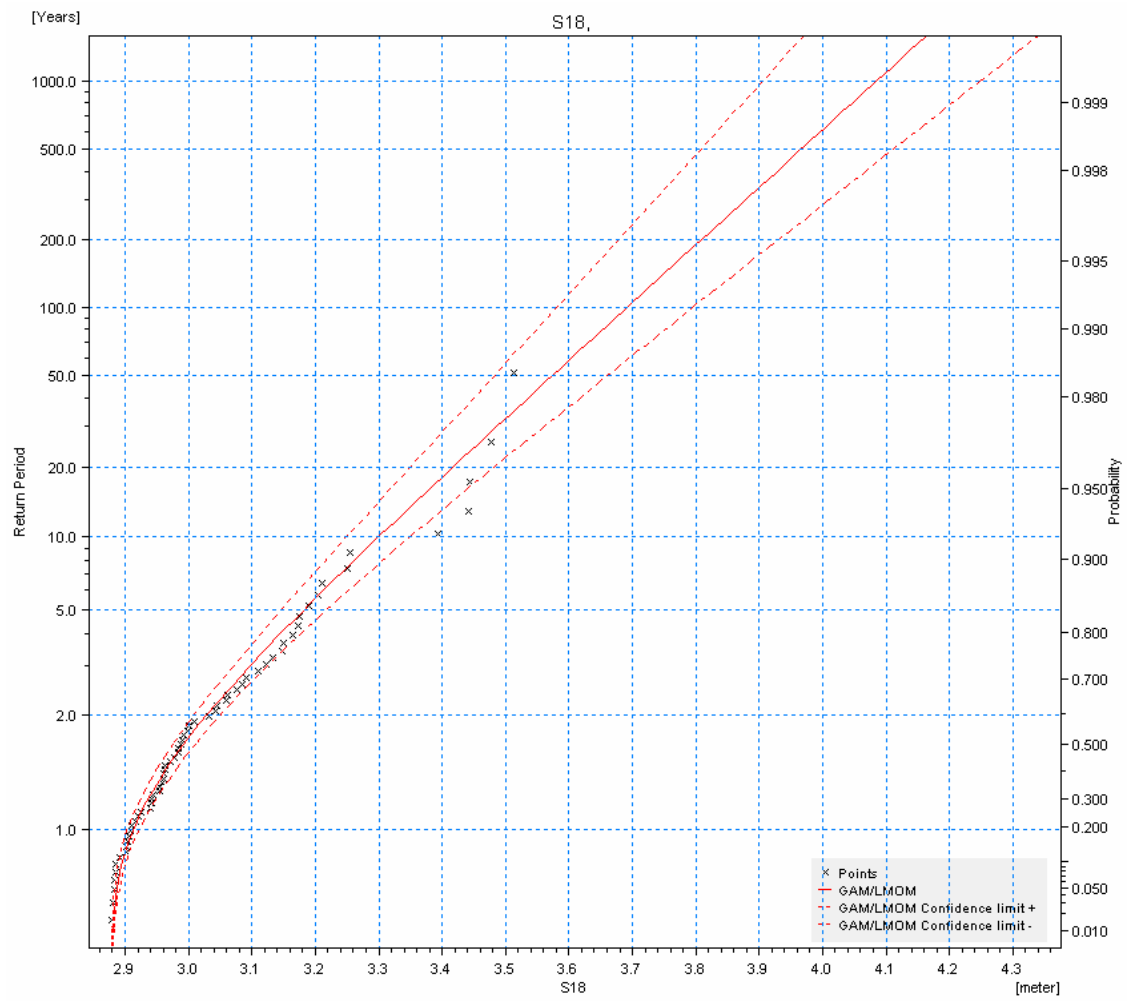


S18		
		D/E Combination
	Return Period [years]	GAM/LMOM
Estimated quantile	2.00	3.028
	5.00	3.182
	10.00	3.300
	20.00	3.417
	50.00	3.573
	100.00	3.691
	200.00	3.810
	1000.00	4.084
Average quantile	2.00	3.029
	5.00	3.183
	10.00	3.299
	20.00	3.416
	50.00	3.571
	100.00	3.688
	200.00	3.805
	1000.00	4.077
Standard deviation	2.00	0.020
	5.00	0.036
	10.00	0.050
	20.00	0.066
	50.00	0.089
	100.00	0.108
	200.00	0.126
	1000.00	0.172
Goodness-of-fit statistics	SLSC	0.029
	PPCC1	0.991
	PPCC2	0.991

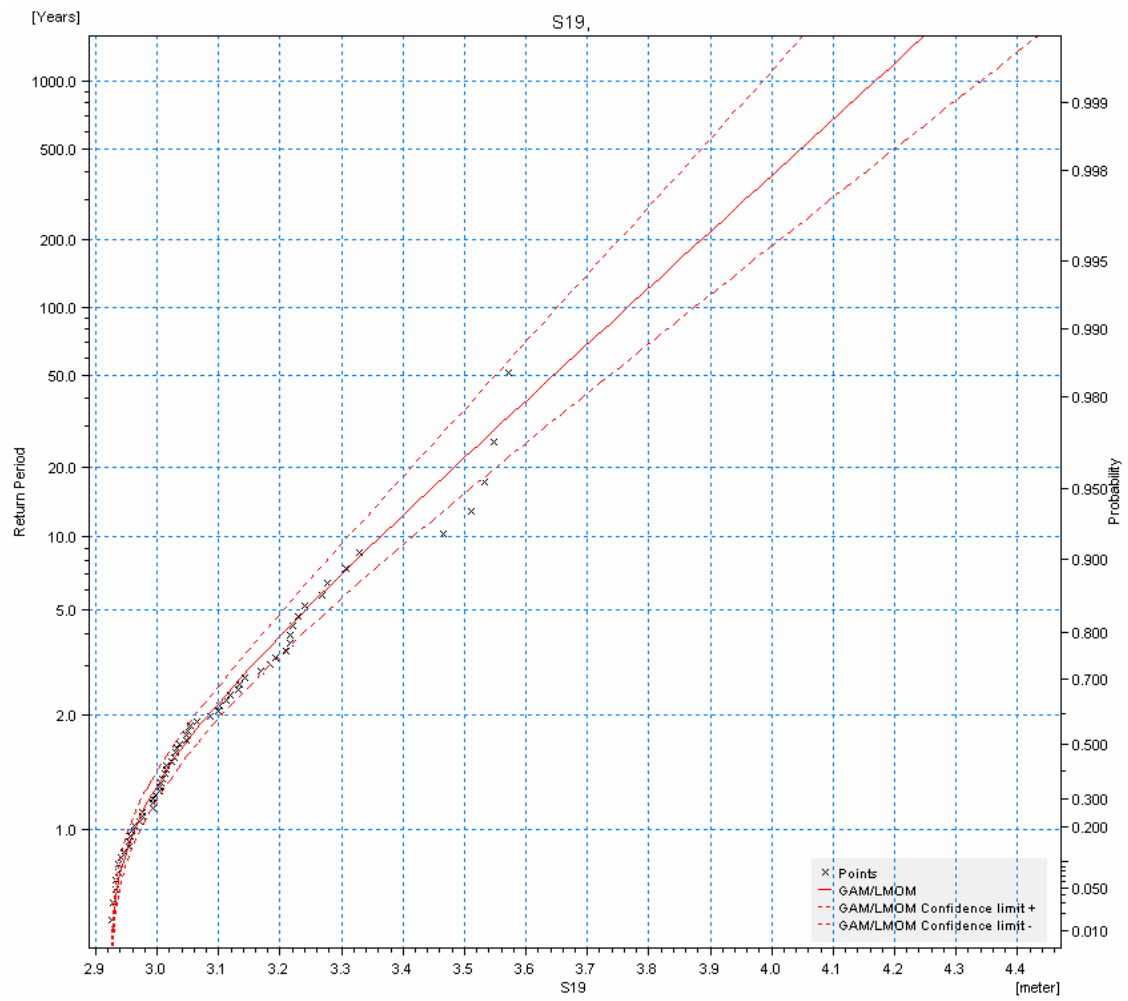


S19		
	D/E Combination	
	Return Period [years]	GAM/LMOM
Estimated quantile	2.00	3.083
	5.00	3.242
	10.00	3.363
	20.00	3.484
	50.00	3.644
	100.00	3.765
	200.00	3.886
	1000.00	4.168
Average quantile	2.00	3.083
	5.00	3.242
	10.00	3.363
	20.00	3.483
	50.00	3.642
	100.00	3.763
	200.00	3.883
	1000.00	4.162
Standard deviation	2.00	0.021
	5.00	0.037
	10.00	0.052
	20.00	0.069
	50.00	0.093
	100.00	0.112
	200.00	0.131
	1000.00	0.177
Goodness-of-fit statistics	SLSC	0.031
	PPCC1	0.990
	PPCC2	0.990

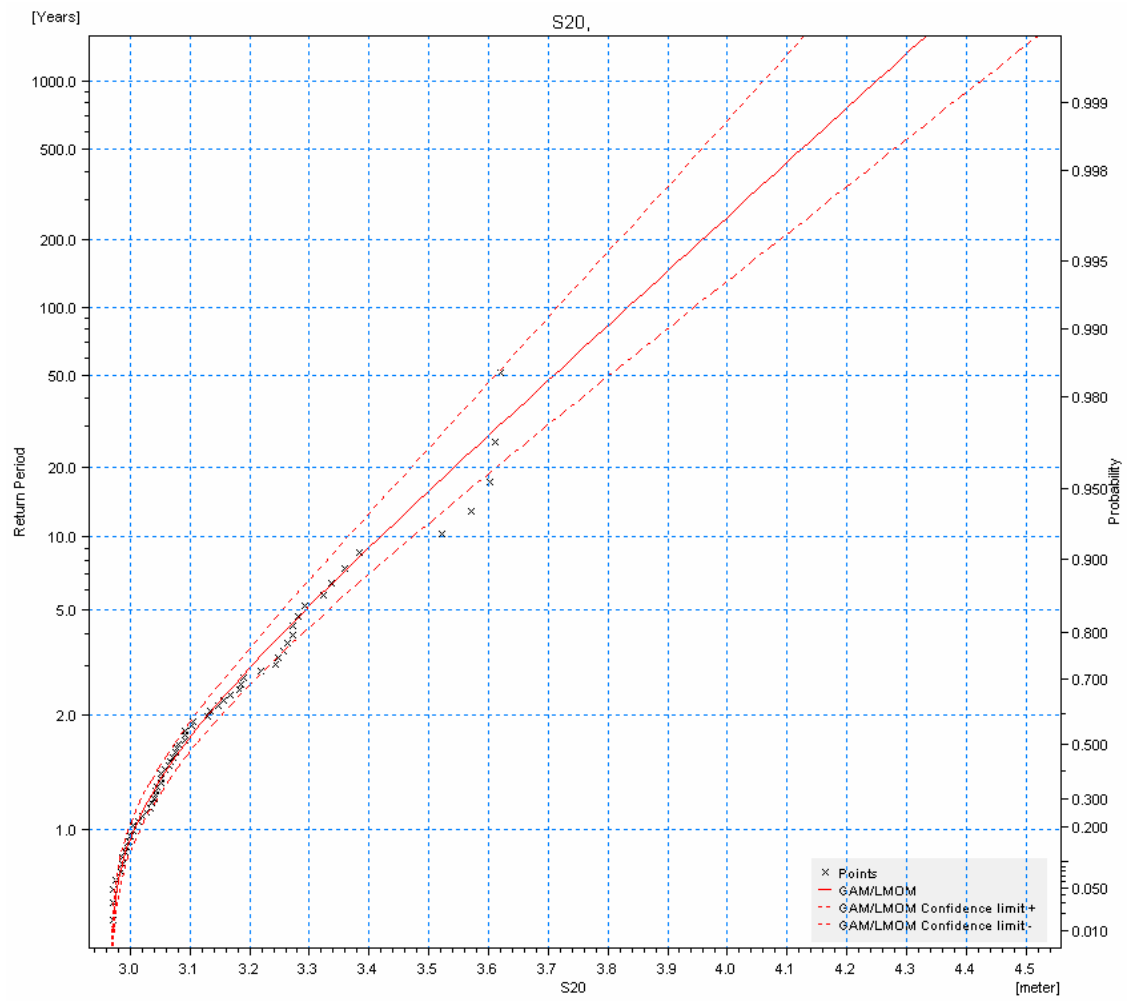


S20		
	D/E Combination	
	Return Period [years]	GAM/LMOM
Estimated quantile	2.00	3.130
	5.00	3.294
	10.00	3.418
	20.00	3.543
	50.00	3.708
	100.00	3.833
	200.00	3.959
	1000.00	4.249
Average quantile	2.00	3.130
	5.00	3.294
	10.00	3.418
	20.00	3.542
	50.00	3.706
	100.00	3.830
	200.00	3.954
	1000.00	4.242
Standard deviation	2.00	0.022
	5.00	0.038
	10.00	0.054
	20.00	0.071
	50.00	0.095
	100.00	0.115
	200.00	0.135
	1000.00	0.182
Goodness-of-fit statistics	SLSC	0.033
	PPCC1	0.989
	PPCC2	0.989

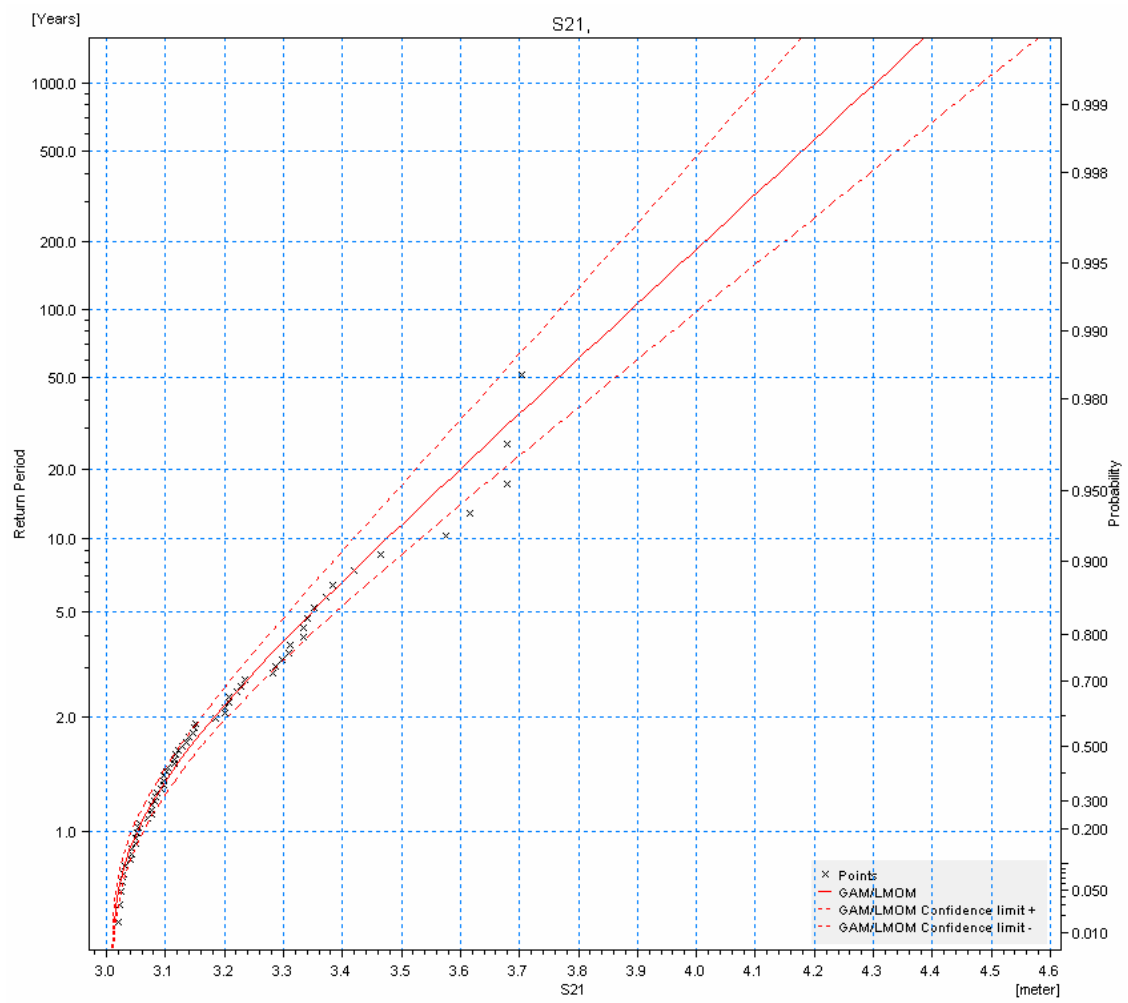


S21		
		D/E Combination
	Return Period [years]	GAM/LMOM
Estimated quantile	2.00	3.182
	5.00	3.349
	10.00	3.475
	20.00	3.600
	50.00	3.765
	100.00	3.890
	200.00	4.014
	1000.00	4.303
Average quantile	2.00	3.182
	5.00	3.350
	10.00	3.475
	20.00	3.599
	50.00	3.763
	100.00	3.887
	200.00	4.010
	1000.00	4.297
Standard deviation	2.00	0.022
	5.00	0.040
	10.00	0.056
	20.00	0.074
	50.00	0.099
	100.00	0.119
	200.00	0.139
	1000.00	0.186
Goodness-of-fit statistics	SLSC	0.031
	PPCC1	0.990
	PPCC2	0.990

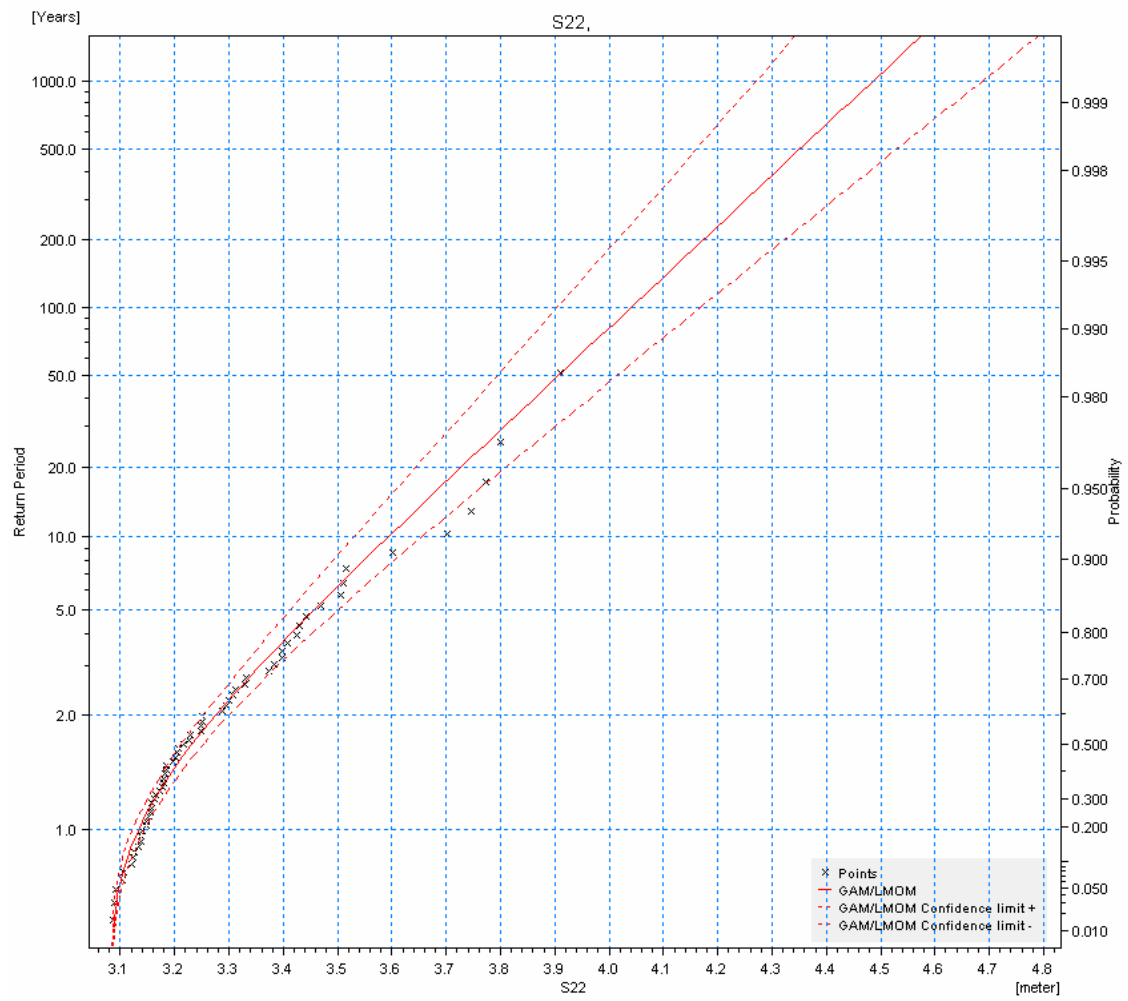


S22		
		D/E Combination
	Return Period [years]	GAM/LMOM
Estimated quantile	2.00	3.275
	5.00	3.457
	10.00	3.593
	20.00	3.728
	50.00	3.906
	100.00	4.040
	200.00	4.174
	1000.00	4.485
Average quantile	2.00	3.276
	5.00	3.457
	10.00	3.592
	20.00	3.727
	50.00	3.904
	100.00	4.037
	200.00	4.170
	1000.00	4.478
Standard deviation	2.00	0.024
	5.00	0.044
	10.00	0.063
	20.00	0.083
	50.00	0.111
	100.00	0.132
	200.00	0.155
	1000.00	0.208
Goodness-of-fit statistics	SLSC	0.026
	PPCC1	0.994
	PPCC2	0.994

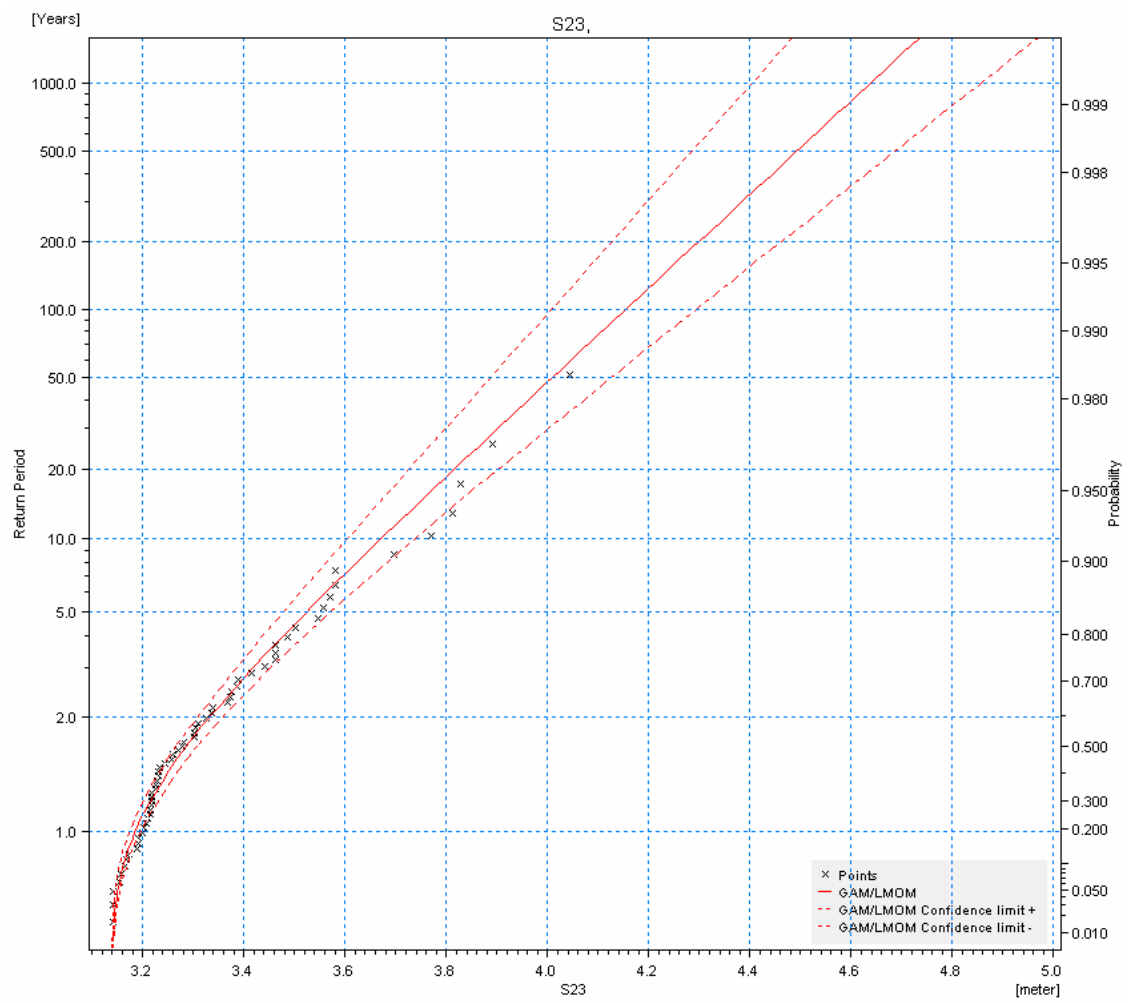


S23		
		D/E Combination
	Return Period [years]	GAM/LMOM
Estimated quantile	2.00	3.332
	5.00	3.525
	10.00	3.671
	20.00	3.816
	50.00	4.009
	100.00	4.154
	200.00	4.300
	1000.00	4.638
Average quantile	2.00	3.333
	5.00	3.525
	10.00	3.670
	20.00	3.815
	50.00	4.006
	100.00	4.151
	200.00	4.295
	1000.00	4.630
Standard deviation	2.00	0.025
	5.00	0.047
	10.00	0.067
	20.00	0.089
	50.00	0.119
	100.00	0.143
	200.00	0.168
	1000.00	0.226
Goodness-of-fit statistics	SLSC	0.023
	PPCC1	0.996
	PPCC2	0.996

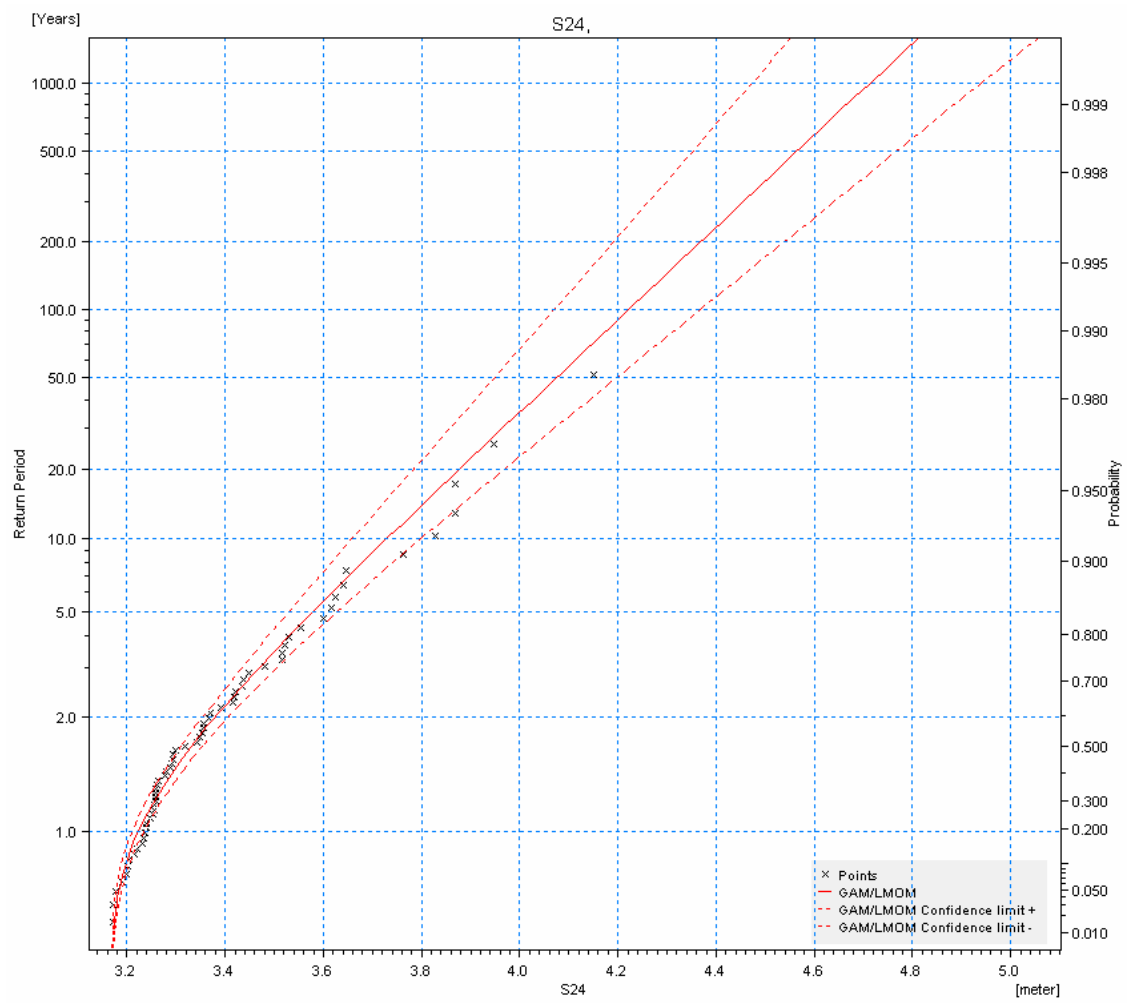

S24		
		D/E Combination
	Return Period [years]	GAM/LMOM
Estimated quantile	2.00	3.379
	5.00	3.579
	10.00	3.728
	20.00	3.878
	50.00	4.074
	100.00	4.222
	200.00	4.370
	1000.00	4.713
Average quantile	2.00	3.379
	5.00	3.579
	10.00	3.728
	20.00	3.877
	50.00	4.072
	100.00	4.219
	200.00	4.366
	1000.00	4.706
Standard deviation	2.00	0.026
	5.00	0.049
	10.00	0.070
	20.00	0.092
	50.00	0.124
	100.00	0.149
	200.00	0.174
	1000.00	0.234
Goodness-of-fit statistics	SLSC	0.024
	PPCC1	0.996
	PPCC2	0.996

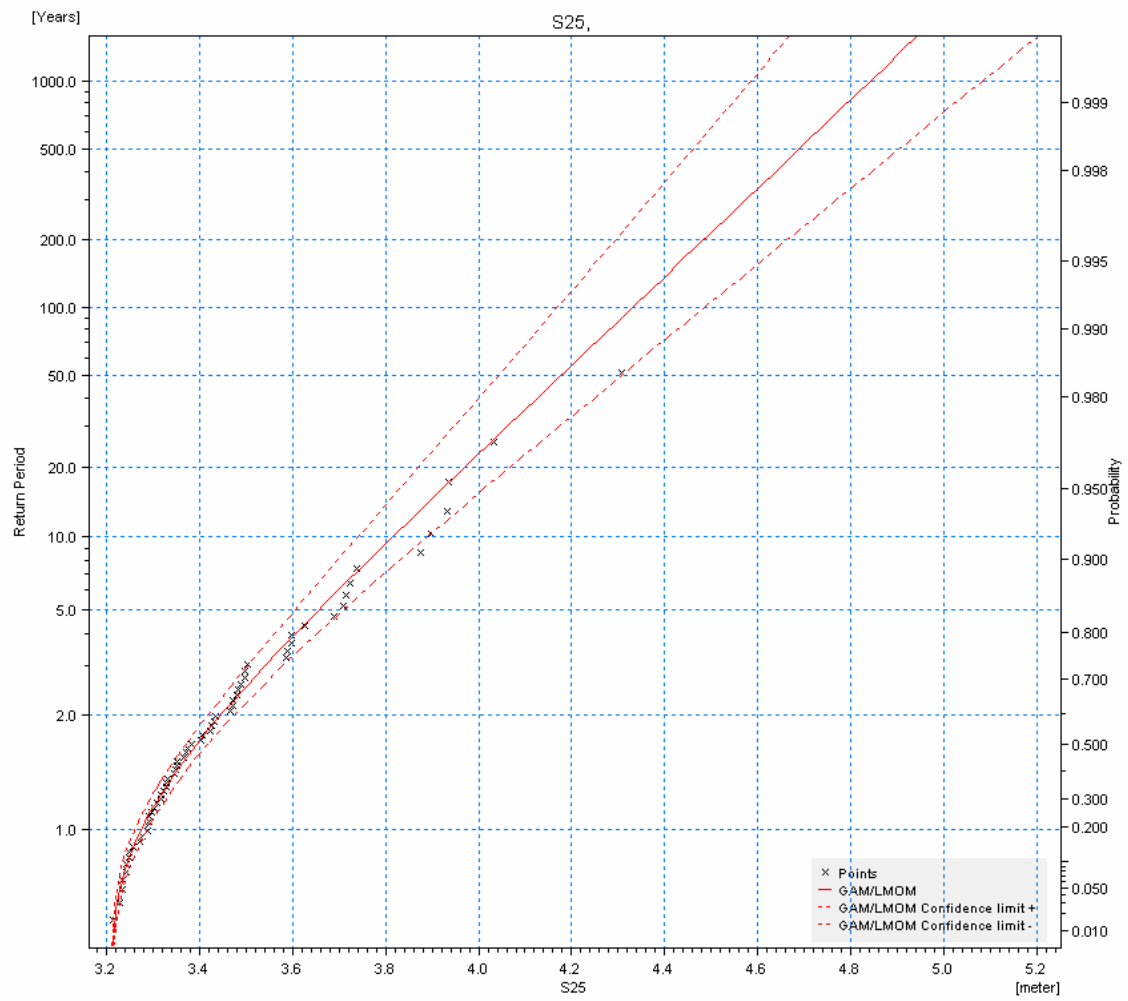

S25		
		D/E Combination
	Return Period [years]	GAM/LMOM
Estimated quantile	2.00	3.445
	5.00	3.657
	10.00	3.815
	20.00	3.971
	50.00	4.176
	100.00	4.331
	200.00	4.485
	1000.00	4.841
Average quantile	2.00	3.446
	5.00	3.658
	10.00	3.815
	20.00	3.970
	50.00	4.174
	100.00	4.327
	200.00	4.480
	1000.00	4.834
Standard deviation	2.00	0.028
	5.00	0.052
	10.00	0.074
	20.00	0.098
	50.00	0.132
	100.00	0.158
	200.00	0.185
	1000.00	0.249
Goodness-of-fit statistics	SLSC	0.025
	PPCC1	0.996
	PPCC2	0.996

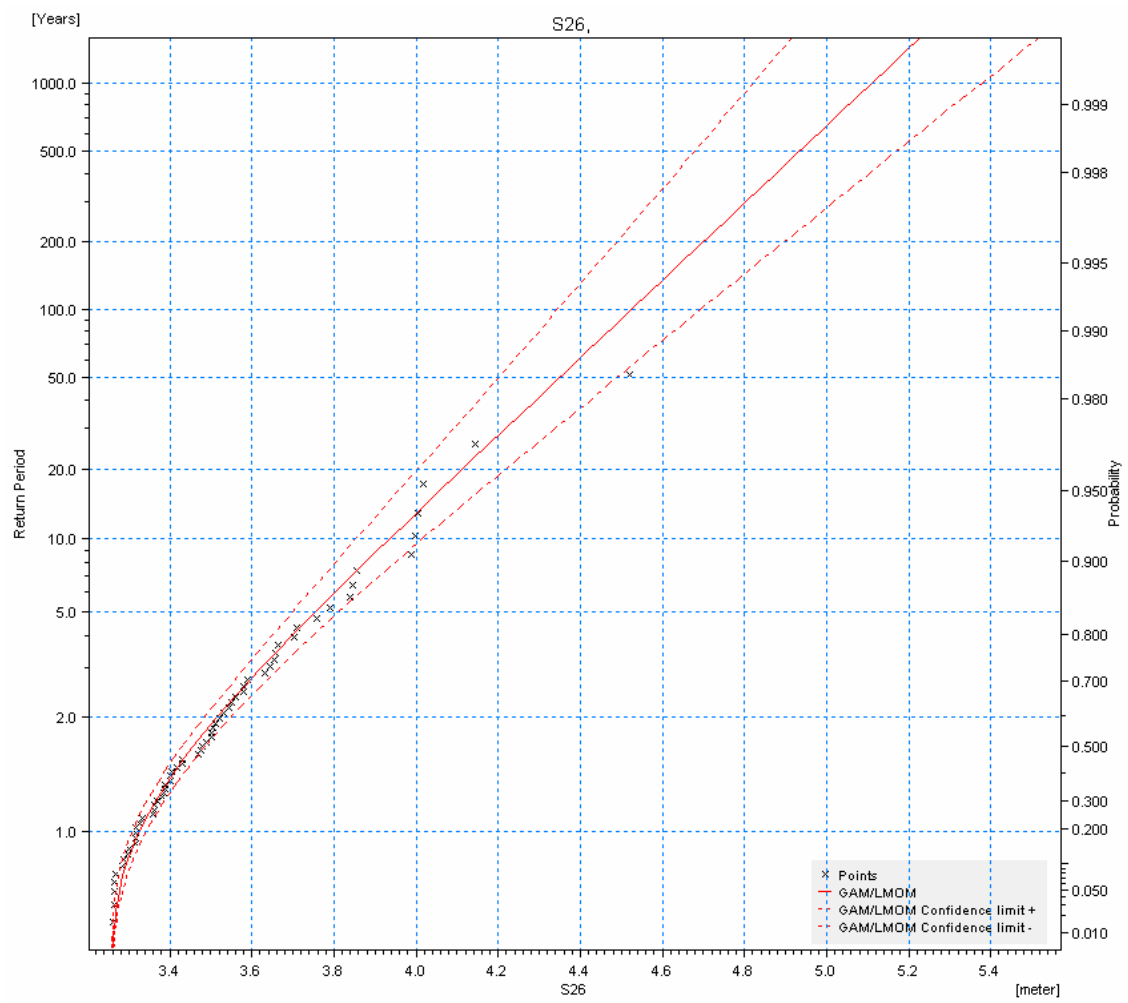

S26		
	D/E Combination	
	Return Period [years]	GAM/LMOM
Estimated quantile	2.00	3.515
	5.00	3.755
	10.00	3.935
	20.00	4.113
	50.00	4.348
	100.00	4.525
	200.00	4.702
	1000.00	5.112
Average quantile	2.00	3.515
	5.00	3.756
	10.00	3.934
	20.00	4.111
	50.00	4.344
	100.00	4.520
	200.00	4.695
	1000.00	5.100
Standard deviation	2.00	0.032
	5.00	0.057
	10.00	0.081
	20.00	0.107
	50.00	0.145
	100.00	0.175
	200.00	0.205
	1000.00	0.278
Goodness-of-fit statistics	SLSC	0.024
	PPCC1	0.995
	PPCC2	0.995